
# COUNTY OF SAN MATEO CALIFORNIA

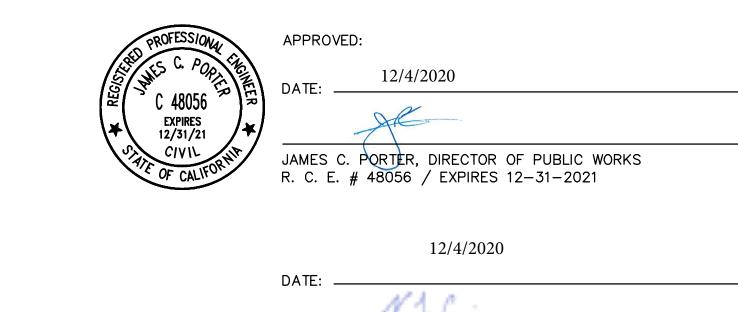


# COYOTE POINT RECREATION AREA EASTERN PROMENADE REJUVENATION PROJECT

IN UNINCORPORATED SAN MATEO COUNTY

TOTAL PROJECT PROMENADE LENGTH APPROXIMATELY 1,000 FEET

TO BE SUPPLEMENTED BY STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION STANDARD PLANS DATED MAY 2006 AND ADOPTED BY SAN MATEO COUNTY, NOVEMBER 14, 2006, BY RESOLUTION NO. 068389

# **PROJECT** SITE HALF MOON BAY VICINITY MAP

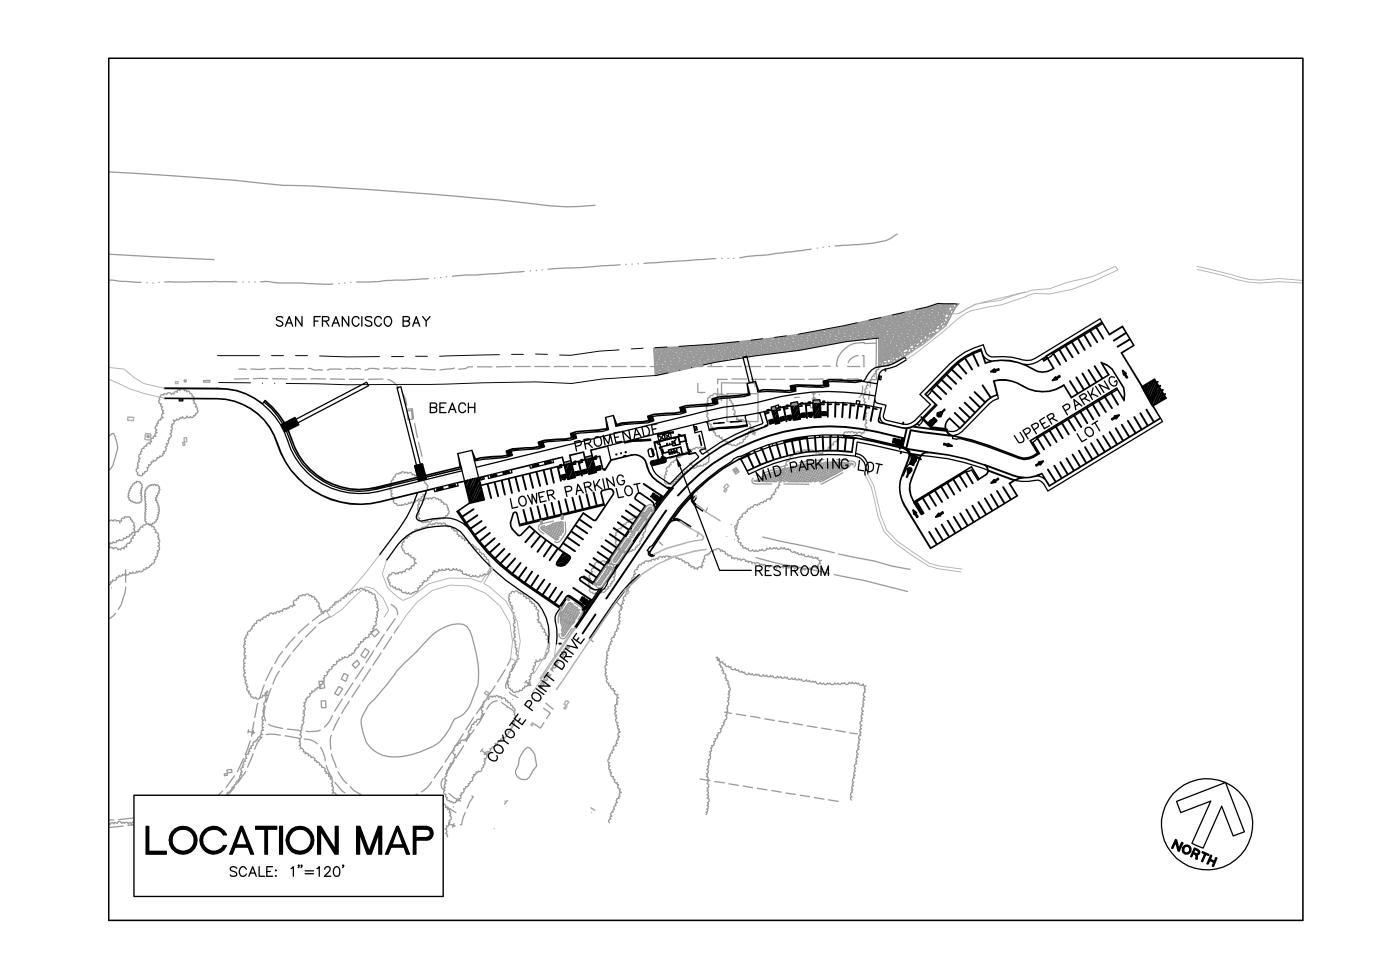

0123045678901123456789012234567890123456789012345678901234555555555555555555555555555555555555	U-1 U-2 U-3 U-4 U-5 EC-1	KEYMAP DEMOLITION PLAN DEMOLITION PLAN HORIZONTAL CONTROL PLAN HORIZONTAL CONTROL PLAN PAVING PLAN SIGNAGE PLAN TYPICAL CROSS SECTIONS GRADING AND DRAINAGE PLAN GRADING AND DRAINAGE PLAN VERTICAL CURVE PROFILES UTILITY PLAN UTILITY PLAN STORMWATER MANAGEMENT PLAN UTILITY PROFILES UTILITY PROFILES UTILITY PROFILES
51	E-1	GENERAL NOTES, LEGEND, ABBREVIATIONS, AND DRAWING INDEX
53	E-3	SINGLE LINE DIAGRAM
56 57	E-6	POWER AND LIGHTING ENLARGED PLAN — SHT. 2
57 50	E-7	LIGHTING SCHEDULE AND PANEL SCHEDULES
58	E-8	ELECTRICAL DETAILS
59	E-9	EXISTING DUCTBANK VERTICAL RE-ALIGNMENT
		OOVOTE DOINT DEODEATION ADEA



THIS PROJECT SITE IMPROVEMENT PLANS HAS BEEN PREPARED UNDER MY DIRECTION. 3-18-2020

ROLAND N.V. HAGA, VICE-PRESIDENT

P.E. #C043971 / EXPIRES 6-11-2021

APPROVED DATE: JONATHAN TANG, PROJECT MANAGER BKF ENGINEERS P.E. #C67726 / EXPIRES 6-30-2021





DESIGNED BY: MD REVISION

COYOTE POINT RECREATION AREA SCALE: AS SHOWN EASTERN PROMENADE REJUVENATION PROJECT DATE: 4/9/2020

555 COUNTY CENTER, 5th FLOOR JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS SAN MATEO COUNTY REDWOOD CITY, CALIFORNIA 94063 DATE T-1 SHEET 1 OF 59

TITLE SHEET

# PROJECT DESCRIPTION: THE PROPOSED COYOTE POINT RECREATION AREA EASTERN PROMENADE REJUVENATION PROJECT

PHYSICAL DESCRIPTION OF SITE: THE COYOTE POINT RECREATION AREA (COYOTE POINT) IS LOCATED ALONG 1,800 FEET OF SAN FRANCISCO BAY SHORELINE

FROM THE EASTERN SIDE OF THE WESTERN PROMENADE PROJECT, TO THE COYOTE POINT HEADLAND, IN THE UNINCORPORATED AREAS OF THE COUNTY OF SAN MATEO.

COYOTE POINT RECREATION AREA, UNINCORPORATED SAN MATEO COUNTY.

STORM DRAIN: COUNTY WATER: COUNTY SANITARY SEWER: COUNTY GAS/ELECTRIC: PG&E

#### **EXISTING TOPOGRAPHY**

THE EXISTING TOPOGRAPHY IS BASED ON TOPOGRAPHY SURVEY PERFORMED BY BKF DATED SEPTEMBER 2015.

#### REFERENCES

6. COUNTY

TO BE SUPPLEMENTED BY STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION STANDARD PLANS DATED MAY 2006 AND ADOPTED BY SAN MATEO COUNTY, NOVEMBER 14, 2006, BY RESOLUTION NO. 068389

#### PROJECT NOTES:

BKF ENGINEERS 1. CIVIL ENGINEER 255 SHORELINE DRIVE, SUITE 200 REDWOOD CITY, CA 94065 TEL 650.482.6300

MIGITRA 2. LANDSCAPE ARCHITECT

> 800 HEARST AVENUE BERKELEY, CA 94710 TEL 510.845.8750

ENVIRONMENTAL MIGITRA 800 HEARST AVENUE

BERKELEY, CA 94710 TEL 510.845.8750

4. SHORELINE PROTECTION MOFFATT & NICHOL

2185 N. CALIFORNIA BOULEVARD, SUITE 500

WALNUT CREEK, CA 94596 TEL 925.944.5411

5. ELECTRICAL ENGINEER MTH ENGINEERS

3350 SCOTT BOULEVARD, #11 SANTA CLARA, CA 95054

TEL 408.986.8558

COUNTY OF SAN MATEO 555 COUNTY CENTER, 5TH FLOOR

REDWOOD CITY, CA 94063 TEL 650.363.4100

- 7. THE FOLLOWING NOTES ARE ESTABLISHED MERELY TO GUIDE THE CONTRACTOR AS TO THE GENERAL ITEMS OF WORK INVOLVED AND ARE NOT INTENDED TO COVER COMPLETE SCOPE OF WORK. CONTRACTOR SHALL COMPLETE ALL WORK AS PER CONTRACT DOCUMENTS.
- 8. CONSTRUCTION CONTRACTOR AGREES THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES. CONSTRUCTION CONTRACTOR WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR PERSONS AND PROPERTY: THIS REQUIREMENT SHALL BE MADE TO APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS. CONTRACTOR FURTHER AGREES TO DEFEND, INDEMNIFY AND HOLD DESIGN PROFESSIONAL HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF WORK ON THIS PROJECT, EXCEPTING LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF THE DESIGN PROFESSIONAL.
- 9. ALL MATERIALS, WORK APPURTENANCES SHALL CONFORM WITH THESE PLANS. THE PROJECT SPECIFICATIONS AND THE LATEST ADOPTED VERSION OF SAN MATEO COUNTY STANDARD DETAILS.
- 10. THE CONTRACTOR SHALL AT ALL TIMES COMPLY WITH THE RULES AND REGULATIONS ESTABLISHED BY CAL-OSHA AND OTHER AGENCIES HAVING JURISDICTION OVER THE WORK.
- 11. THE CONTRACTOR SHALL NOT DESTROY ANY PERMANENT SURVEY POINTS OR MONUMENTS WITHOUT THE CONSENT OF THE COUNTY. ANY PERMANENT MONUMENTS OR POINTS DESTROYED SHALL BE REPLACED BY A REGISTERED CIVIL ENGINEER OR LICENSED LAND SURVEYOR AT THE CONTRACTOR'S EXPENSE.
- 12. THE CONTRACTOR IS RESPONSIBLE FOR MATCHING EXISTING ROADWAYS, SURROUNDING LANDSCAPE AND OTHER IMPROVEMENTS WITH A SMOOTH TRANSITION IN PAVING, CURBS, GUTTERS, SIDEWALKS, GRADING, ETC. AND TO AVOID ANY ABRUPT OR APPARENT CHANGES IN GRADES OR CROSS SLOPES, LOW SPOTS OR HAZARDOUS CONDITIONS.
- 13. THE LOCATIONS AND TYPES OF EXISTING UTILITIES SHOWN ON THE PLANS ARE BASED ON INFORMATION FURNISHED BY SERVICING AGENCIES AND FIELD SURVEY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE POSITION OF AND PROVIDE PROTECTION FOR SUCH UTILITIES AND STRUCTURES, WHETHER SHOWN ON THE PLAN OR
- 14.IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO IMMEDIATELY NOTIFY THE ENGINEER UPON DISCOVERY OF ANY FIELD CONFLICTS.
- 15. THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ANY FIELD CHANGES DONE WITHOUT WRITTEN AUTHORIZATION FROM
- 16. ANY DEVIATIONS OR CHANGES IN THESE PLANS WITHOUT WRITTEN APPROVAL OF THE ENGINEER SHALL BE AT THE CONTRACTOR'S OWN RISK.
- 17. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS SHOWN.
- 18. ELEVATIONS AND LOCATIONS OF ALL EXISTING UTILITY CROSSINGS SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO START OF ANY CONSTRUCTION AFFECTING SAID LINES. CONTACT USA AT (800) 227-2600 AT LEAST TWO WORKING DAYS PRIOR TO EXCAVATION.
- 19. CONTRACTOR SHALL CONFINE HIS OPERATIONS AND ACTIVITIES WITHIN THE PROJECT LIMITS, CONSISTING OF ROAD RIGHT-OF-WAY, UTILITY EASEMENTS, AND/OR PROJECT CONFORMS, AS SHOWN ON THE PLANS.

#### PROJECT NOTES (CONTINUED):

- 20. THE CONTRACTOR SHALL RESTORE ALL DAMAGED, REMOVED OR OTHERWISE DISTURBED WALLS, FENCES, SERVICES, UTILITIES. IMPROVEMENTS OR FEATURES OF WHATEVER NATURE. DUE TO CONTRACTOR'S WORK. SEPARATE PAYMENT FOR RESTORATION OF EXISTING IMPROVEMENTS TO THEIR ORIGINAL CONDITION WILL NOT BE MADE. COMPENSATION FOR THIS TASK SHALL BE CONSIDERED AS INCLUDED IN THE VARIOUS CONTRACT ITEMS OF WORK INVOLVED.
- 21. ALL PERMANENT MONUMENTS DISTURBED DURING THE PROCESS OF CONSTRUCTION SHALL BE REPLACED BEFORE ACCEPTANCE OF THE IMPROVEMENTS BY THE COUNTY ENGINEER.
- 22. THE CONTRACTOR SHALL GIVE THE COUNTY ENGINEER A MINIMUM OF TWO WORKING DAYS ADVANCE NOTICE FOR
- 23. VEGETATION AND IMPROVEMENTS SHALL BE REMOVED ONLY WHEN DIRECTED IN WRITING BY THE ENGINEER. NO TREES. VEGETATION, OR IMPROVEMENTS (INCLUDING FENCES) SHALL BE REMOVED WITHOUT PRIOR WRITTEN CONSENT AND APPROVAL OF THE ENGINEER.
- 24.CONTINUOUS DUST CONTROL SHALL BE PROVIDED AS REQUIRED BY SECTION 17 "DEVELOP AND APPLY WATER," OF THE SPECIAL PROVISIONS AND AS DIRECTED BY THE ENGINEER.
- 25. THE CONTRACTOR SHALL FURNISH AND IMPLEMENT A WATER POLLUTION CONTROL PROGRAM FOR ALL PHASES OF WORK IN ACCORDANCE WITH SECTION 11-1, "WATER POLLUTION AND EROSION CONTROL," OF THE SPECIAL PROVISIONS.
- 26. THE CONTRACTOR SHALL FURNISH AND IMPLEMENT A TRAFFIC CONTROL PLAN FOR ALL PHASES OF WORK IN ACCORDANCE
- 27. NO TRENCHES OR HOLES SHALL BE LEFT OPEN OVERNIGHT, USE STEEL PLATING OR HOT-MIX ASPHALT AS REQUIRED TO PROTECT OPEN TRENCHES OVERNIGHT, OR AS DIRECTED BY ENGINEER.
- 28. STAGING AREAS FOR EQUIPMENT AND MATERIALS STORAGE SHALL BE LOCATED IN THE PUBLIC ROAD RIGHT-OF-WAY WITH SAID LOCATION SUBJECT TO THE APPROVAL OF THE ENGINEER.
- 29. ALL REVISIONS TO THIS PLAN MUST BE REVIEWED AND APPROVED BY THE ENGINEER PRIOR TO CONSTRUCTION AND SHALL BE ACCURATELY SHOWN ON REVISED PLANS STAMPED AND SIGNED BY COUNTY ENGINEER PRIOR TO THE INSTALLATION OF THE IMPROVEMENTS.

#### **GENERAL CONSTRUCTION NOTES:**

IN ACCORDANCE WITH THE NPDES PERMIT COMPLIANCE CHECKLIST FOR THE COUNTY OF SAN MATEO, THE CONTRACTOR SHALL COMPLY WITH THE FOLLOWING:

- 1. STORE, HANDLE AND DISPOSE OF CONSTRUCTION MATERIALS AND WASTES PROPERLY, SO AS TO PREVENT THEIR CONTACT WITH STORMWATER.
- 2. CONTROL AND PREVENT THE DISCHARGE OF ALL POTENTIAL POLLUTANTS, INCLUDING SOLID WASTES, PAINTS, CONCRETE, PETROLEUM PRODUCTS, CHEMICALS, WASHWATER OR SEDIMENTS AND NON-STORMWATER DISCHARGES TO STORM DRAINS AND WATERCOURSES.
- USE SEDIMENT CONTROL OR FILTRATION TO REMOVE SEDIMENT FROM DEWATERING EFFLUENT.

WITH SECTION 12, "MAINTAINING TRAFFIC," OF THE SPECIAL PROVISIONS.

- 4. AVOID CLEANING, FUELING OR MAINTAINING VEHICLES ON-SITE, EXCEPT IN A DESIGNATED AREA IN WHICH RUNOFF IS CONTAINED AND TREATED.
- 5. DELINEATE CLEARING LIMITS, EASEMENTS, SETBACKS, SENSITIVE OR CRITICAL AREAS, BUFFER ZONES, TREES, AND DRAINAGE COURSES WITH FIELD MARKERS, OR OTHER DELINEATOR, AS APPROVED BY THE ENGINEER
- 6. PROTECT ADJACENT PROPERTIES AND UNDISTURBED AREAS FROM CONSTRUCTION IMPACTS USING VEGETATIVE BUFFER STRIPS, SEDIMENT BARRIERS OR FILTERS, DIKES, MULCHING, OR OTHER MEASURES AS APPROPRIATE.
- 7. PERFORM CLEARING AND EARTH MOVING ACTIVITIES ONLY DURING DRY WEATHER OR AS APPROVED BY THE ENGINEER.
- 8. LIMIT CONSTRUCTION ACCESS ROUTES AND STABILIZE DESIGNATED ACCESS POINTS.
- 9. AVOID TRACKING DIRT OR OTHER MATERIALS OFF-SITE PAVED AREAS AND SIDEWALKS USING DRY SWEEPING METHODS.

#### **BENCHMARK:**


HORIZONTAL CONTROL IS CALIFORNIA STATE PLANE COORDINATE SYSTEM, ZONE 3, IN FEET; NAD83 (2011) 2011.00.

NORTHING AND EASTINGS ARE IN GRID COORDINATES. THE COMBINED GRID FACTOR IS 0.9999379 (THIS FACTOR IS THE PRODUCT OF THE CCS. ZONE 3 SCALE FACTOR OF 0.9999332 AND AN ELEVATION FACTOR OF 1.0000047). TO CONVERT FROM THE CALIFORNIA LAMBERT COORDINATE DISTANCES, MULTIPLY GRID DISTANCES BY THE RECIPROCÁL OF THE ABOVE COMBINED GRID FACTOR (EQUAL TO 1.0000621) TO GET GROUND DISTANCES.

PRIMARY SURVEY CONTROL BENCHMARKS USED (SEE SHEET OP-2 FOR LOCATIONS):

- CONTROL POINT 301: N 2041805.78, E 6031501.15, ELEVATION 10.08
- (PAINTED TARGET W/ NAIL AT WEST PARKING LOT)
- CONTROL POINT 302: N 2042489.96, E 6032999.87, ELEVATION 10.85 (PAINTED TARGET W/ NAIL AT EAST END PROMENADE)
- CONTROL POINT 303: N 2042125.18, E 6032620.75, ELEVATION 10.07 (PAINTED TARGET W/ NAIL AT PAVED TRAIL WEST OF EAST PARKING LOT)
- CONTROL POINT 304: N 2041254.31, E 6031752.22, ELEVATION 8.32 (PAINTED TARGET W/ NAIL AT PLAYGROUND PARKING LOT)
- CONTROL POINT 305: N 2041654.37, E 6032846.22, ELEVATION 6.30 (PAINTED TARGET W/ NAIL AT COYOTE POINT DRIVE)
- ALL ELEVATIONS ARE REFERENCED TO NORTH AMERICAN DATUM OF 1988 (NAVD88) IN FEET.
- THE TIDAL BENCHMARK 9414458 AT SAN MATEO BRIDGE WAS USED TO ESTABLISH TIDAL DATUM FOR THE PRESENT TIDAL EPOCH FROM 1983 TO 2001.

#### **ABBREVIATIONS:**

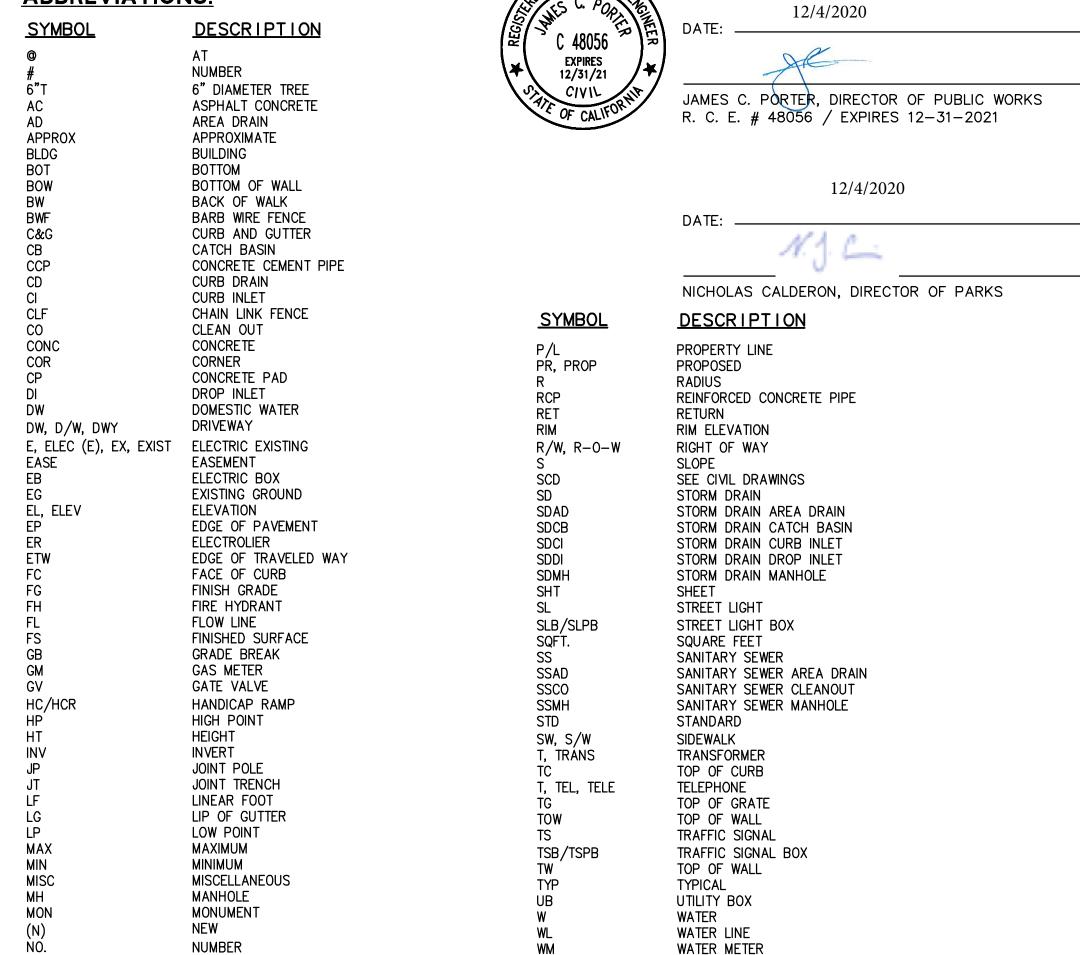

APPROVED:

WATER VALVE

WITH

#### **LEGEND:**


NOT TO SCALE

OVERHEAD

PAVEMENT

NTS


OH, O/

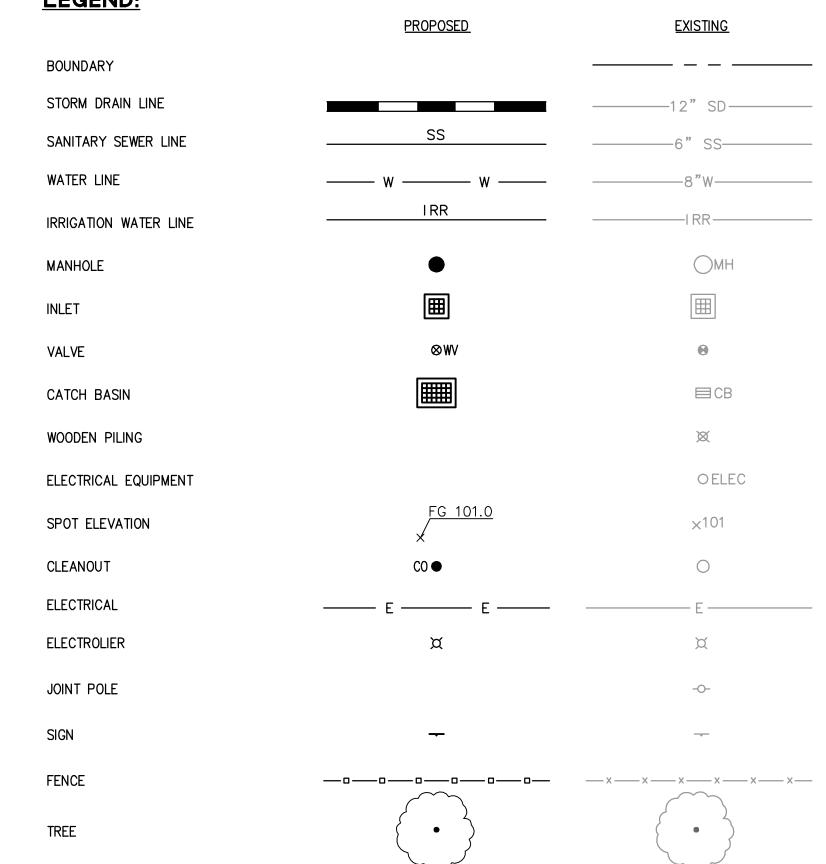







(650) 482-6300






		DESIGNED BY:	MD
		CHECKED BY:	JT
		DRAWN BY:	AG
		JAMES C.	PORT
REVISION	DATE		S
	FOR REDUCED P		0

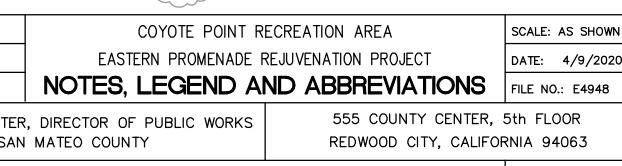



SHEET 2 OF 59


Know what's **below**.


Call before you dig.

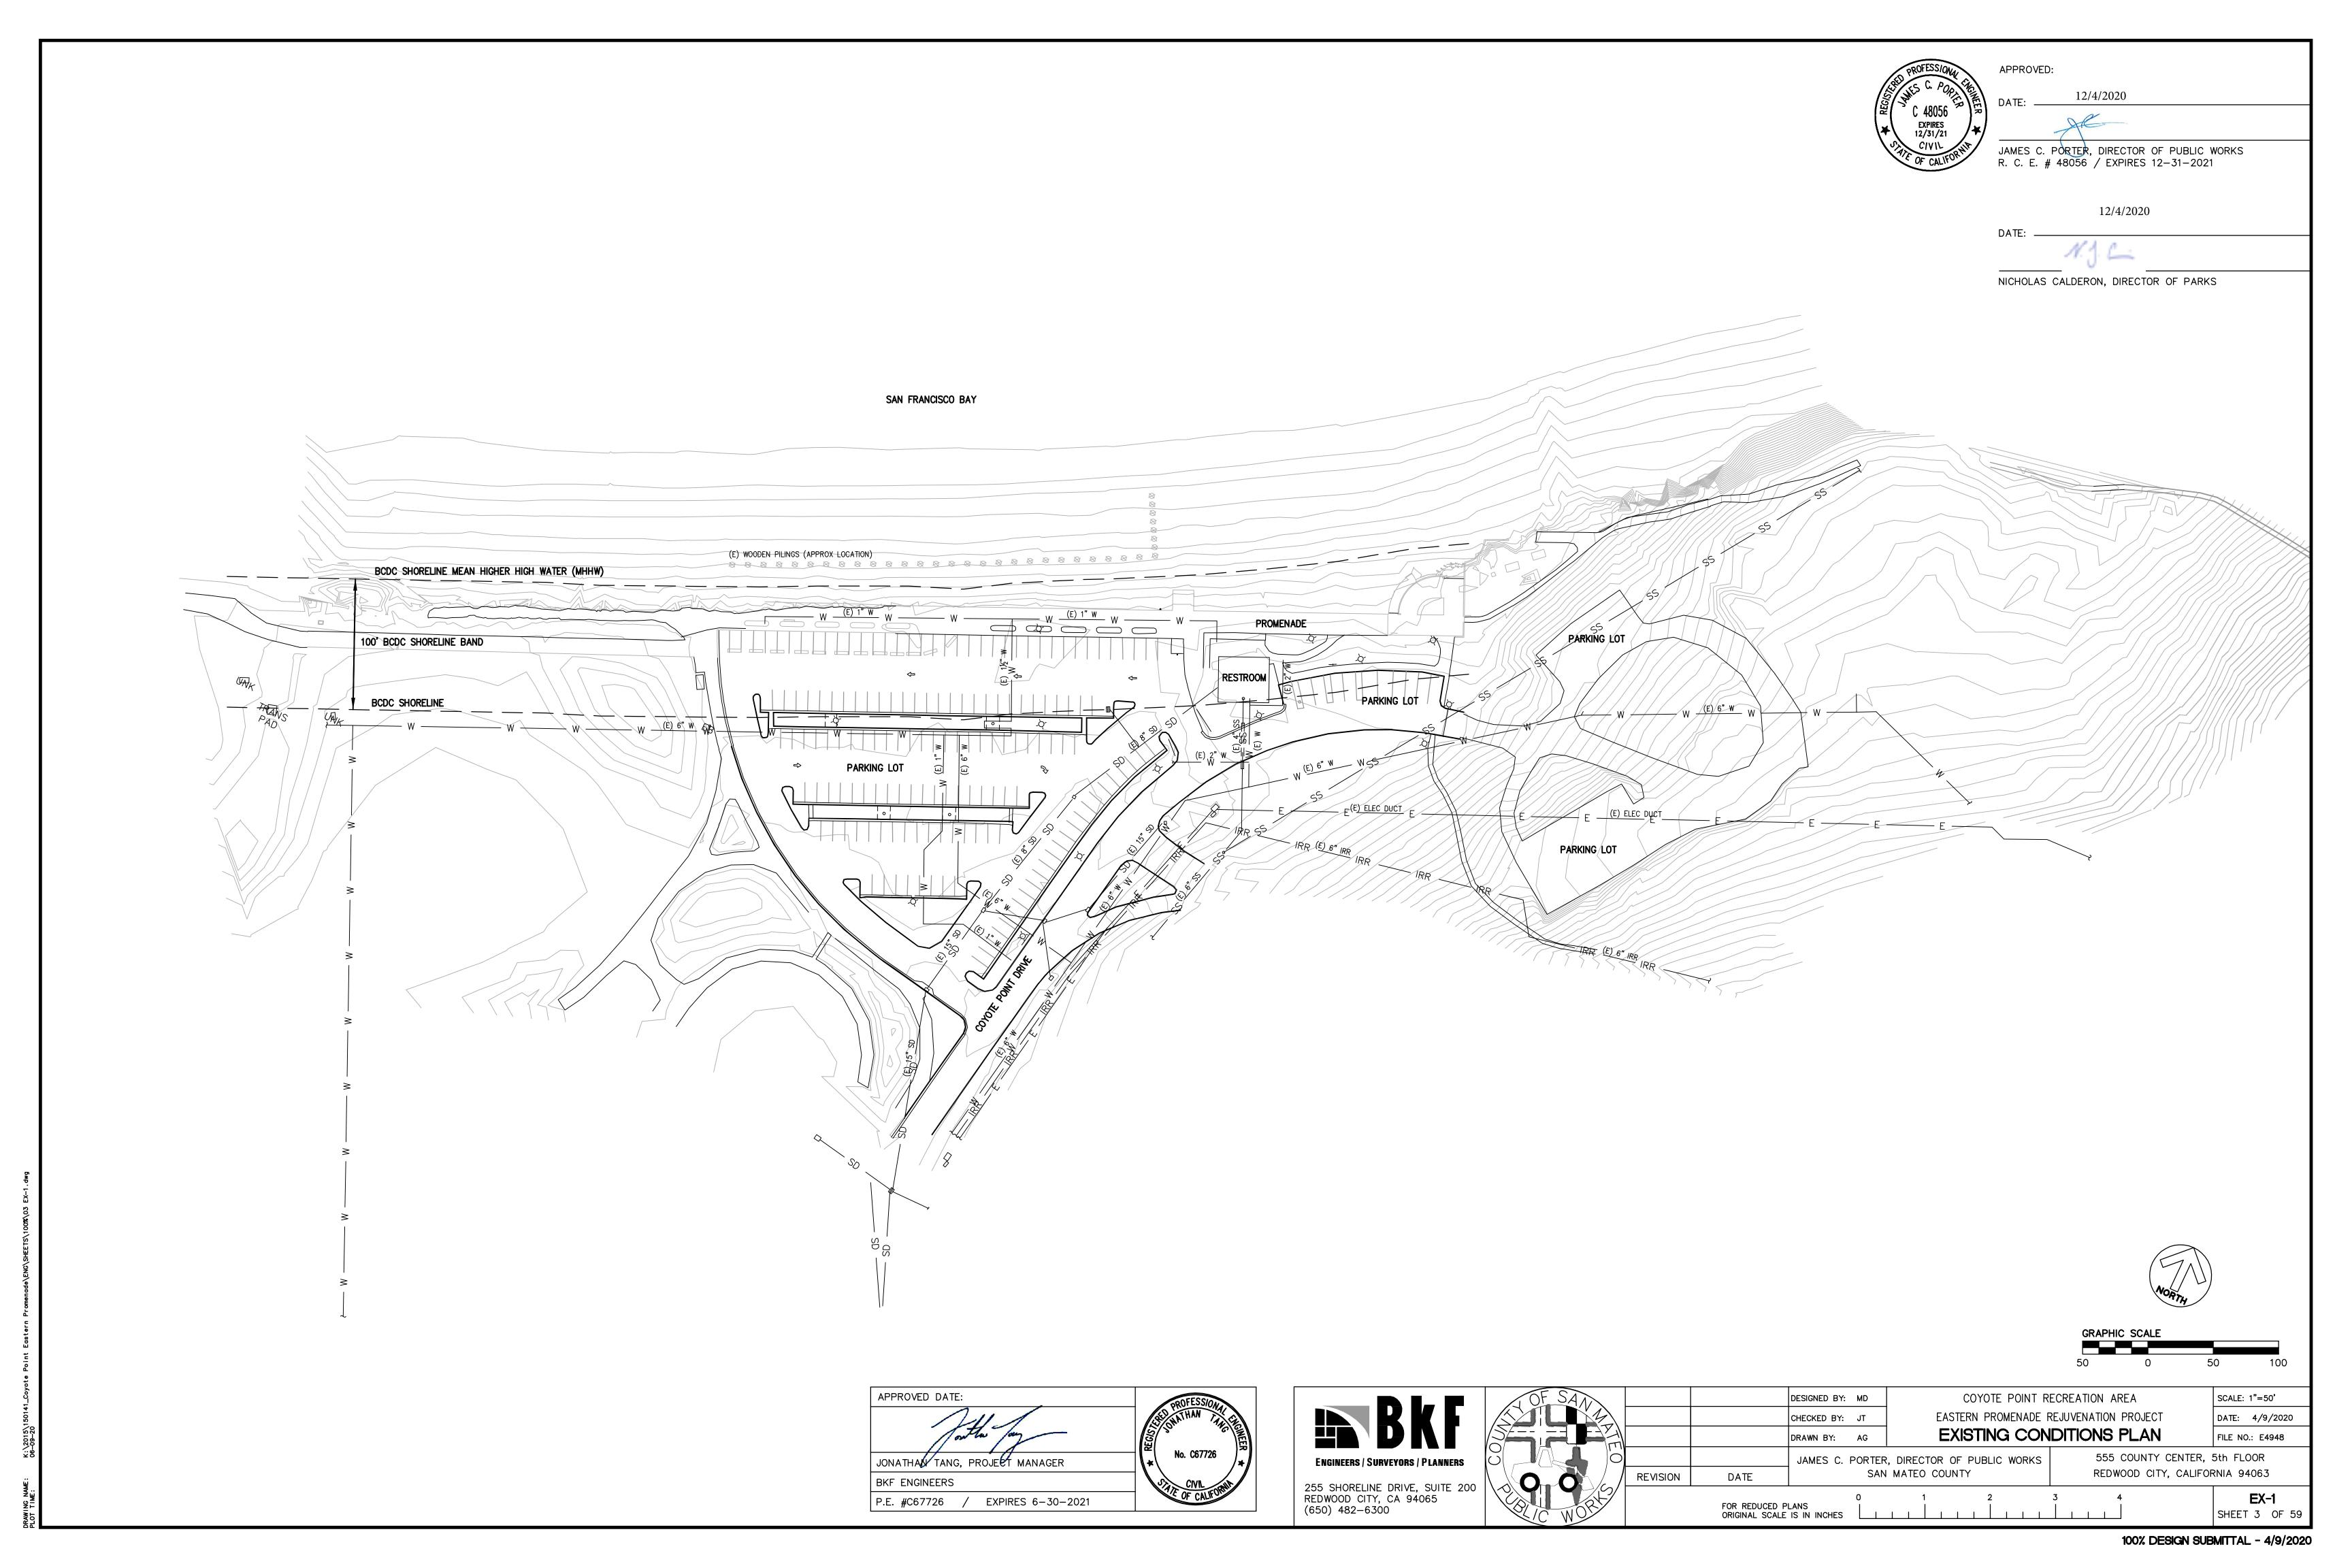


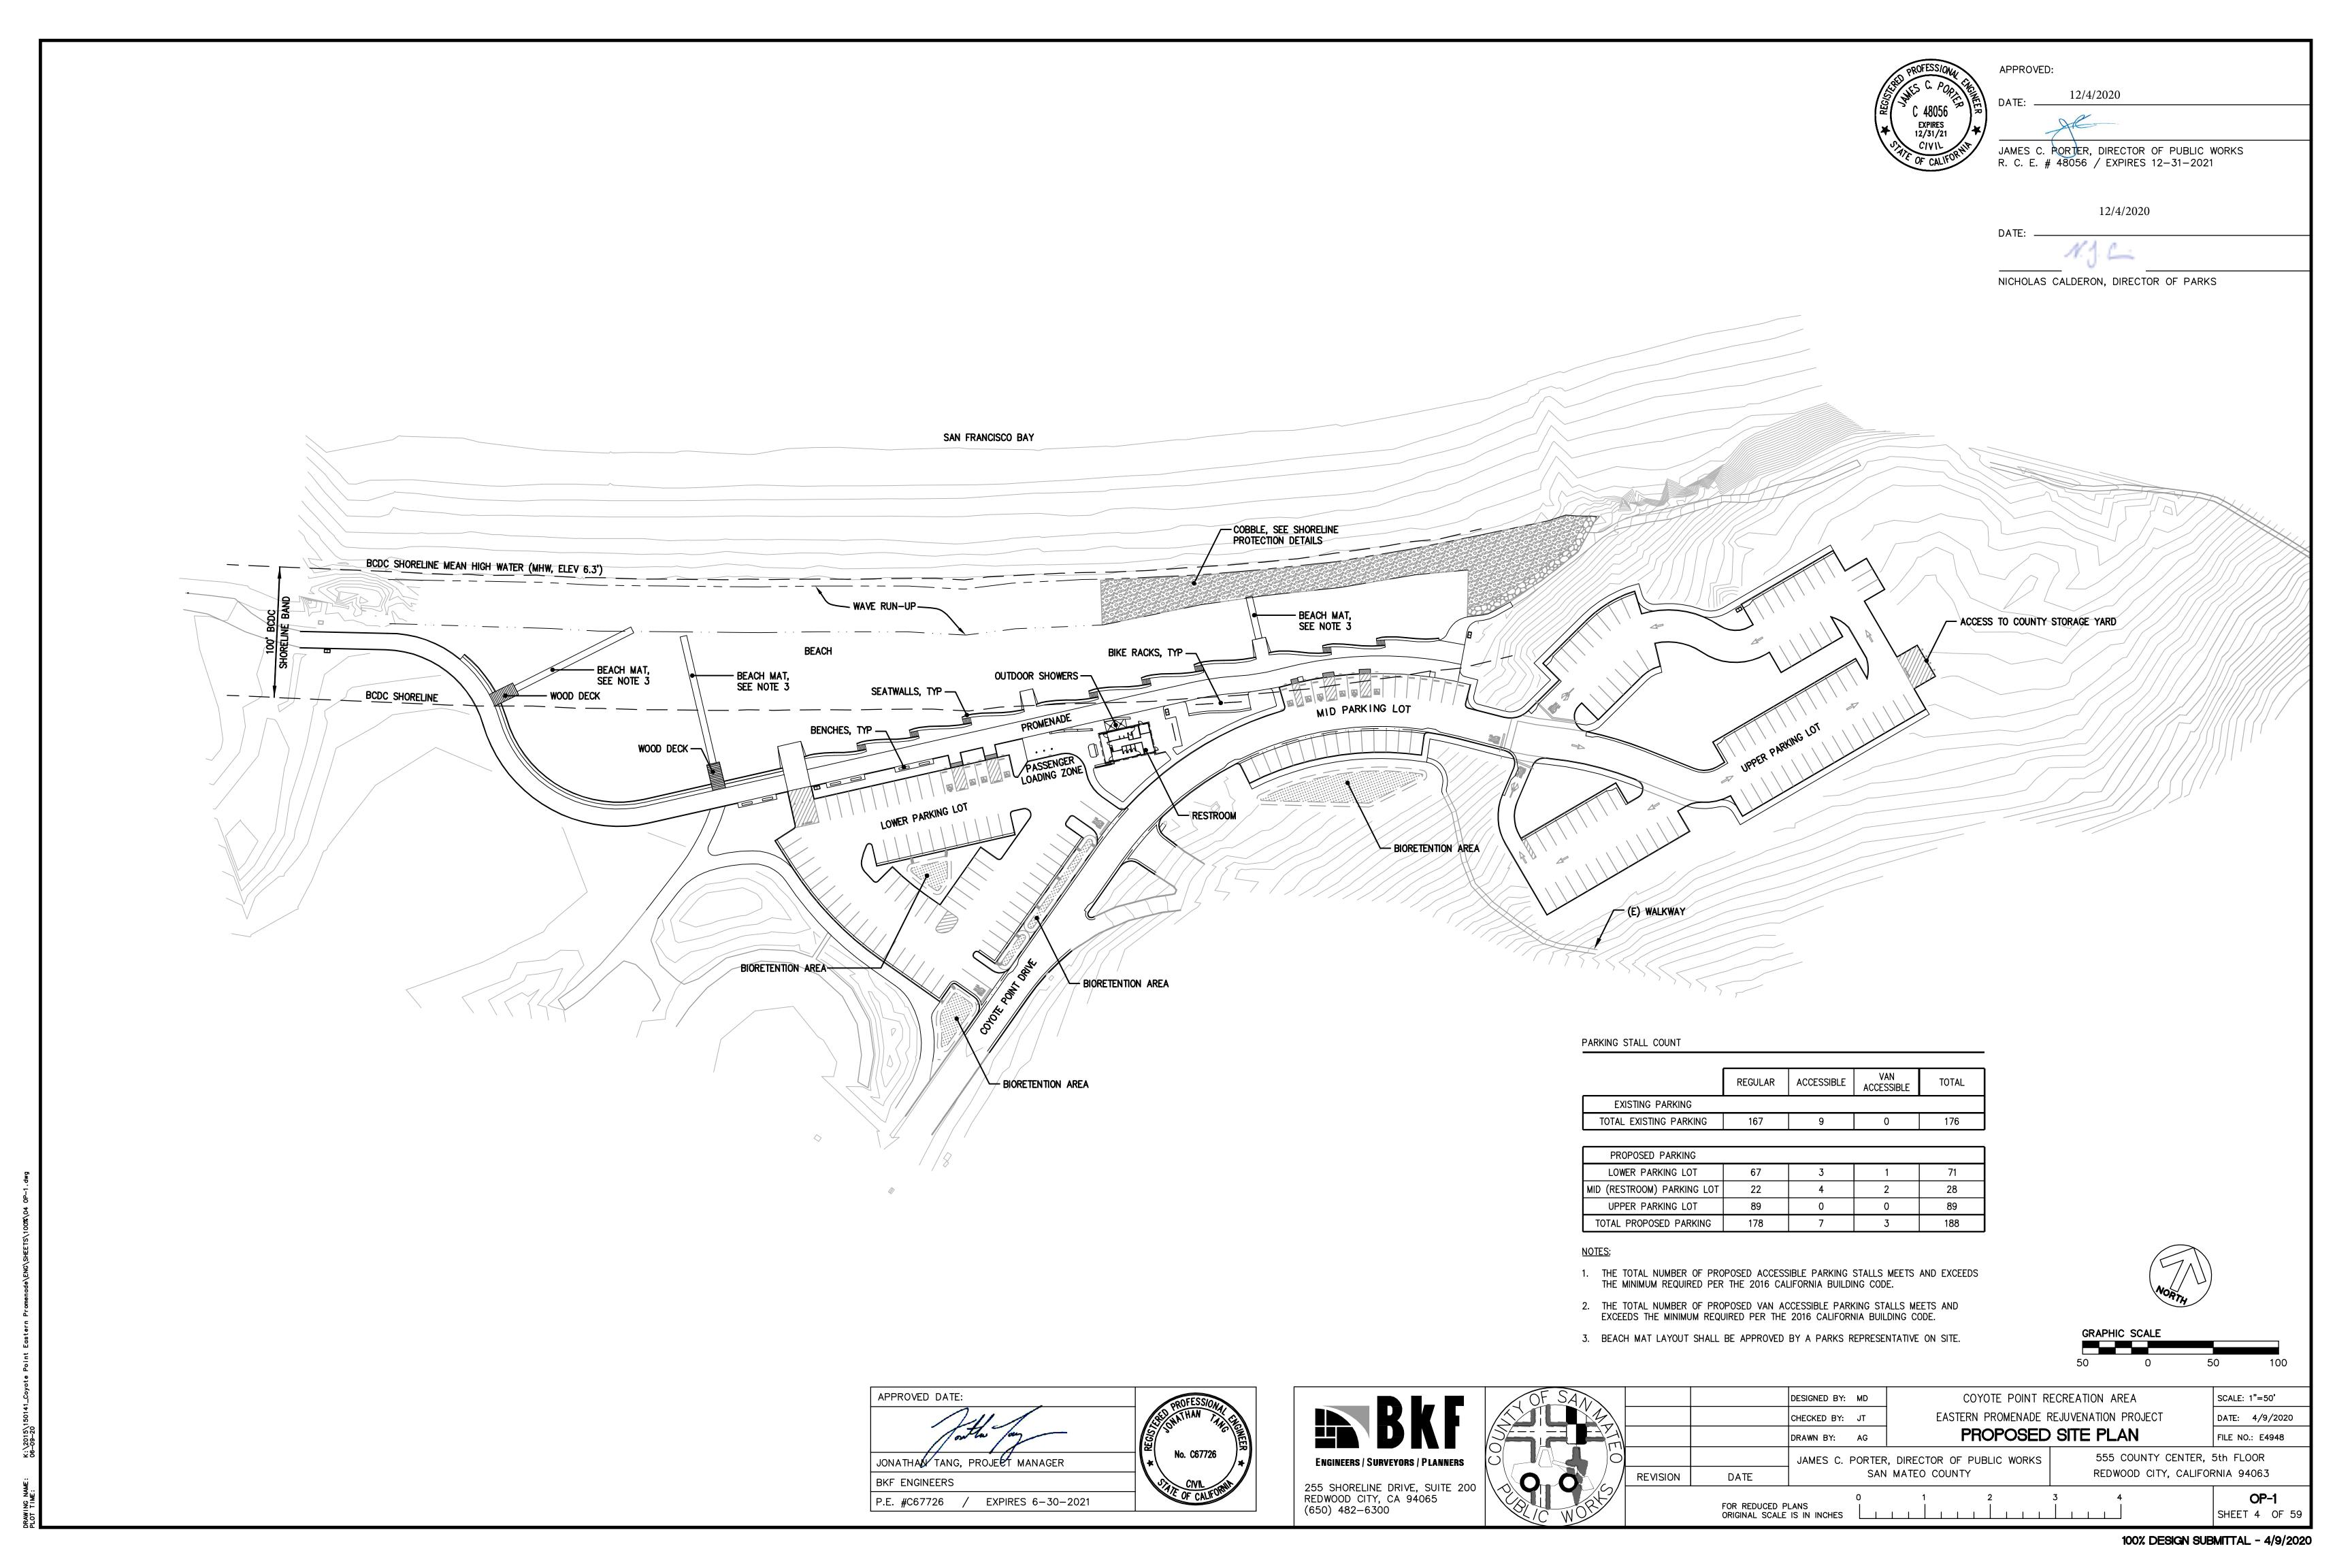


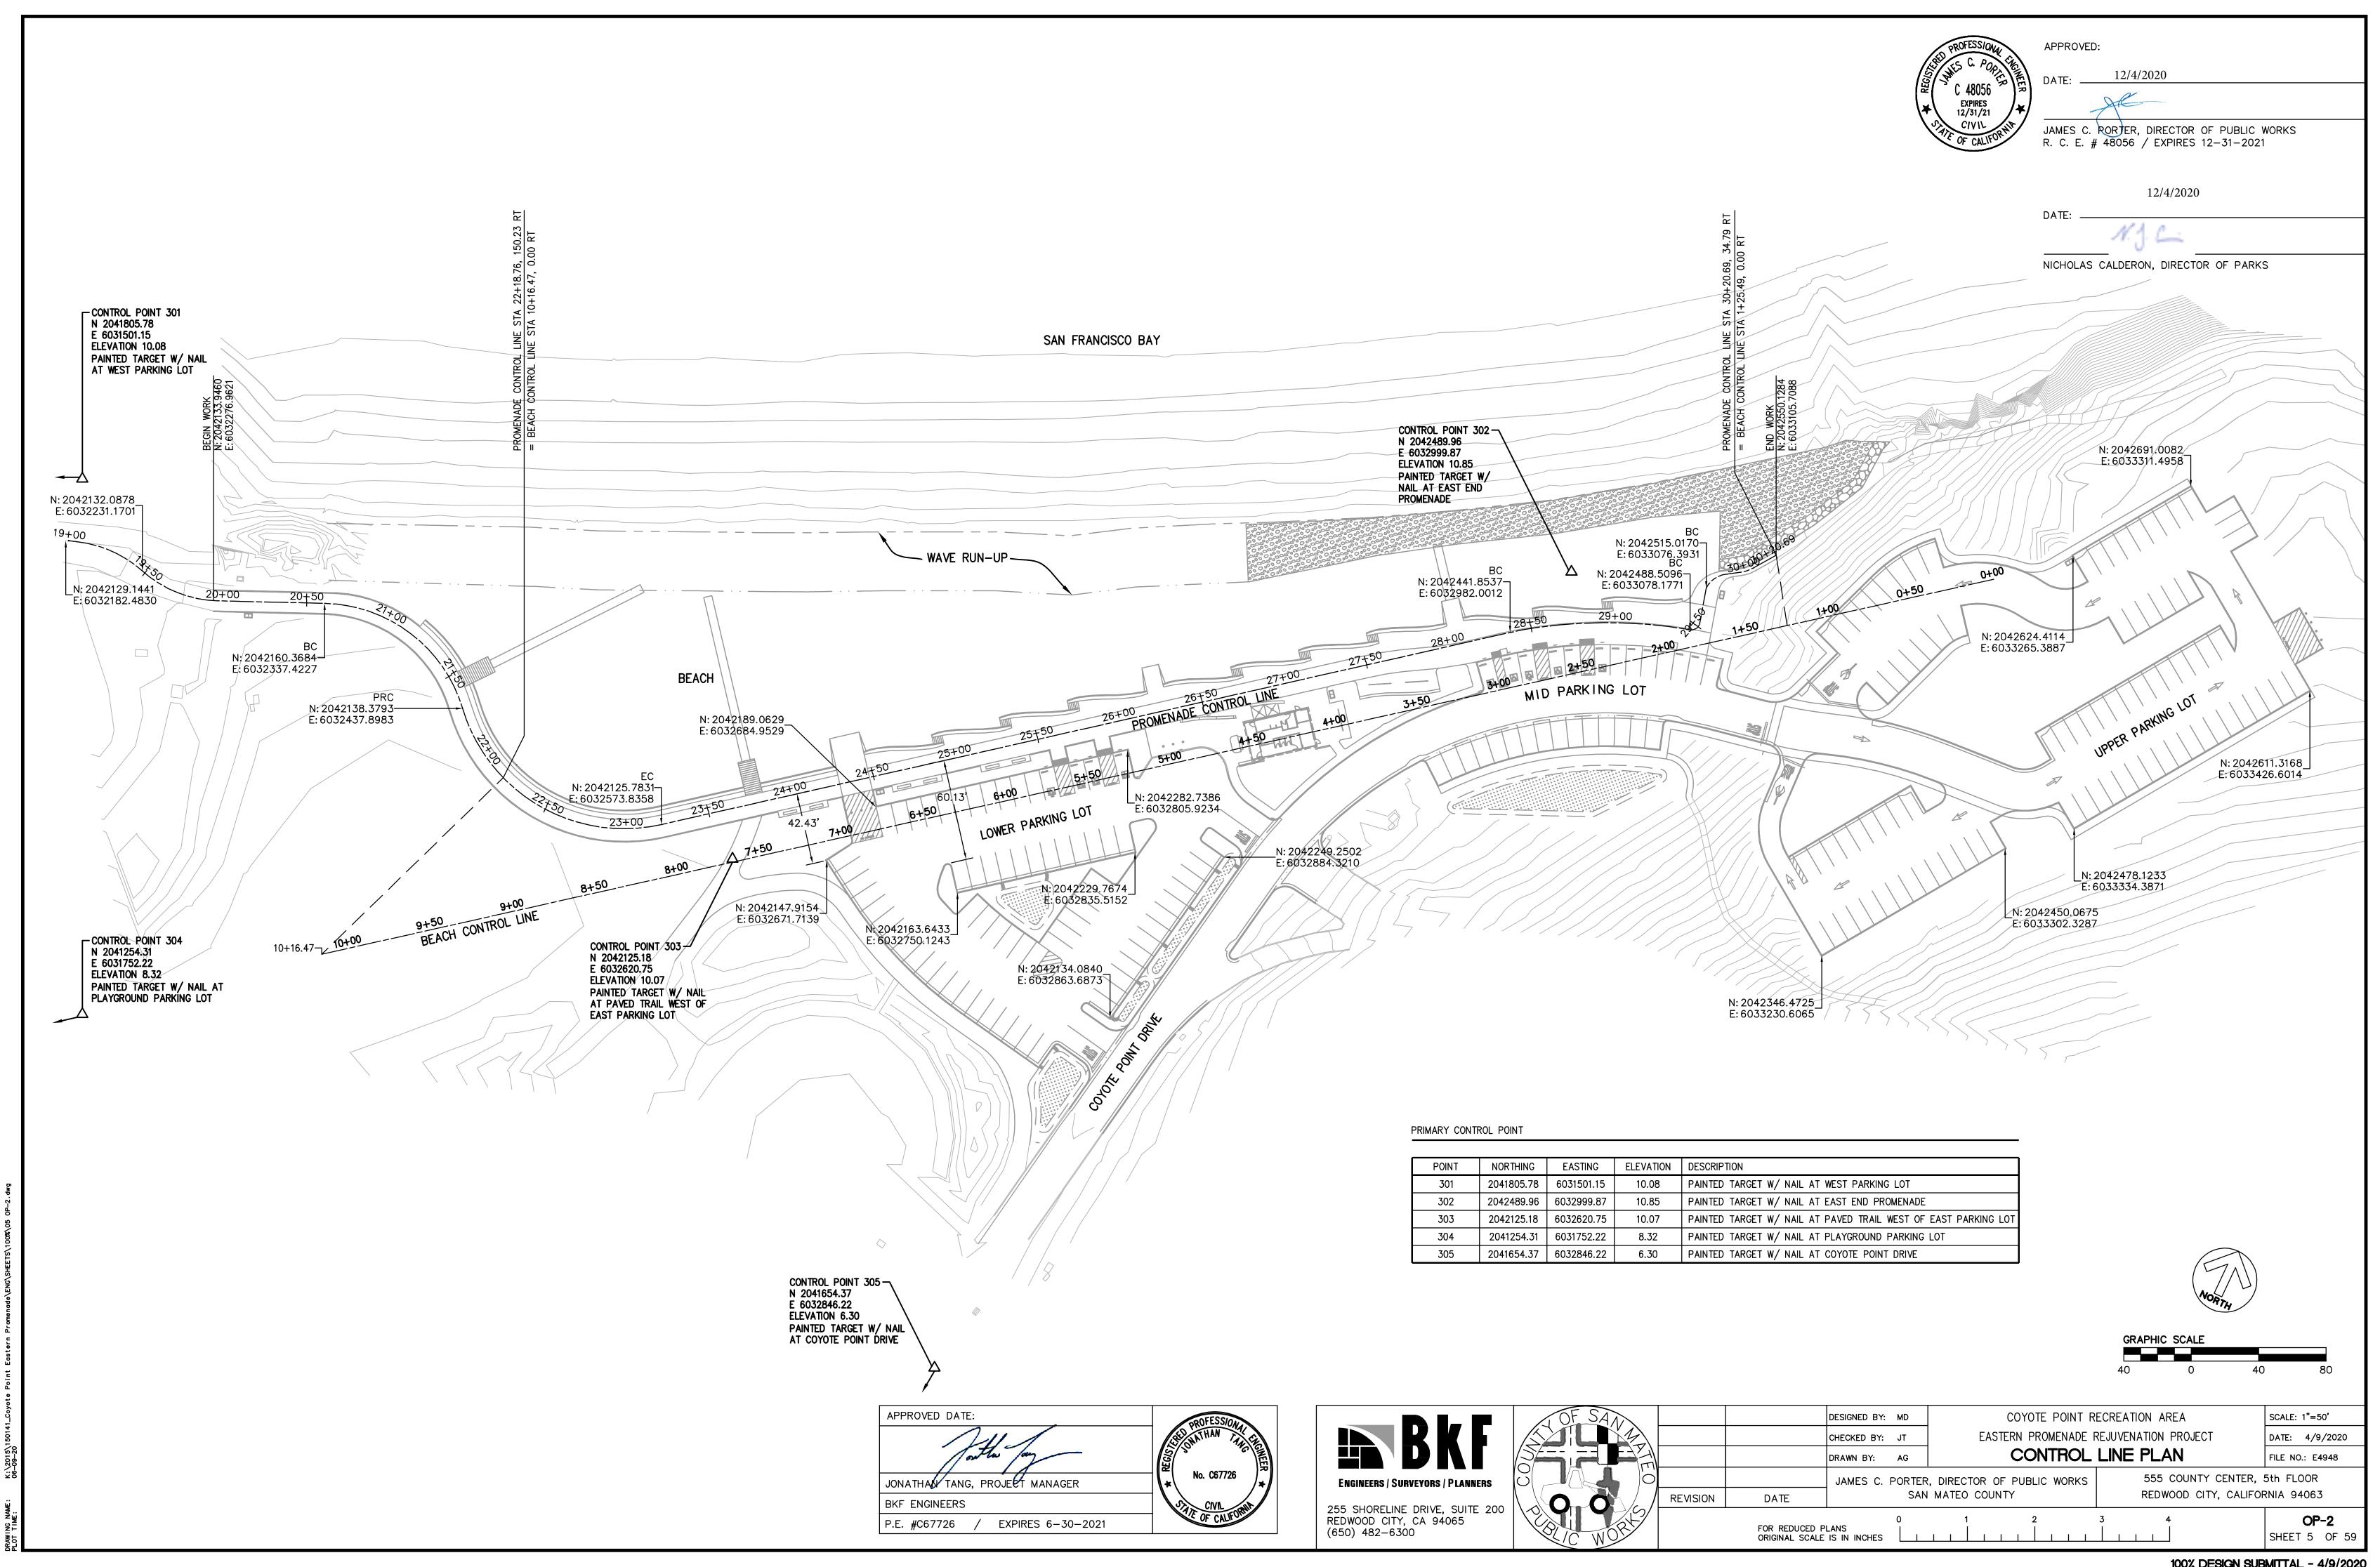


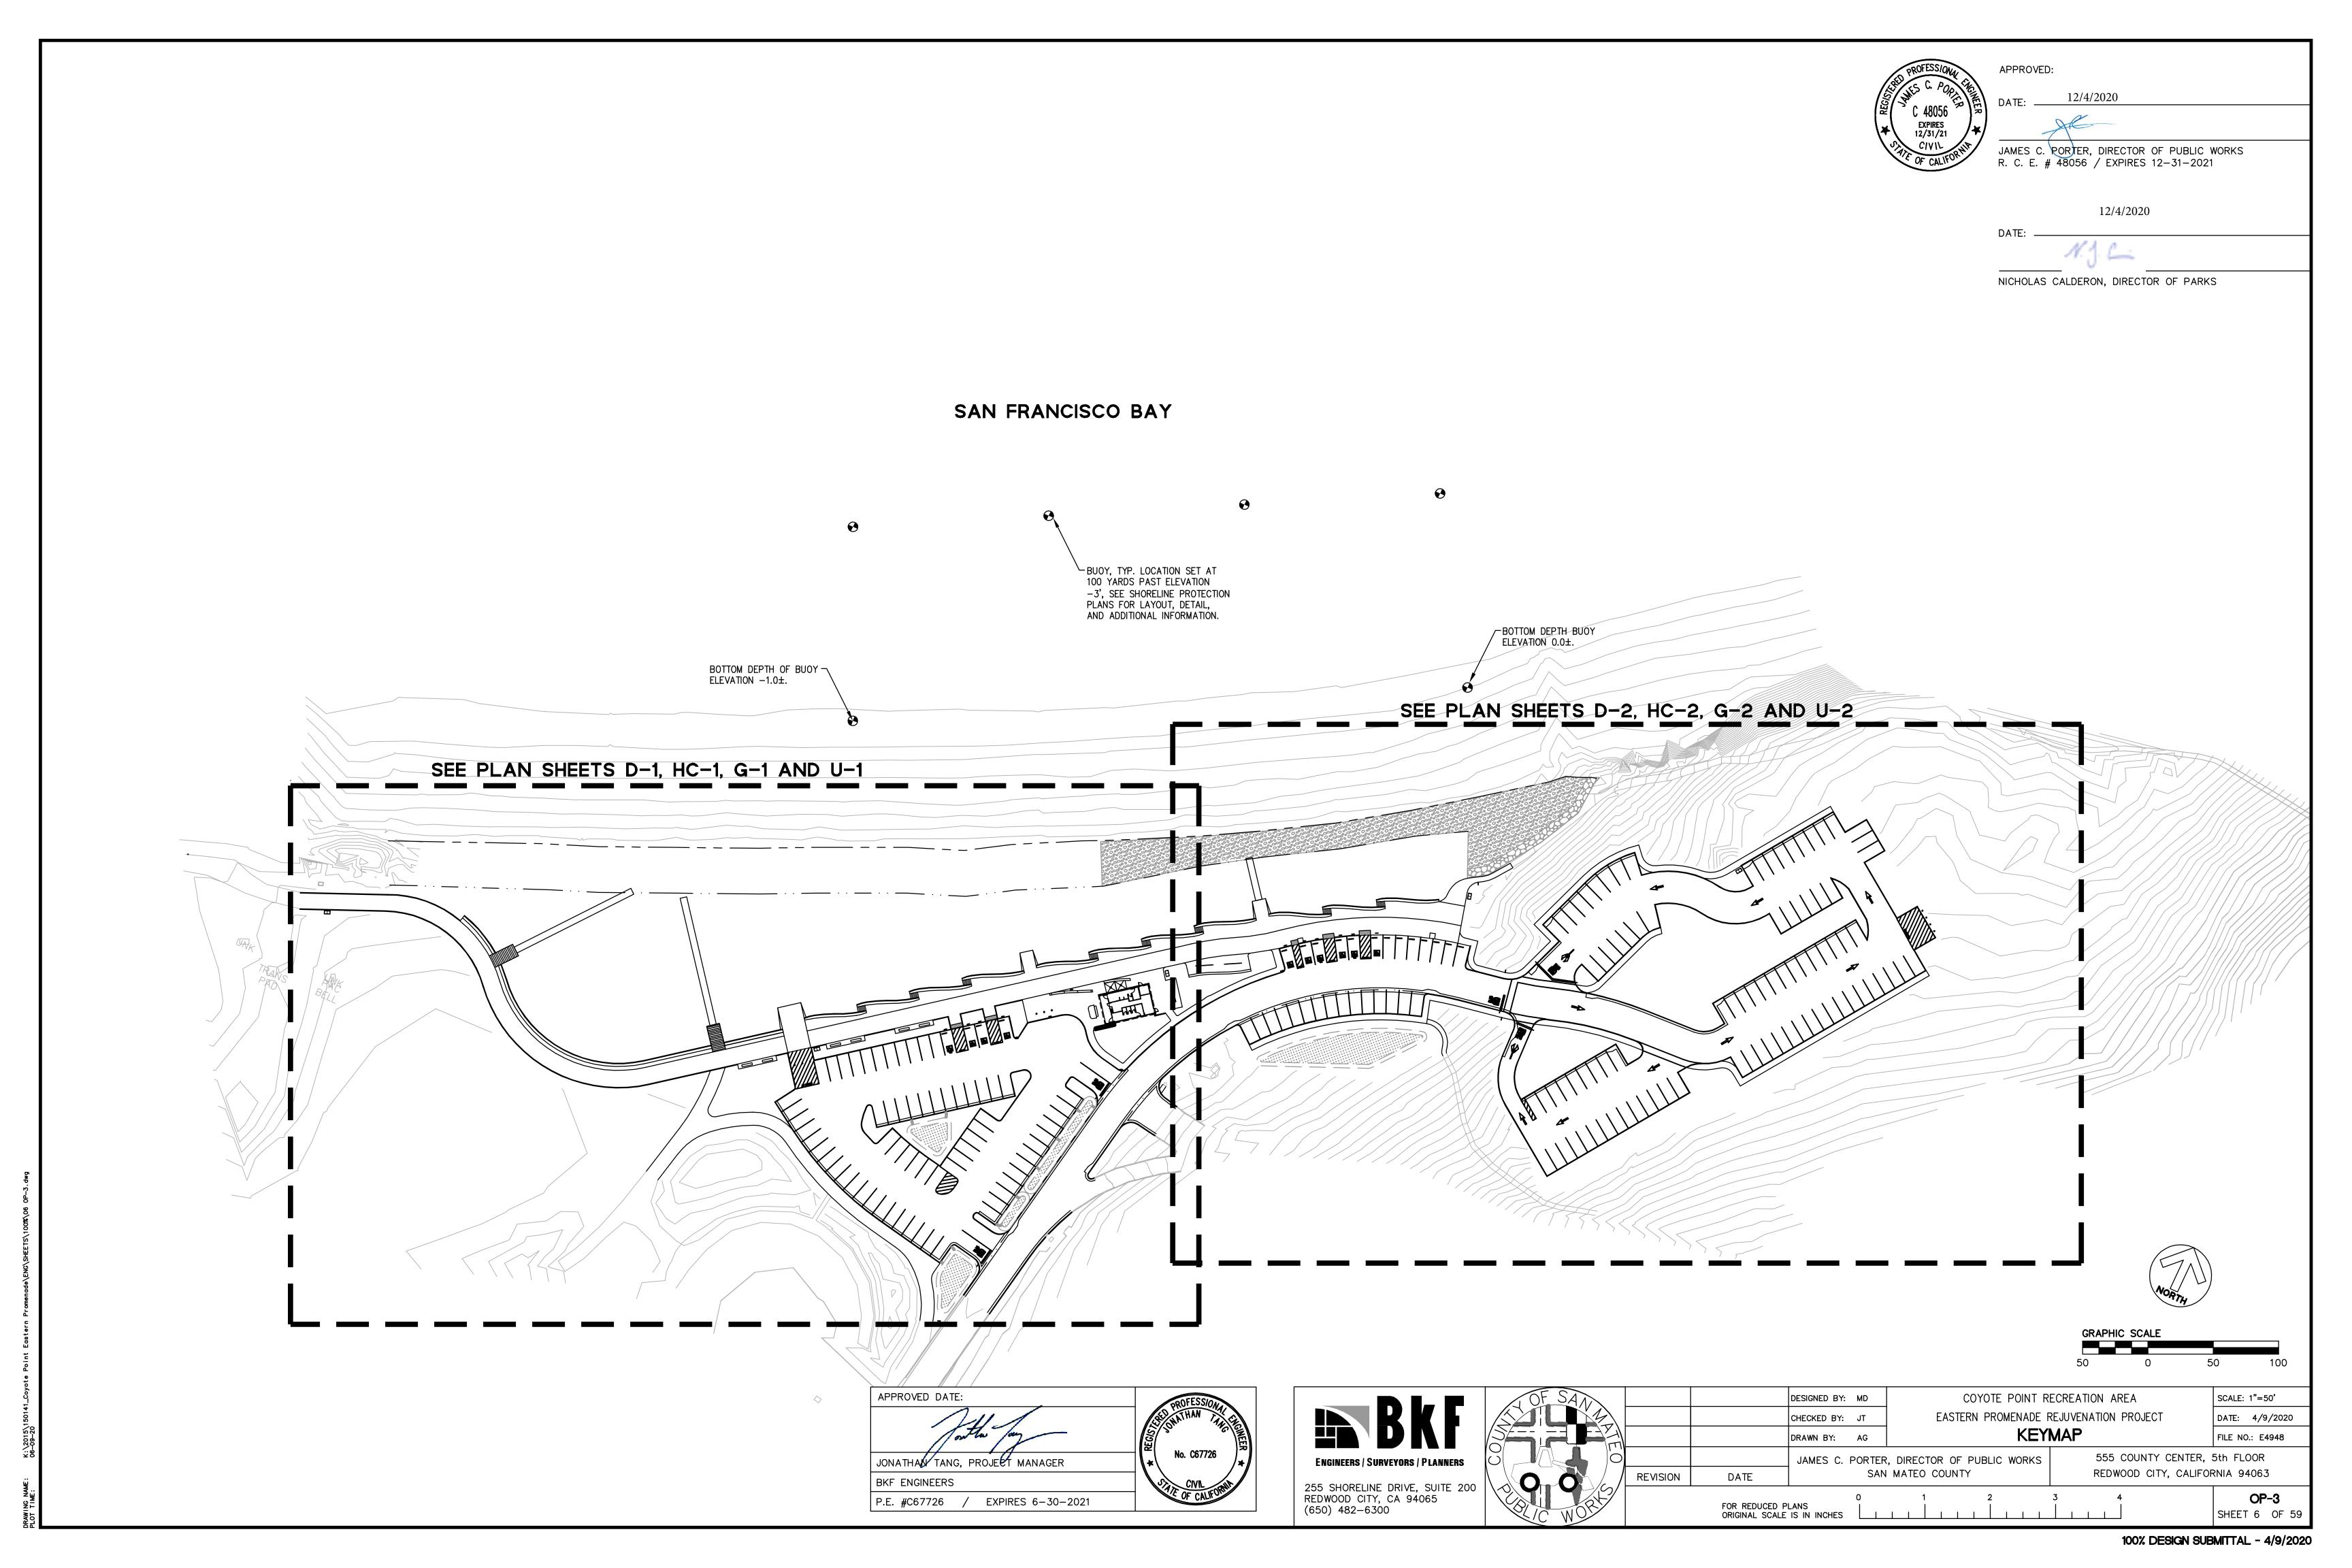


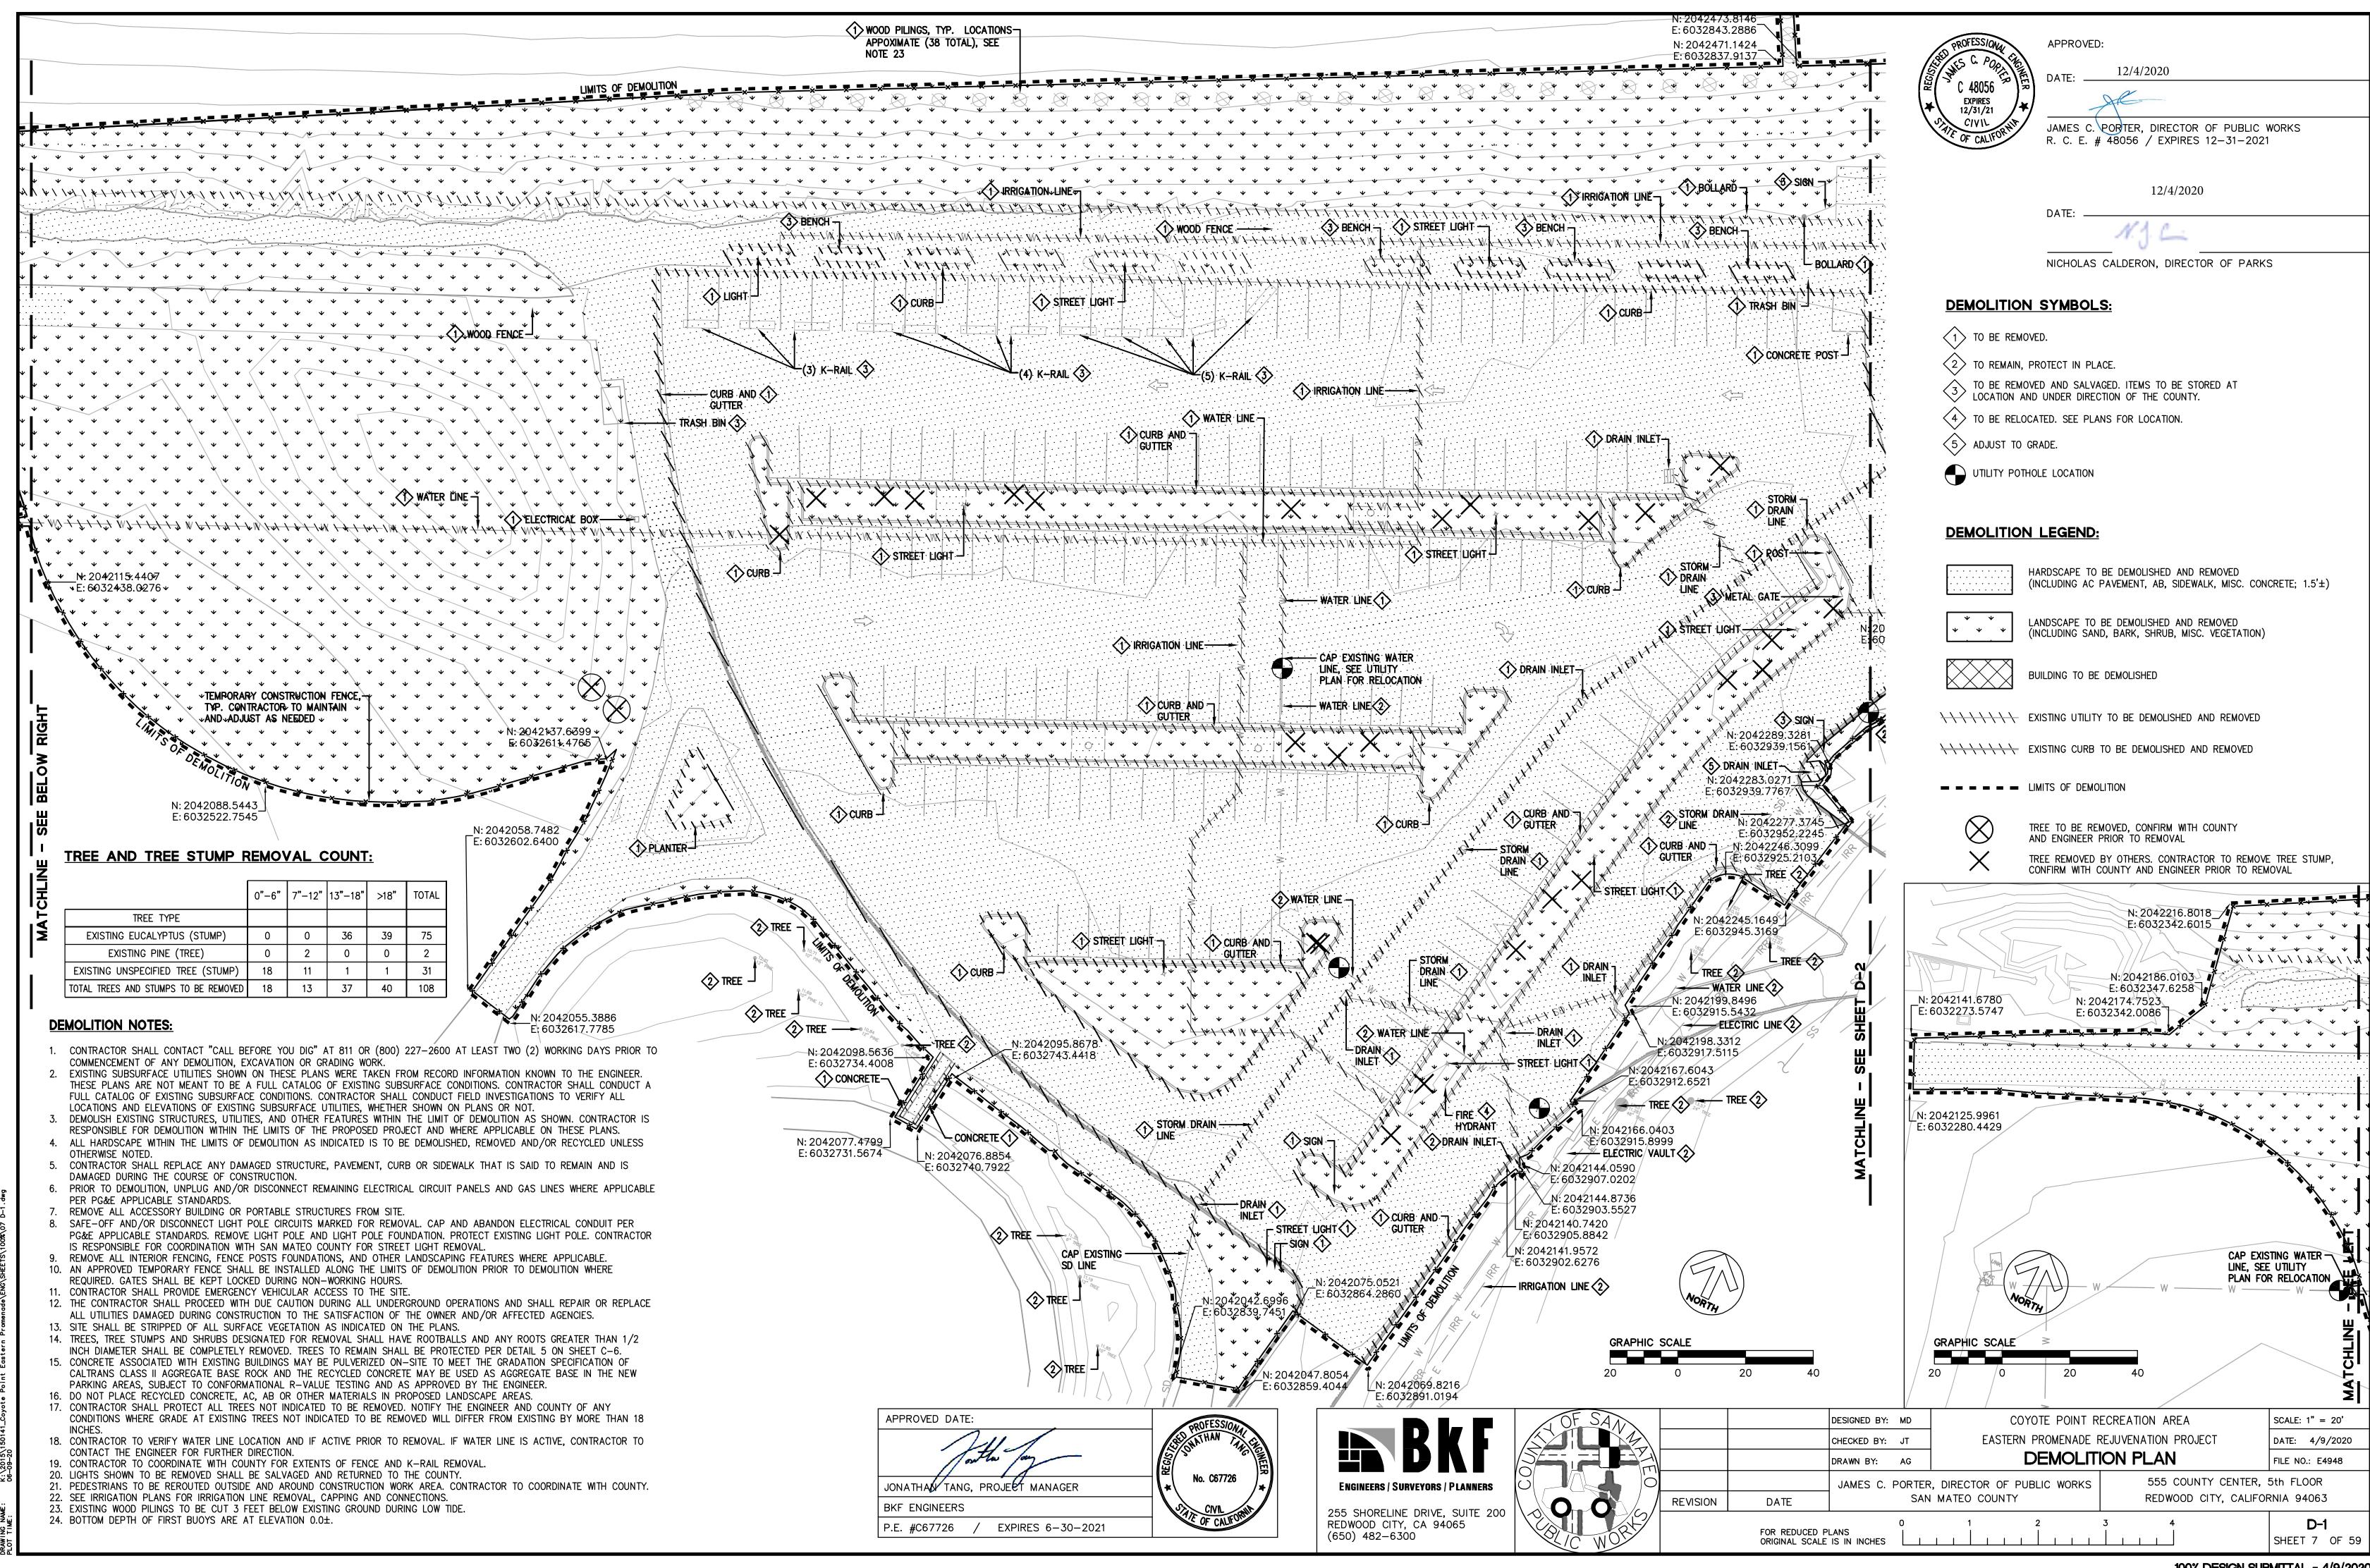


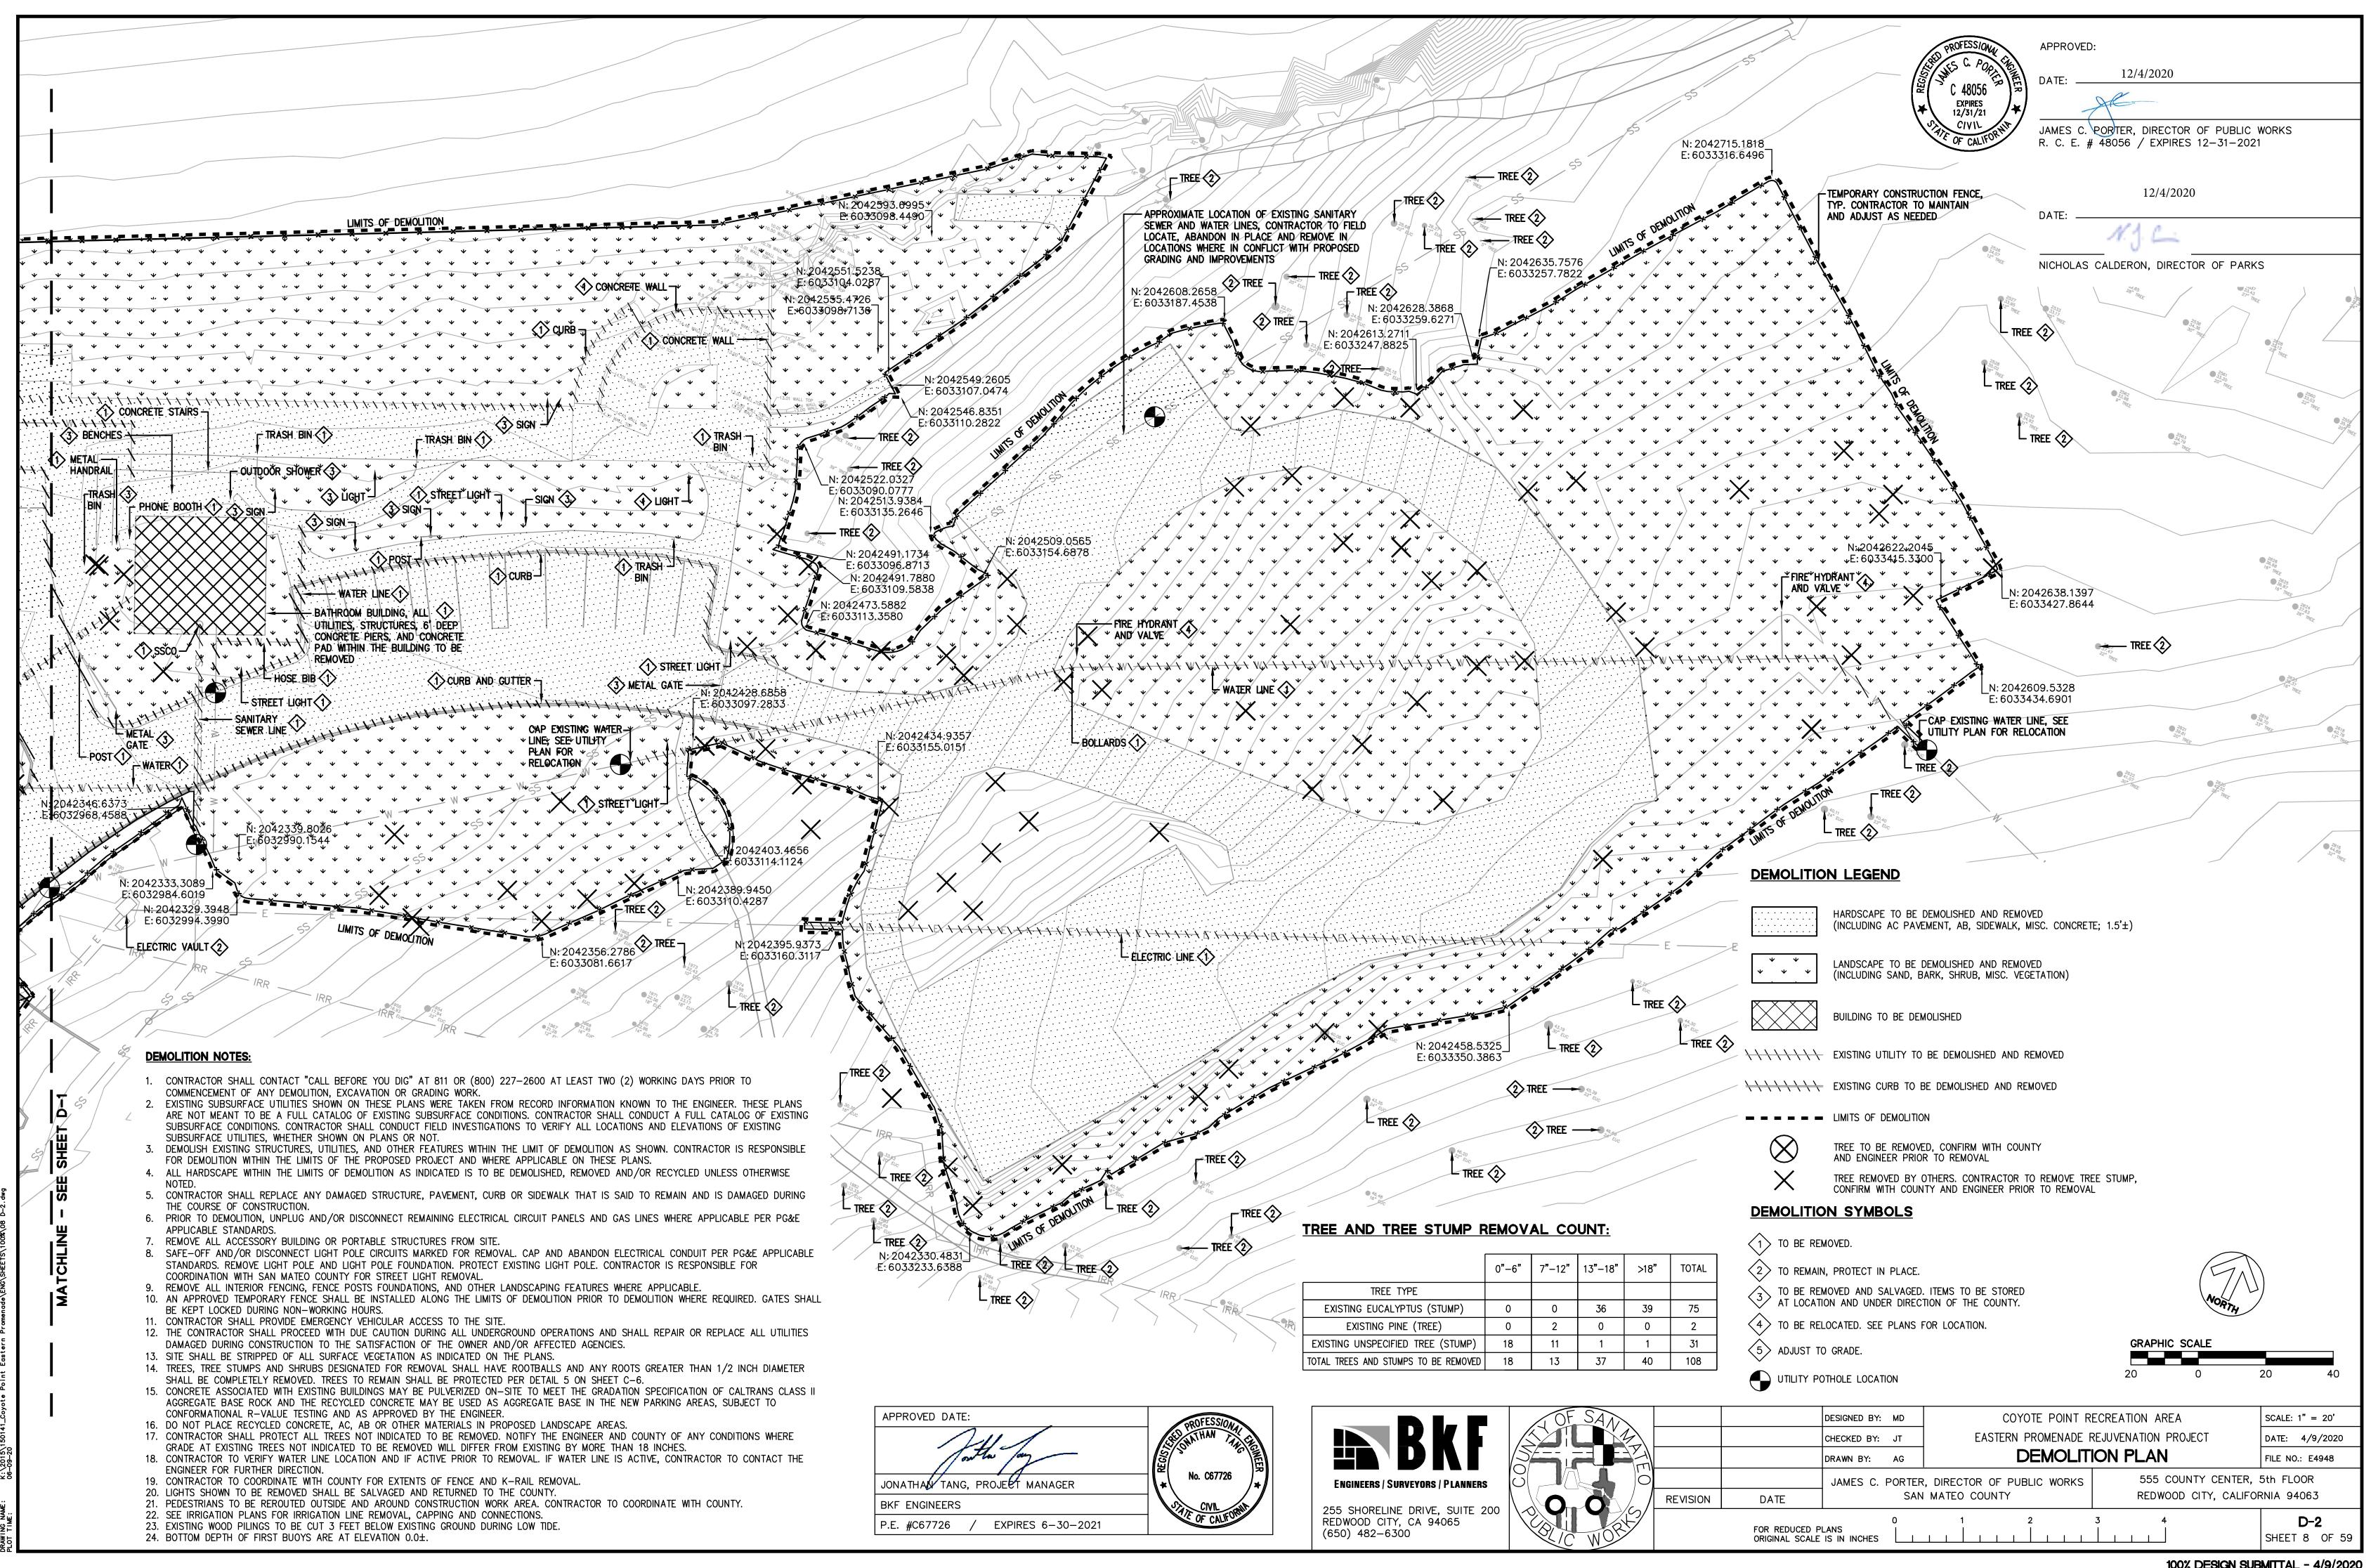


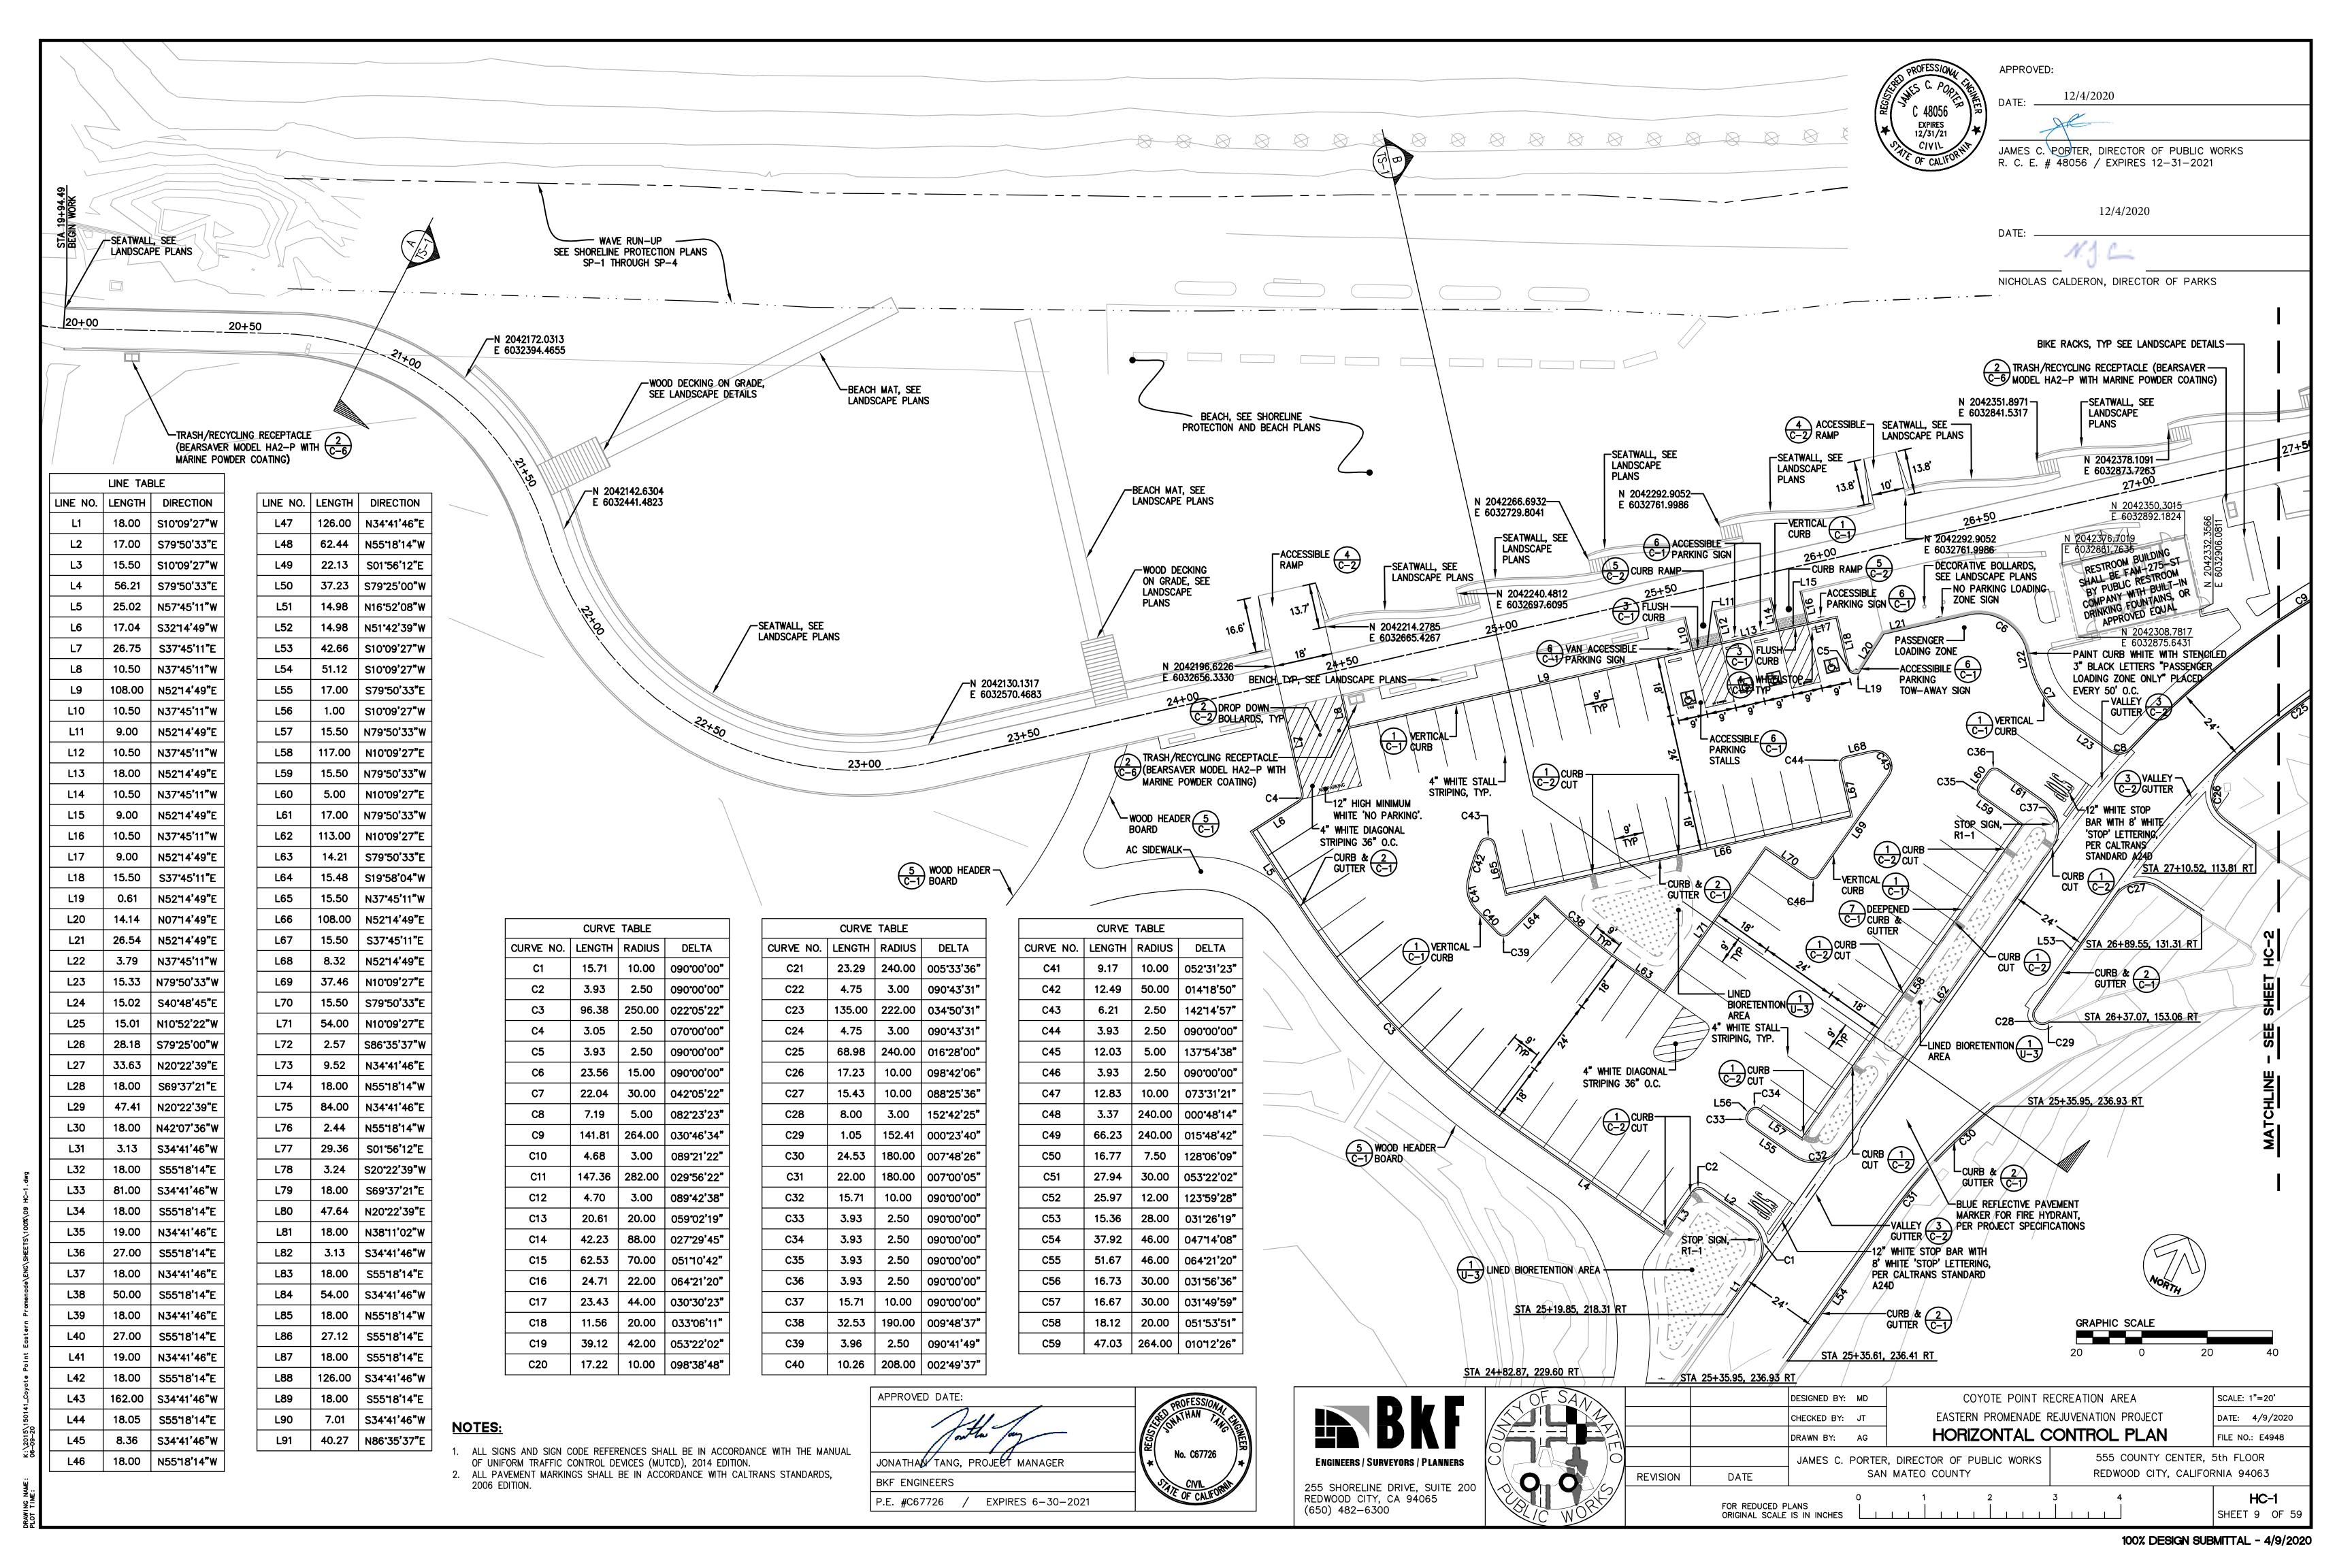


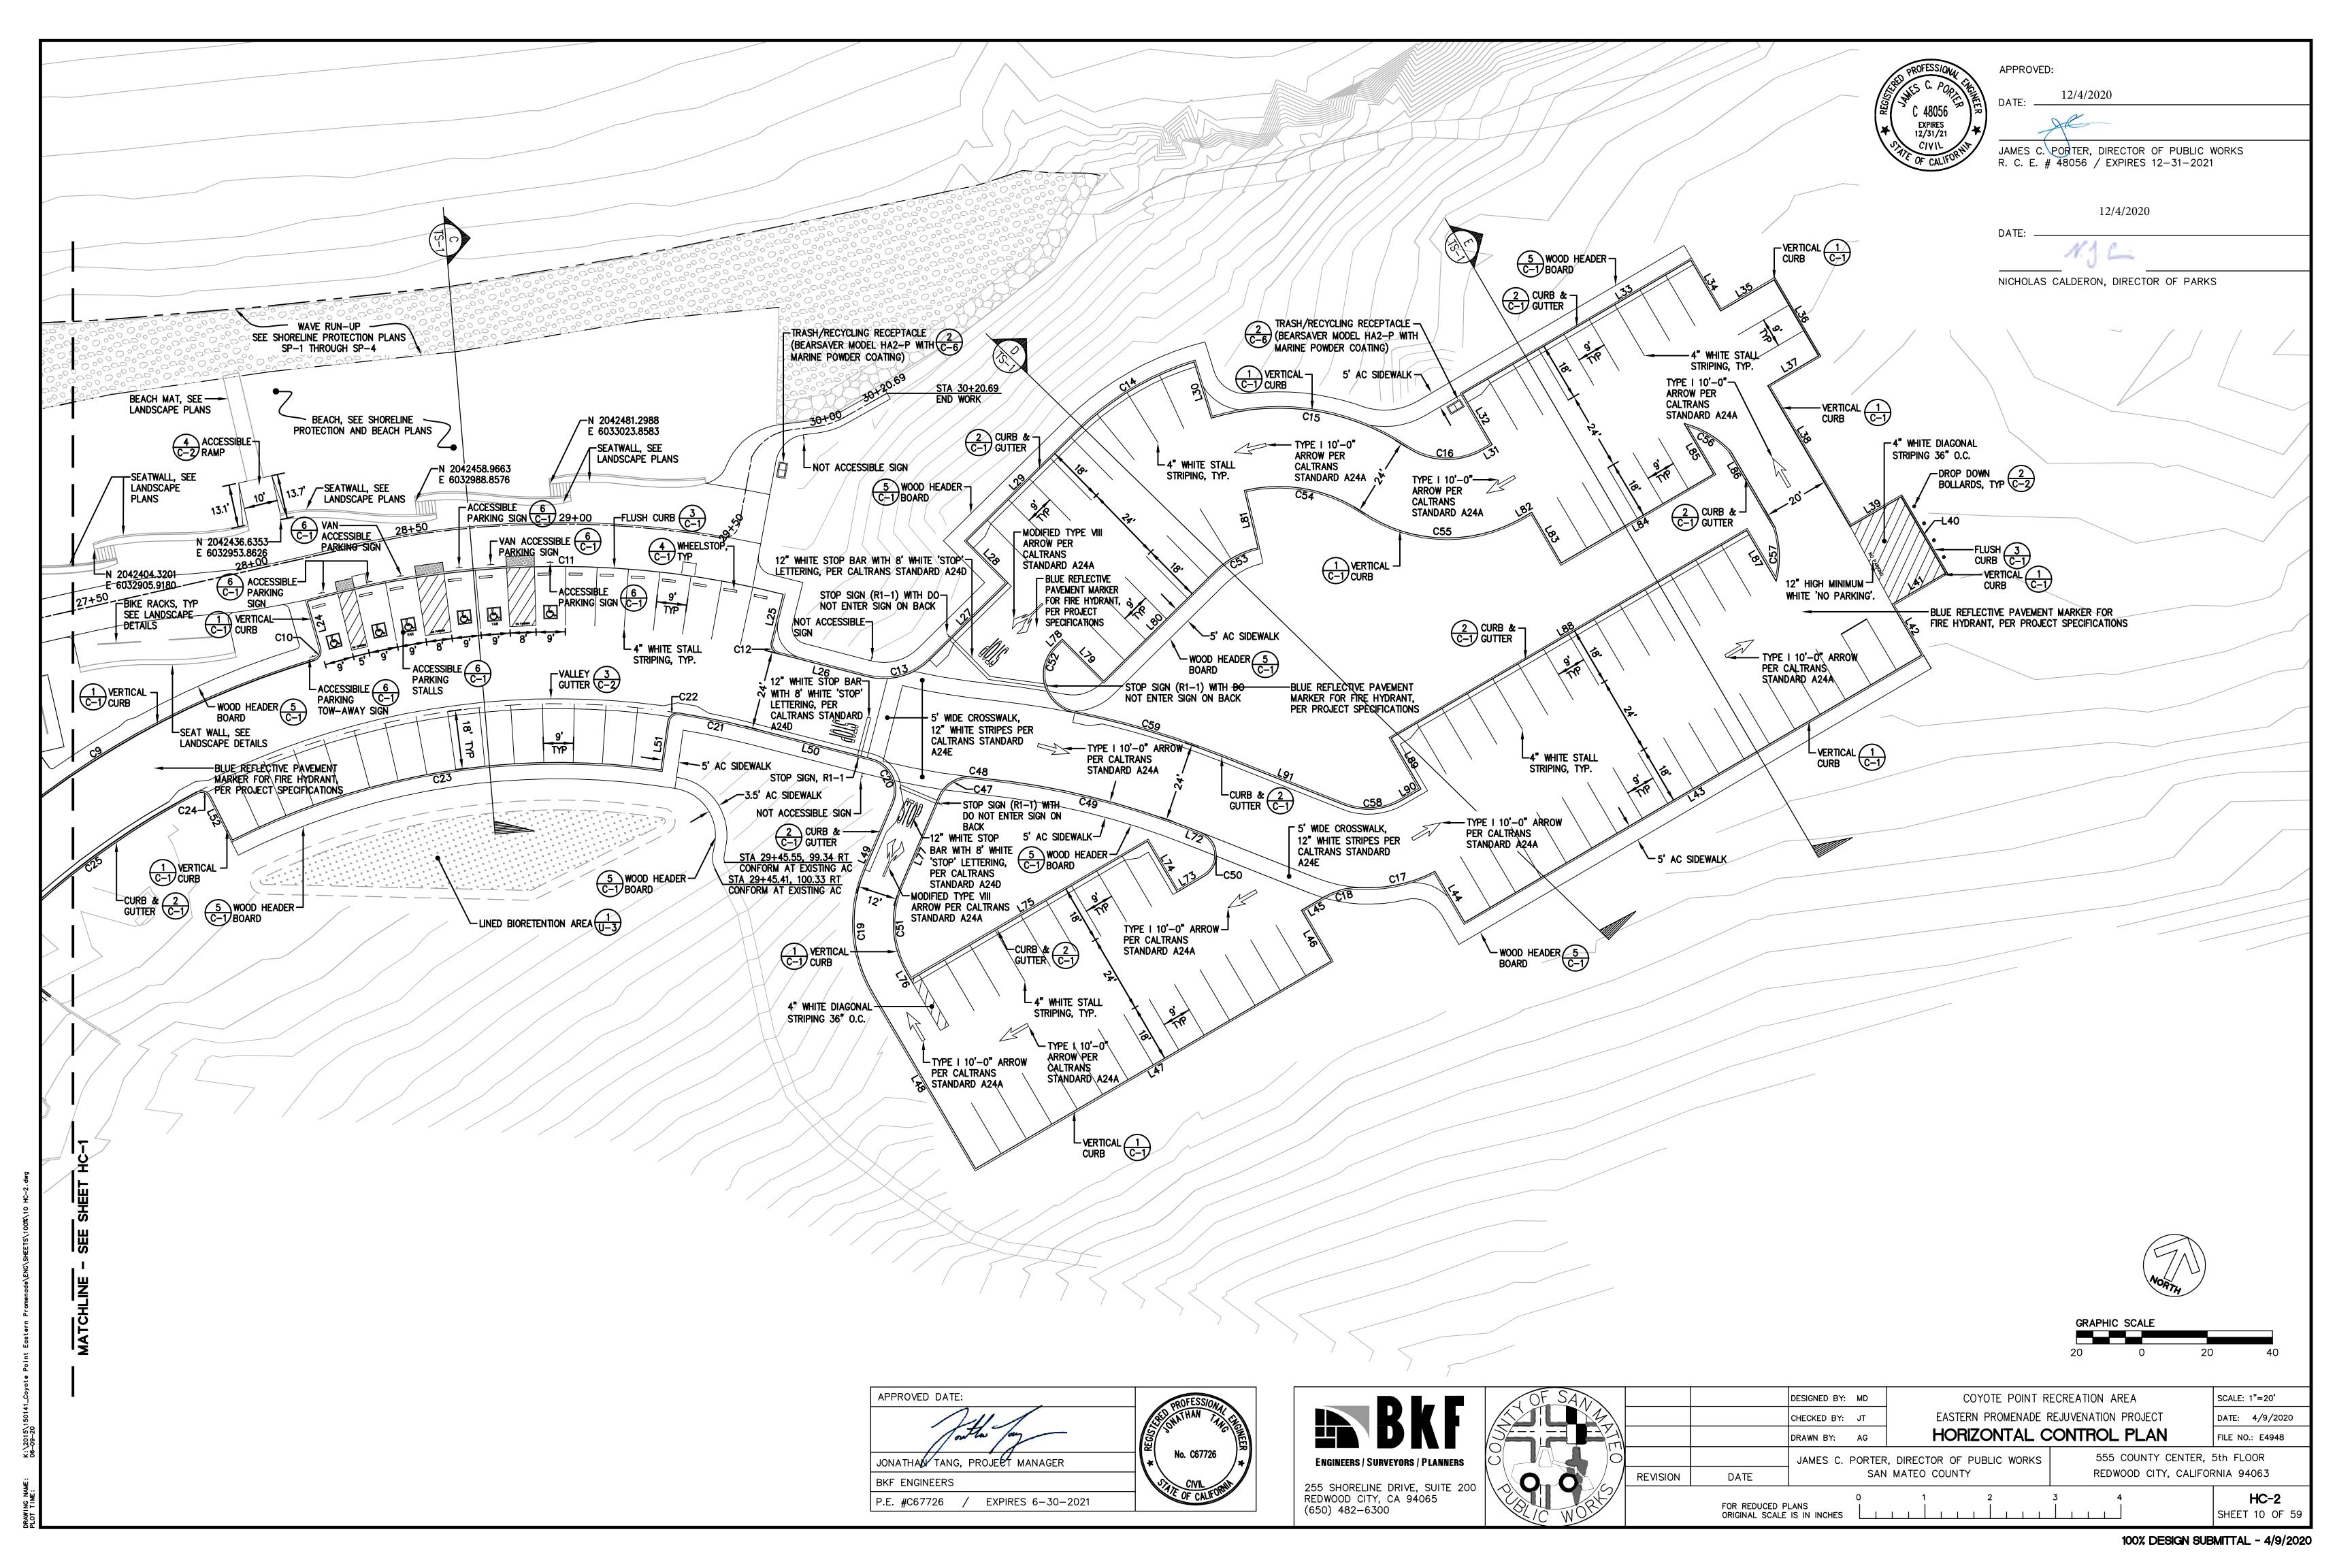


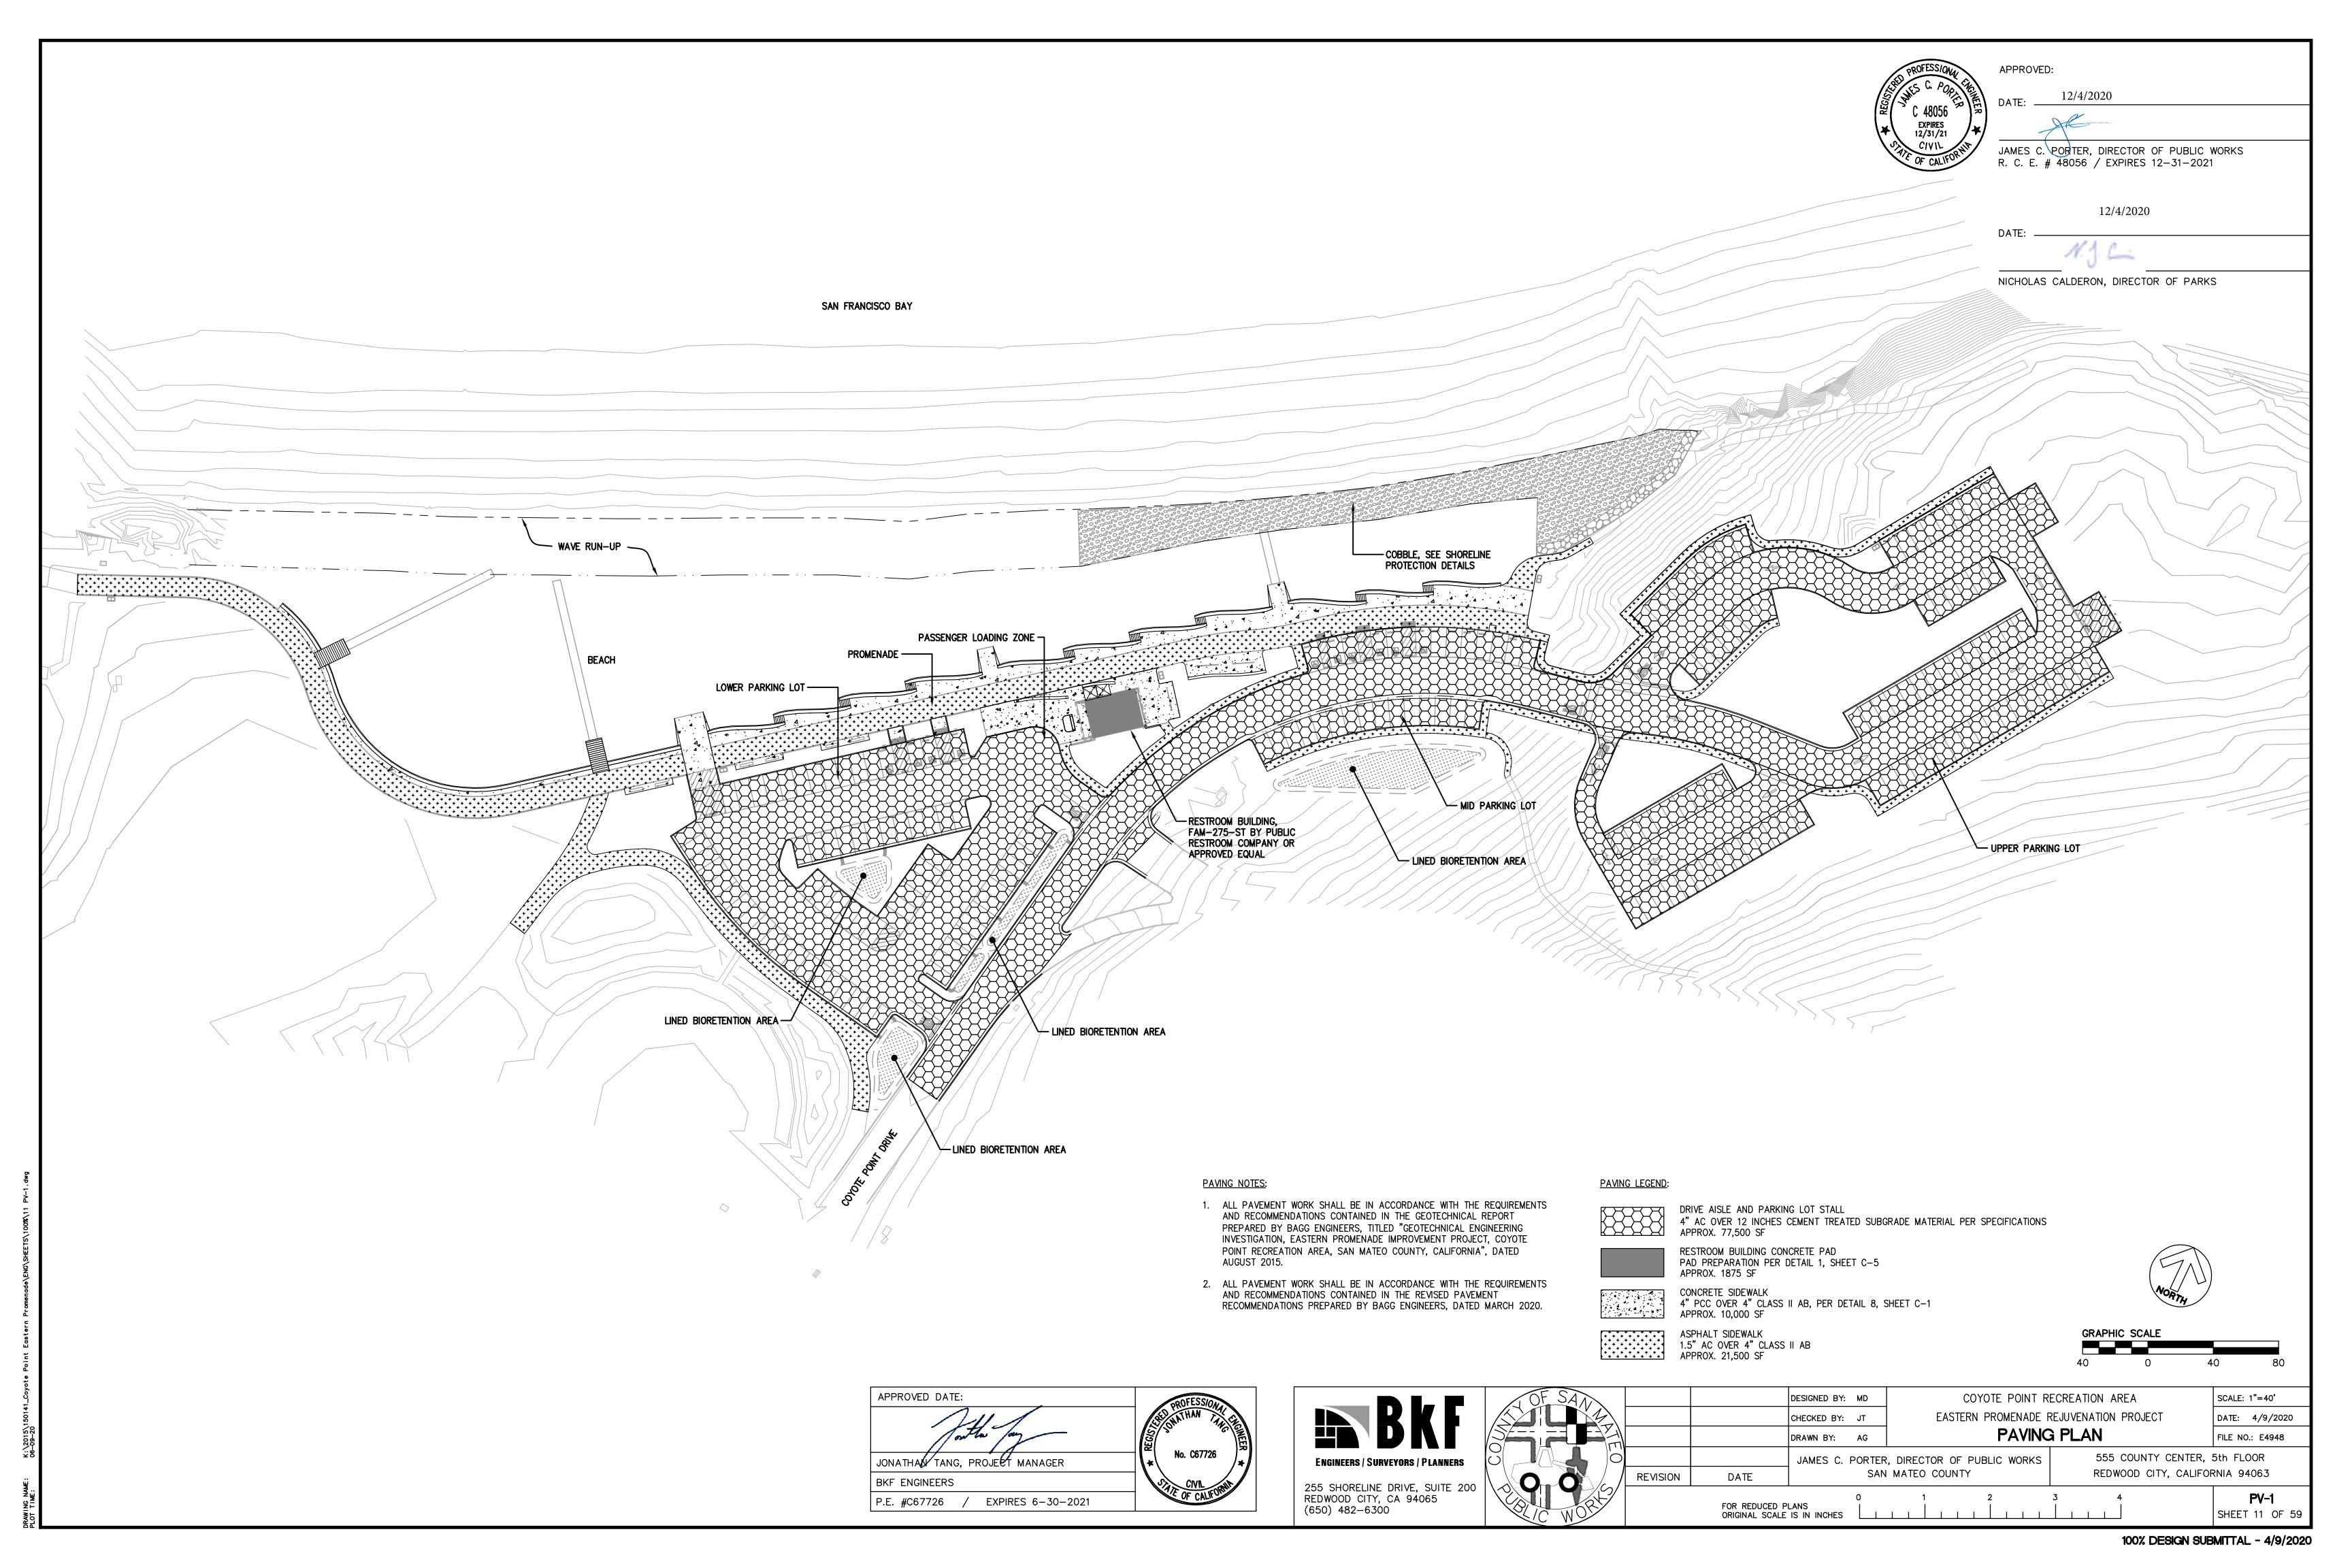


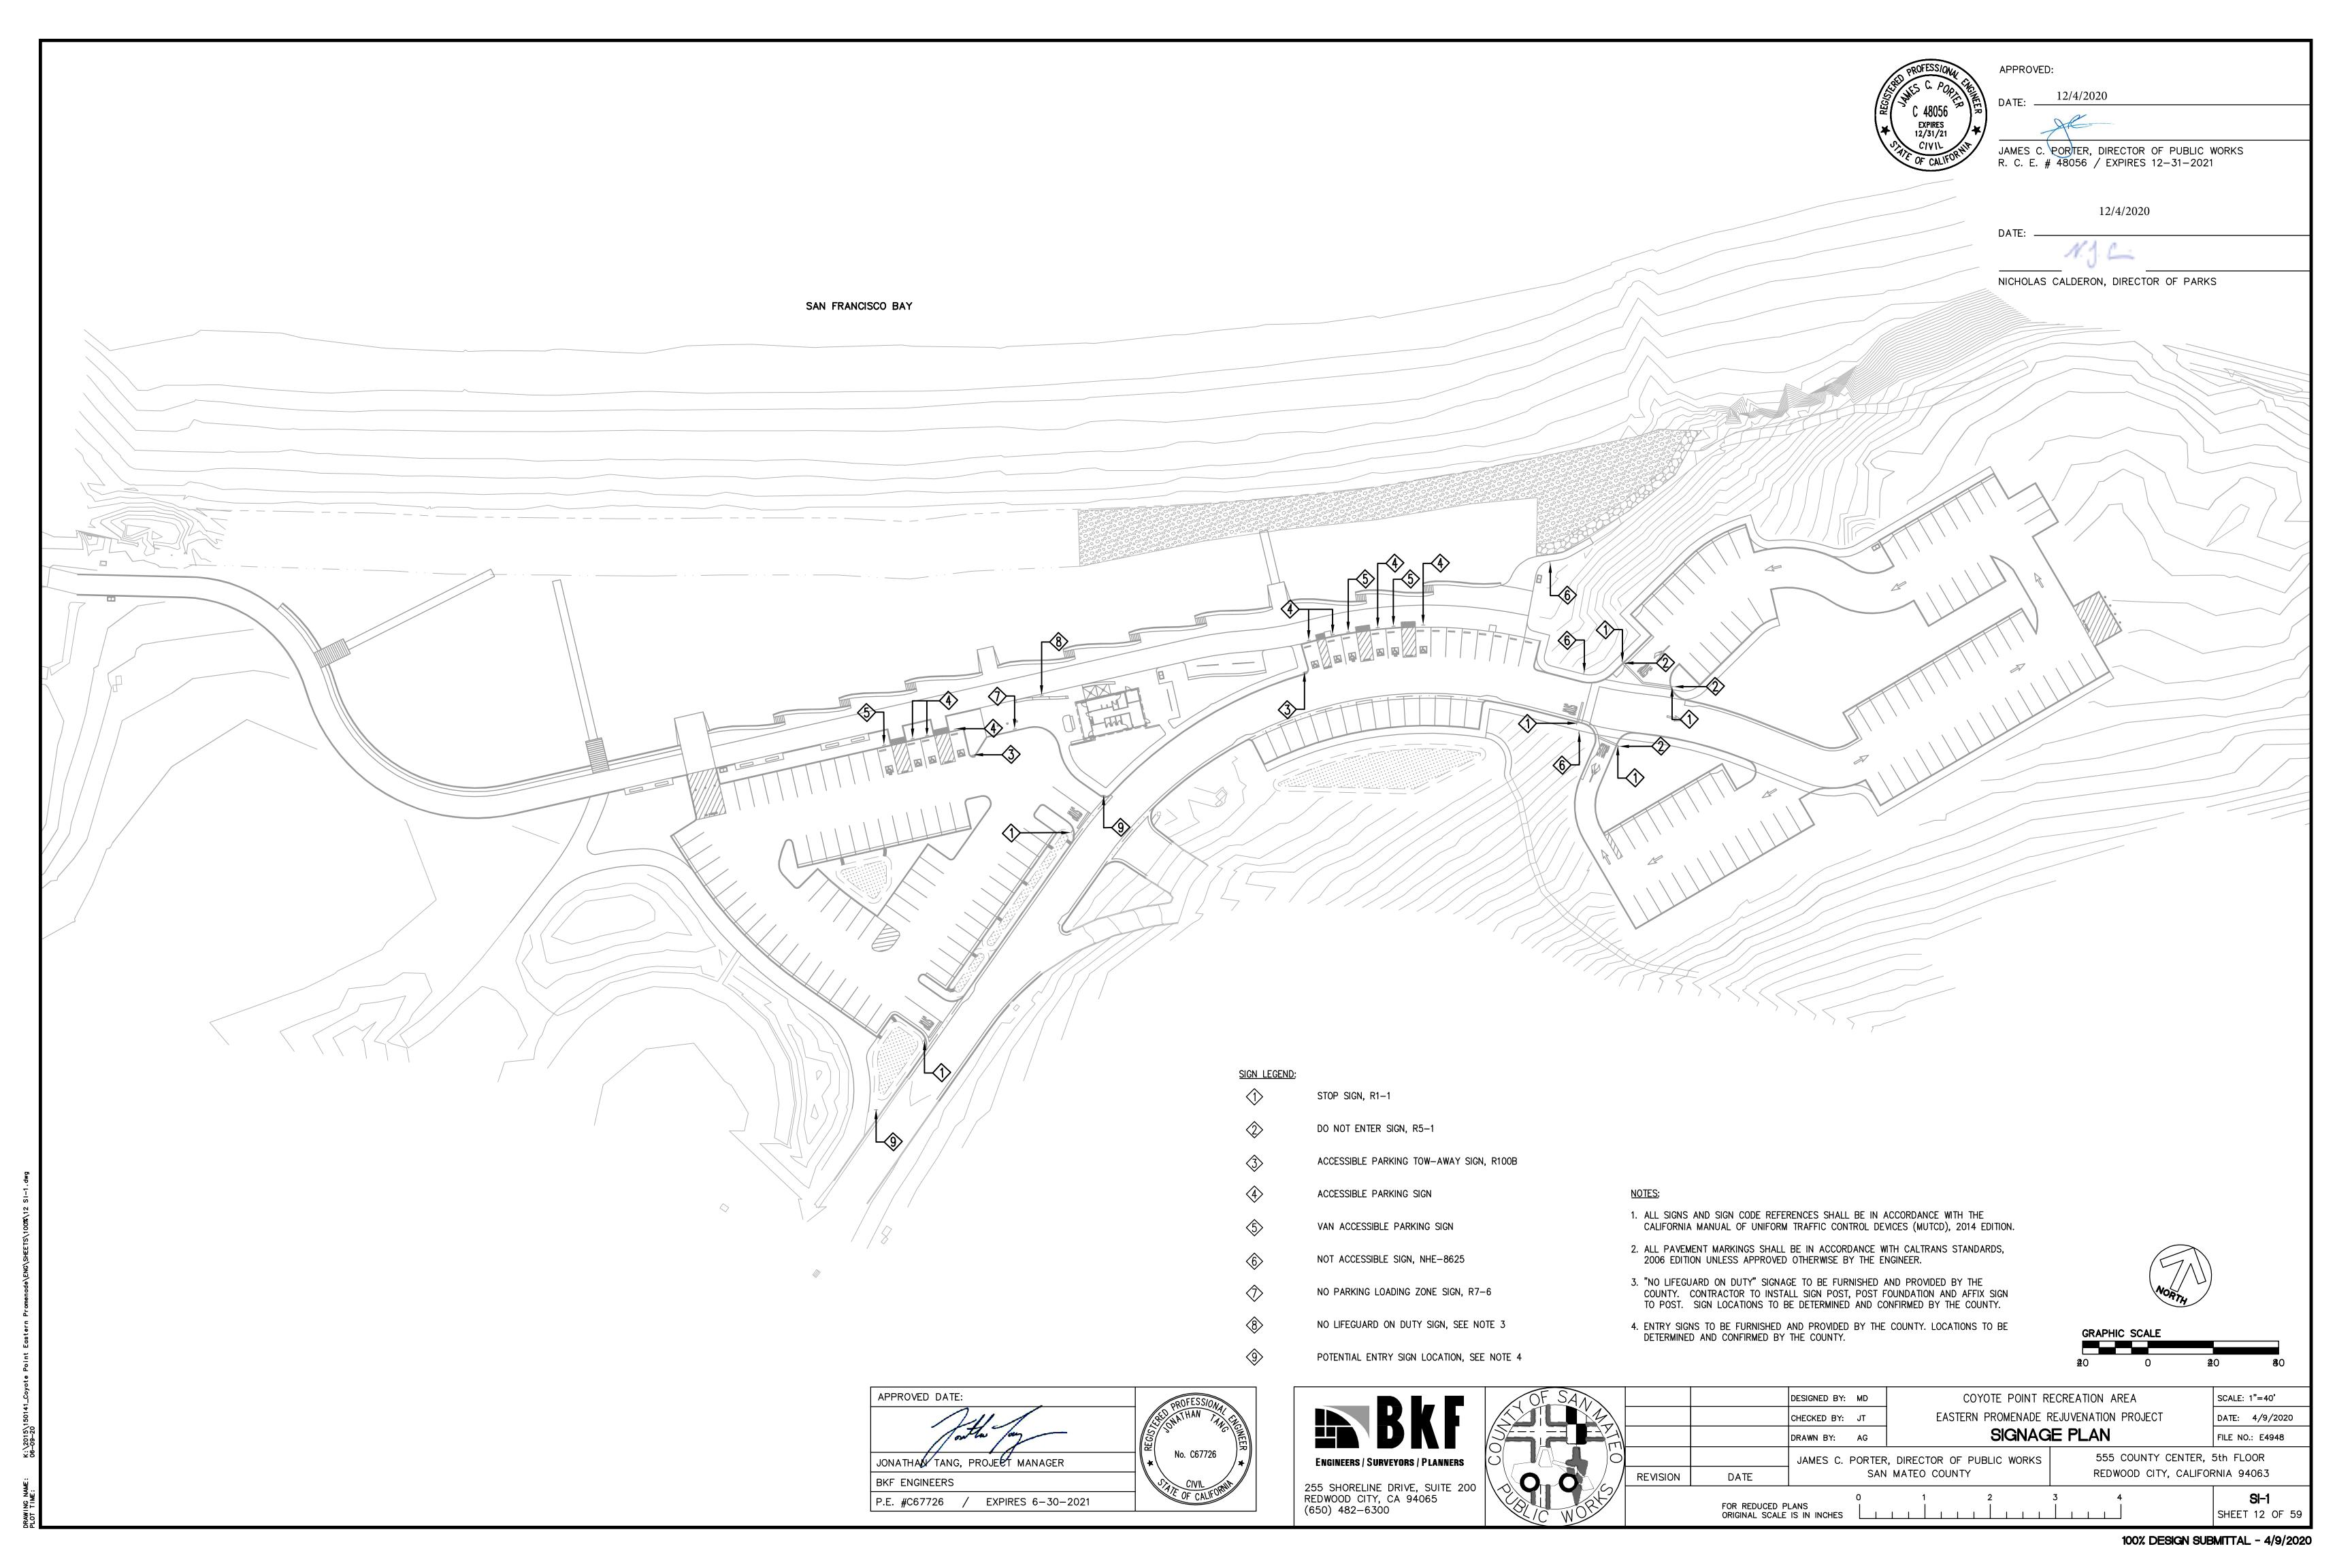


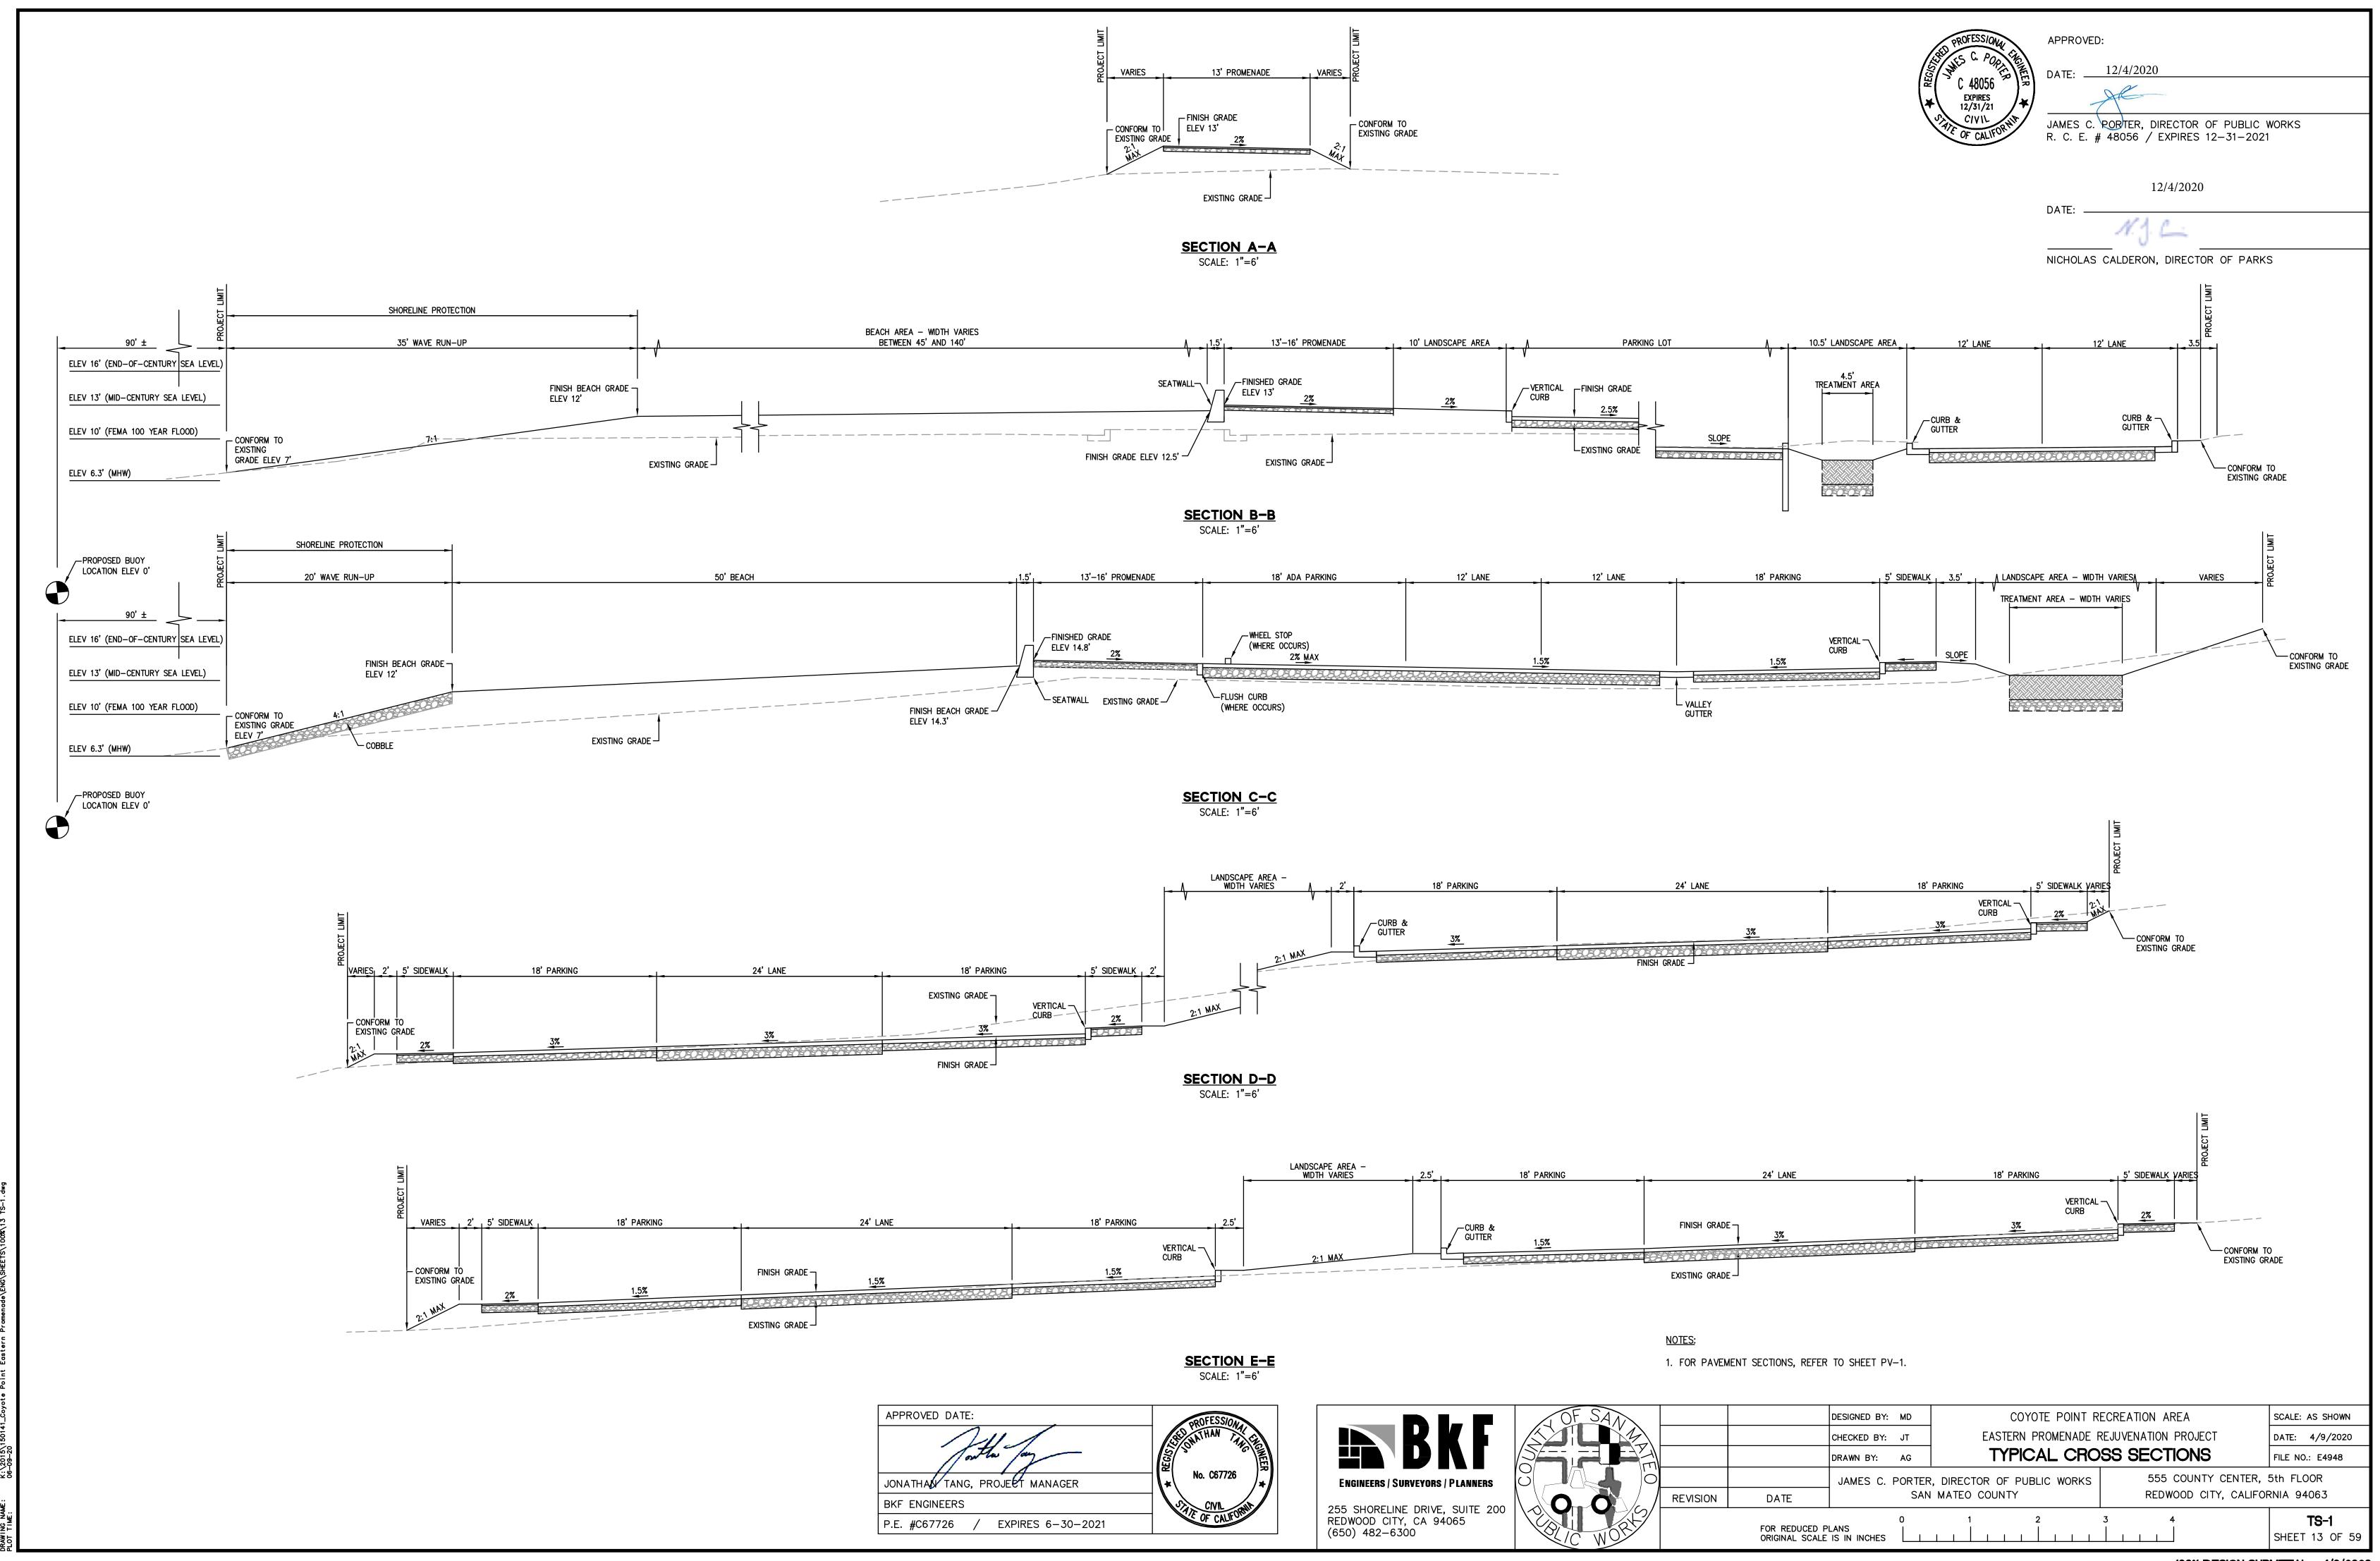


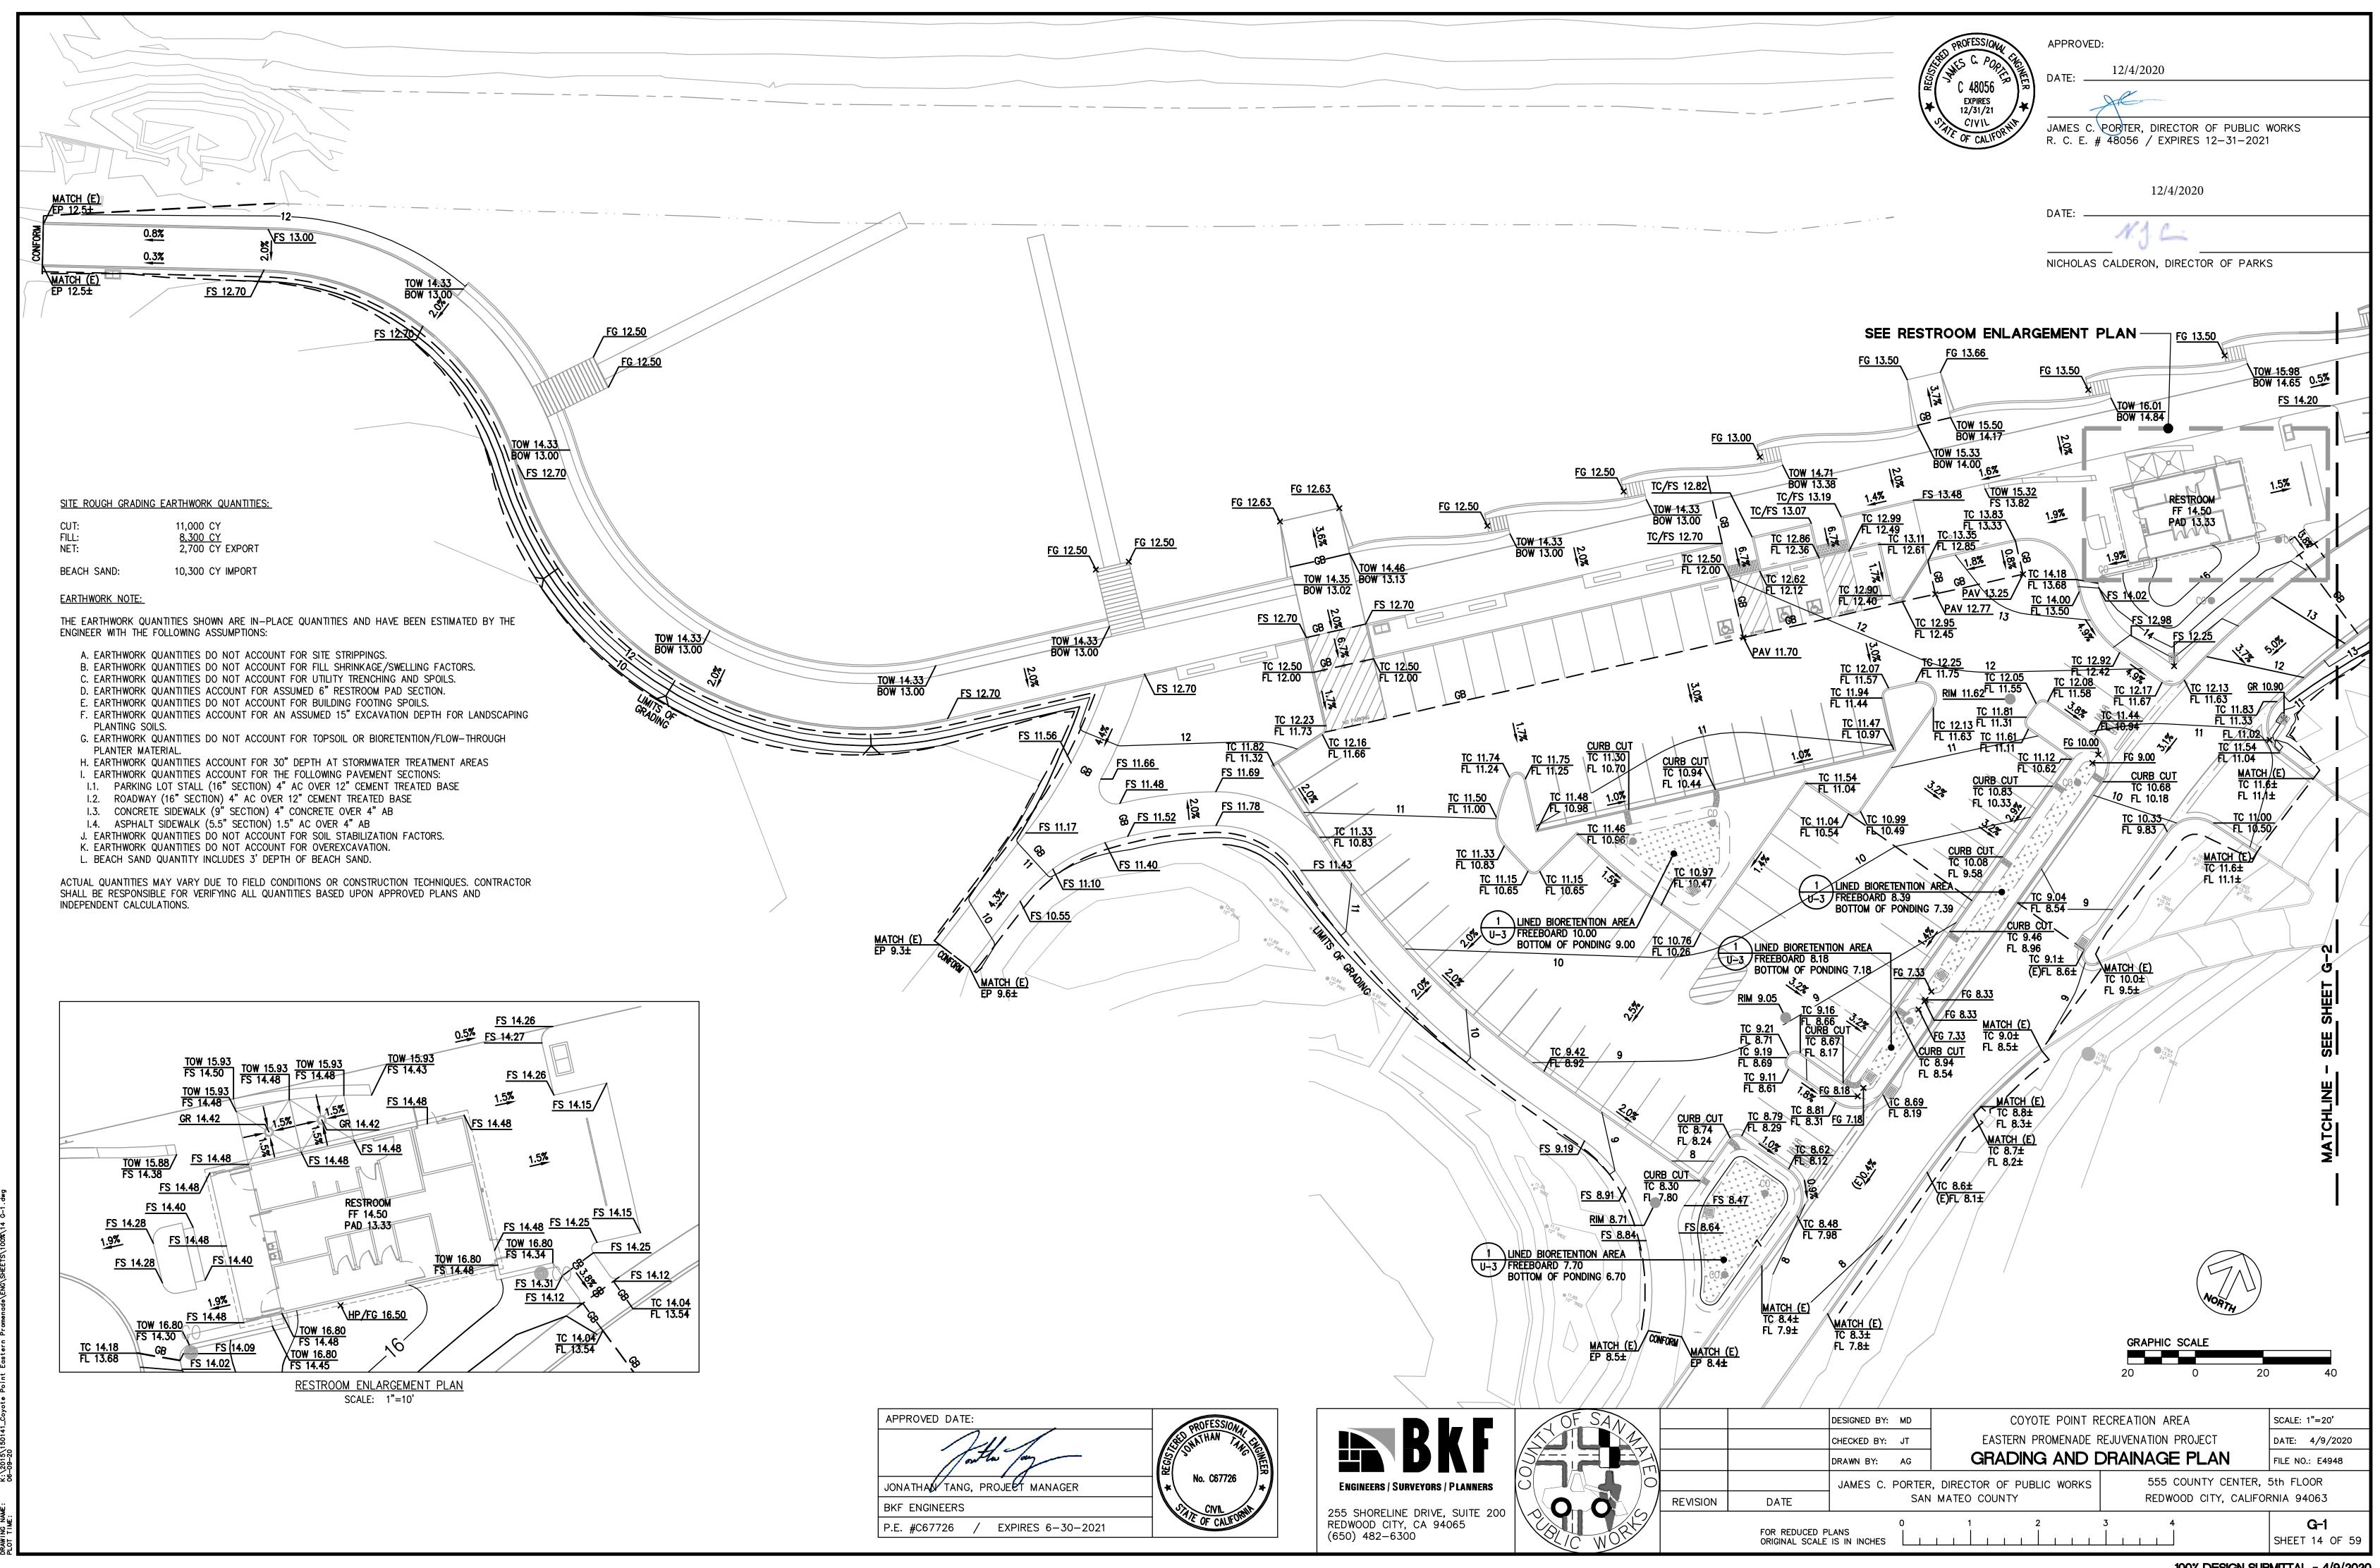


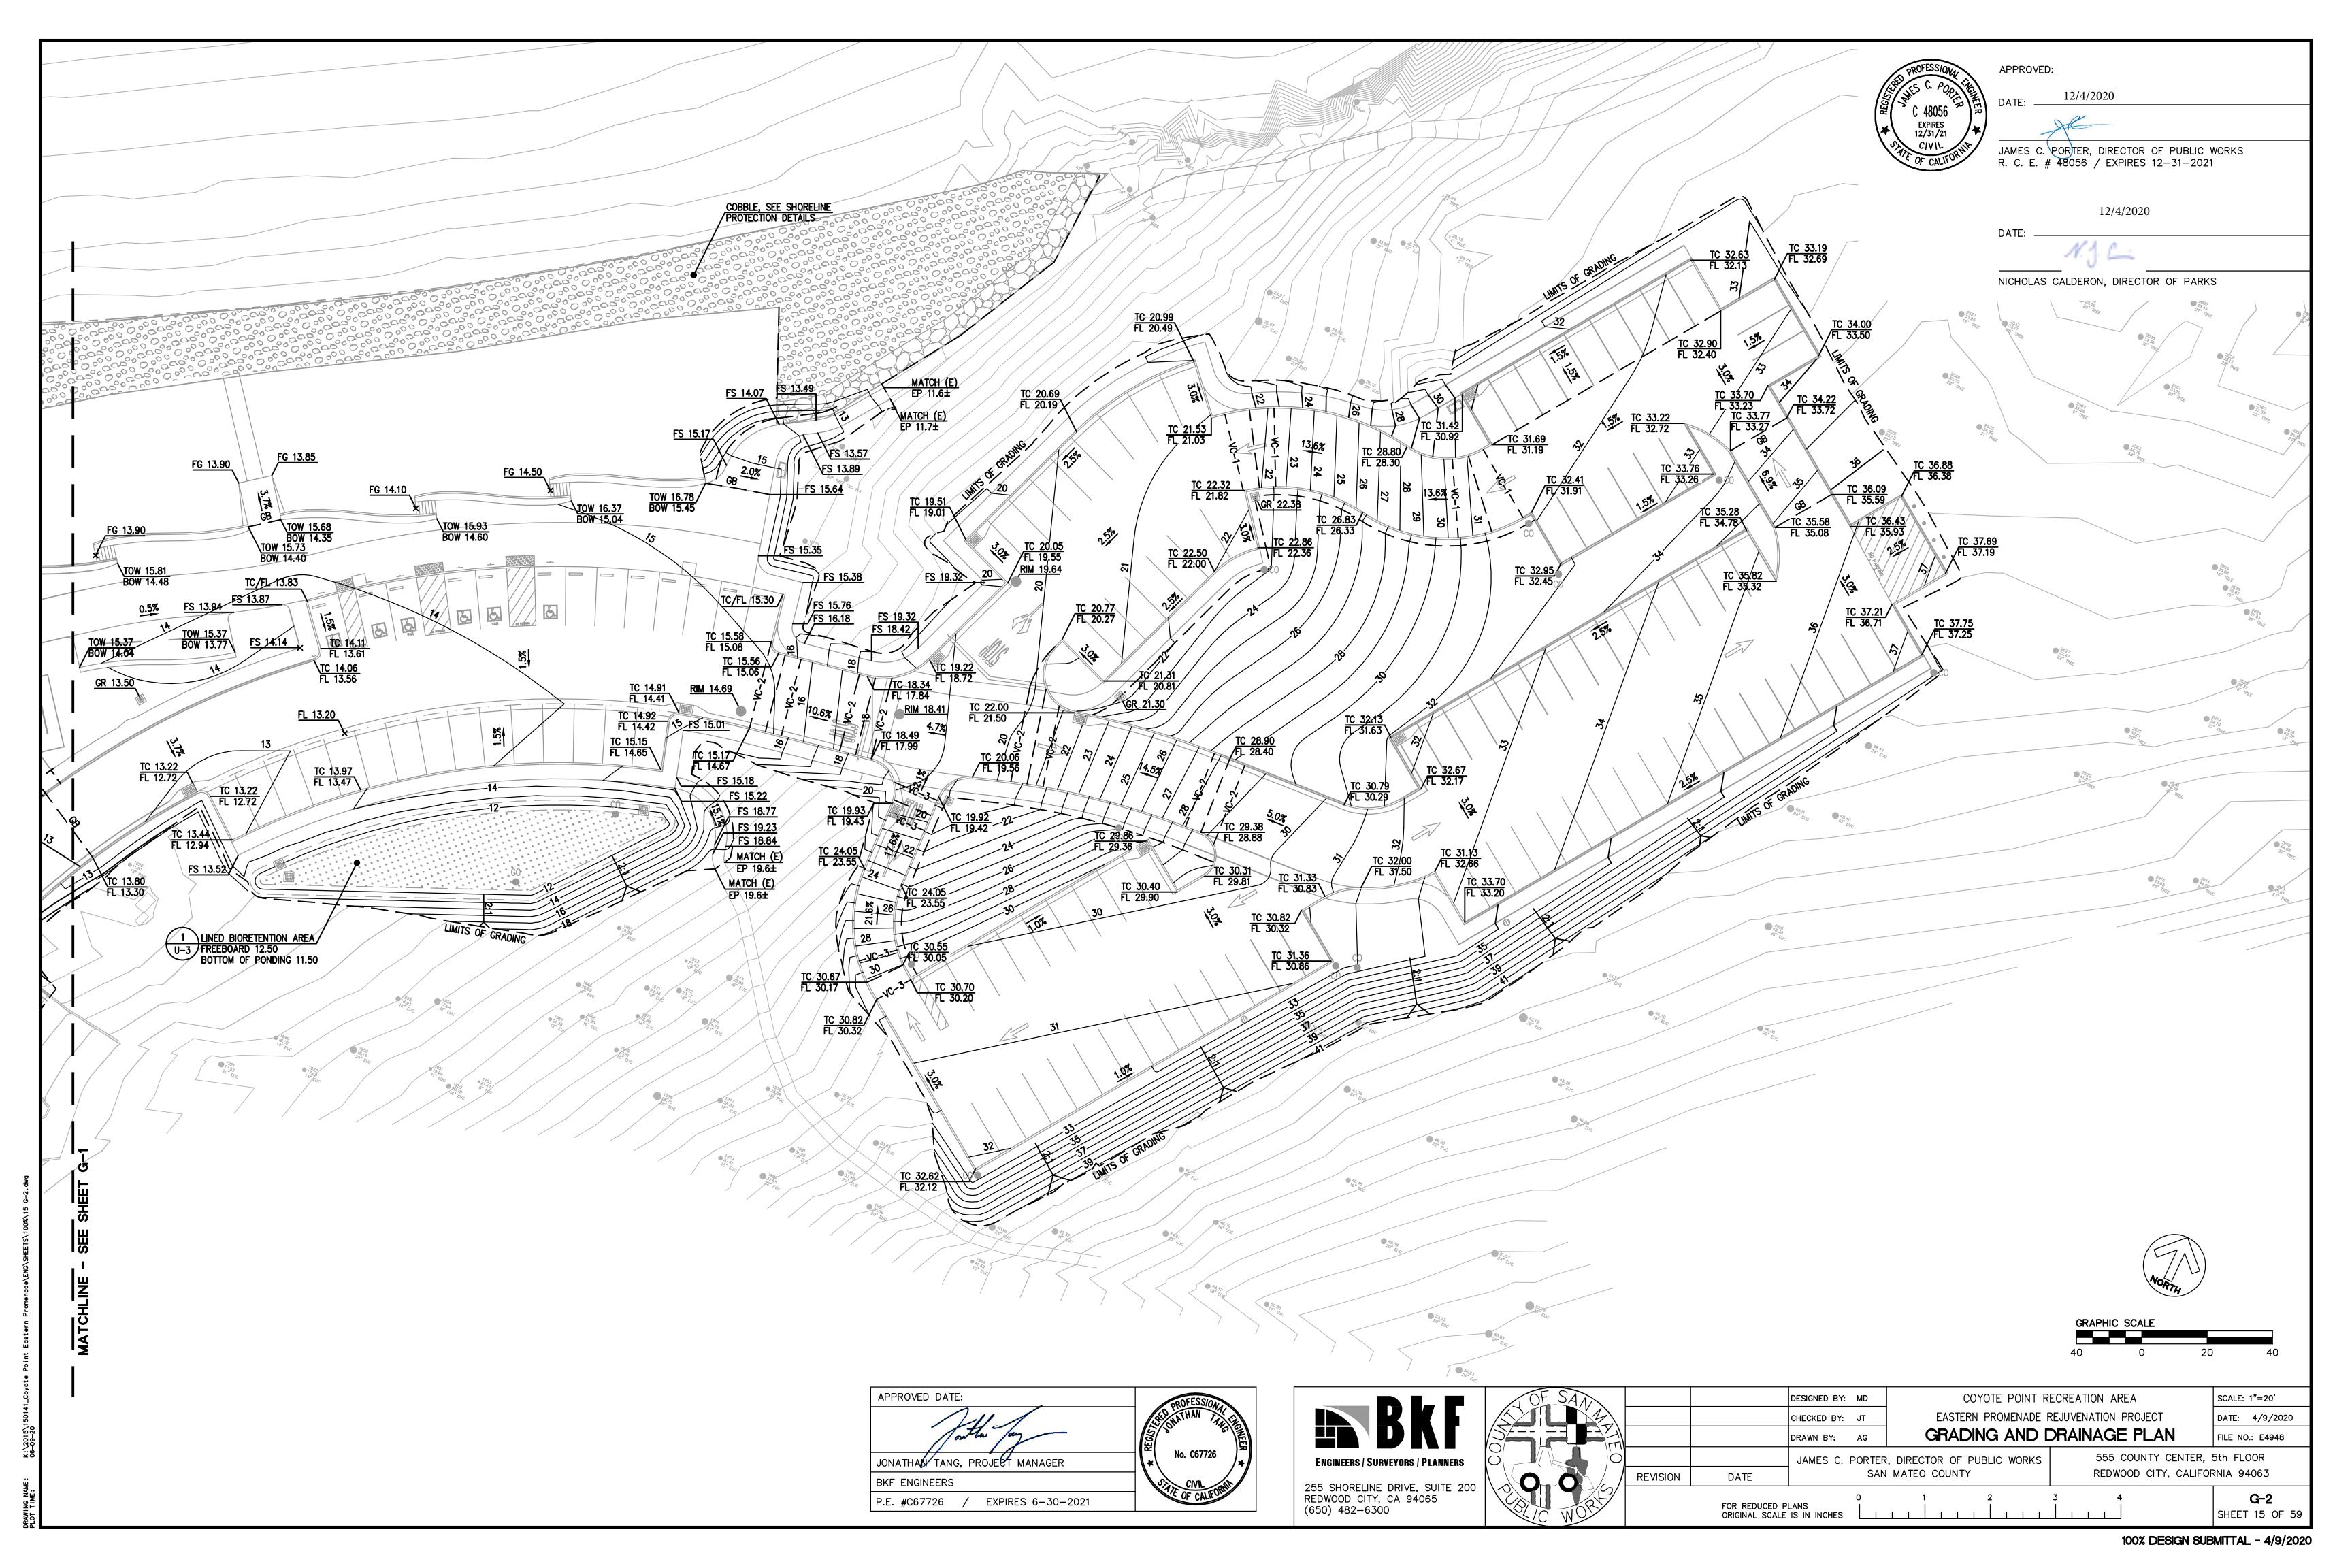


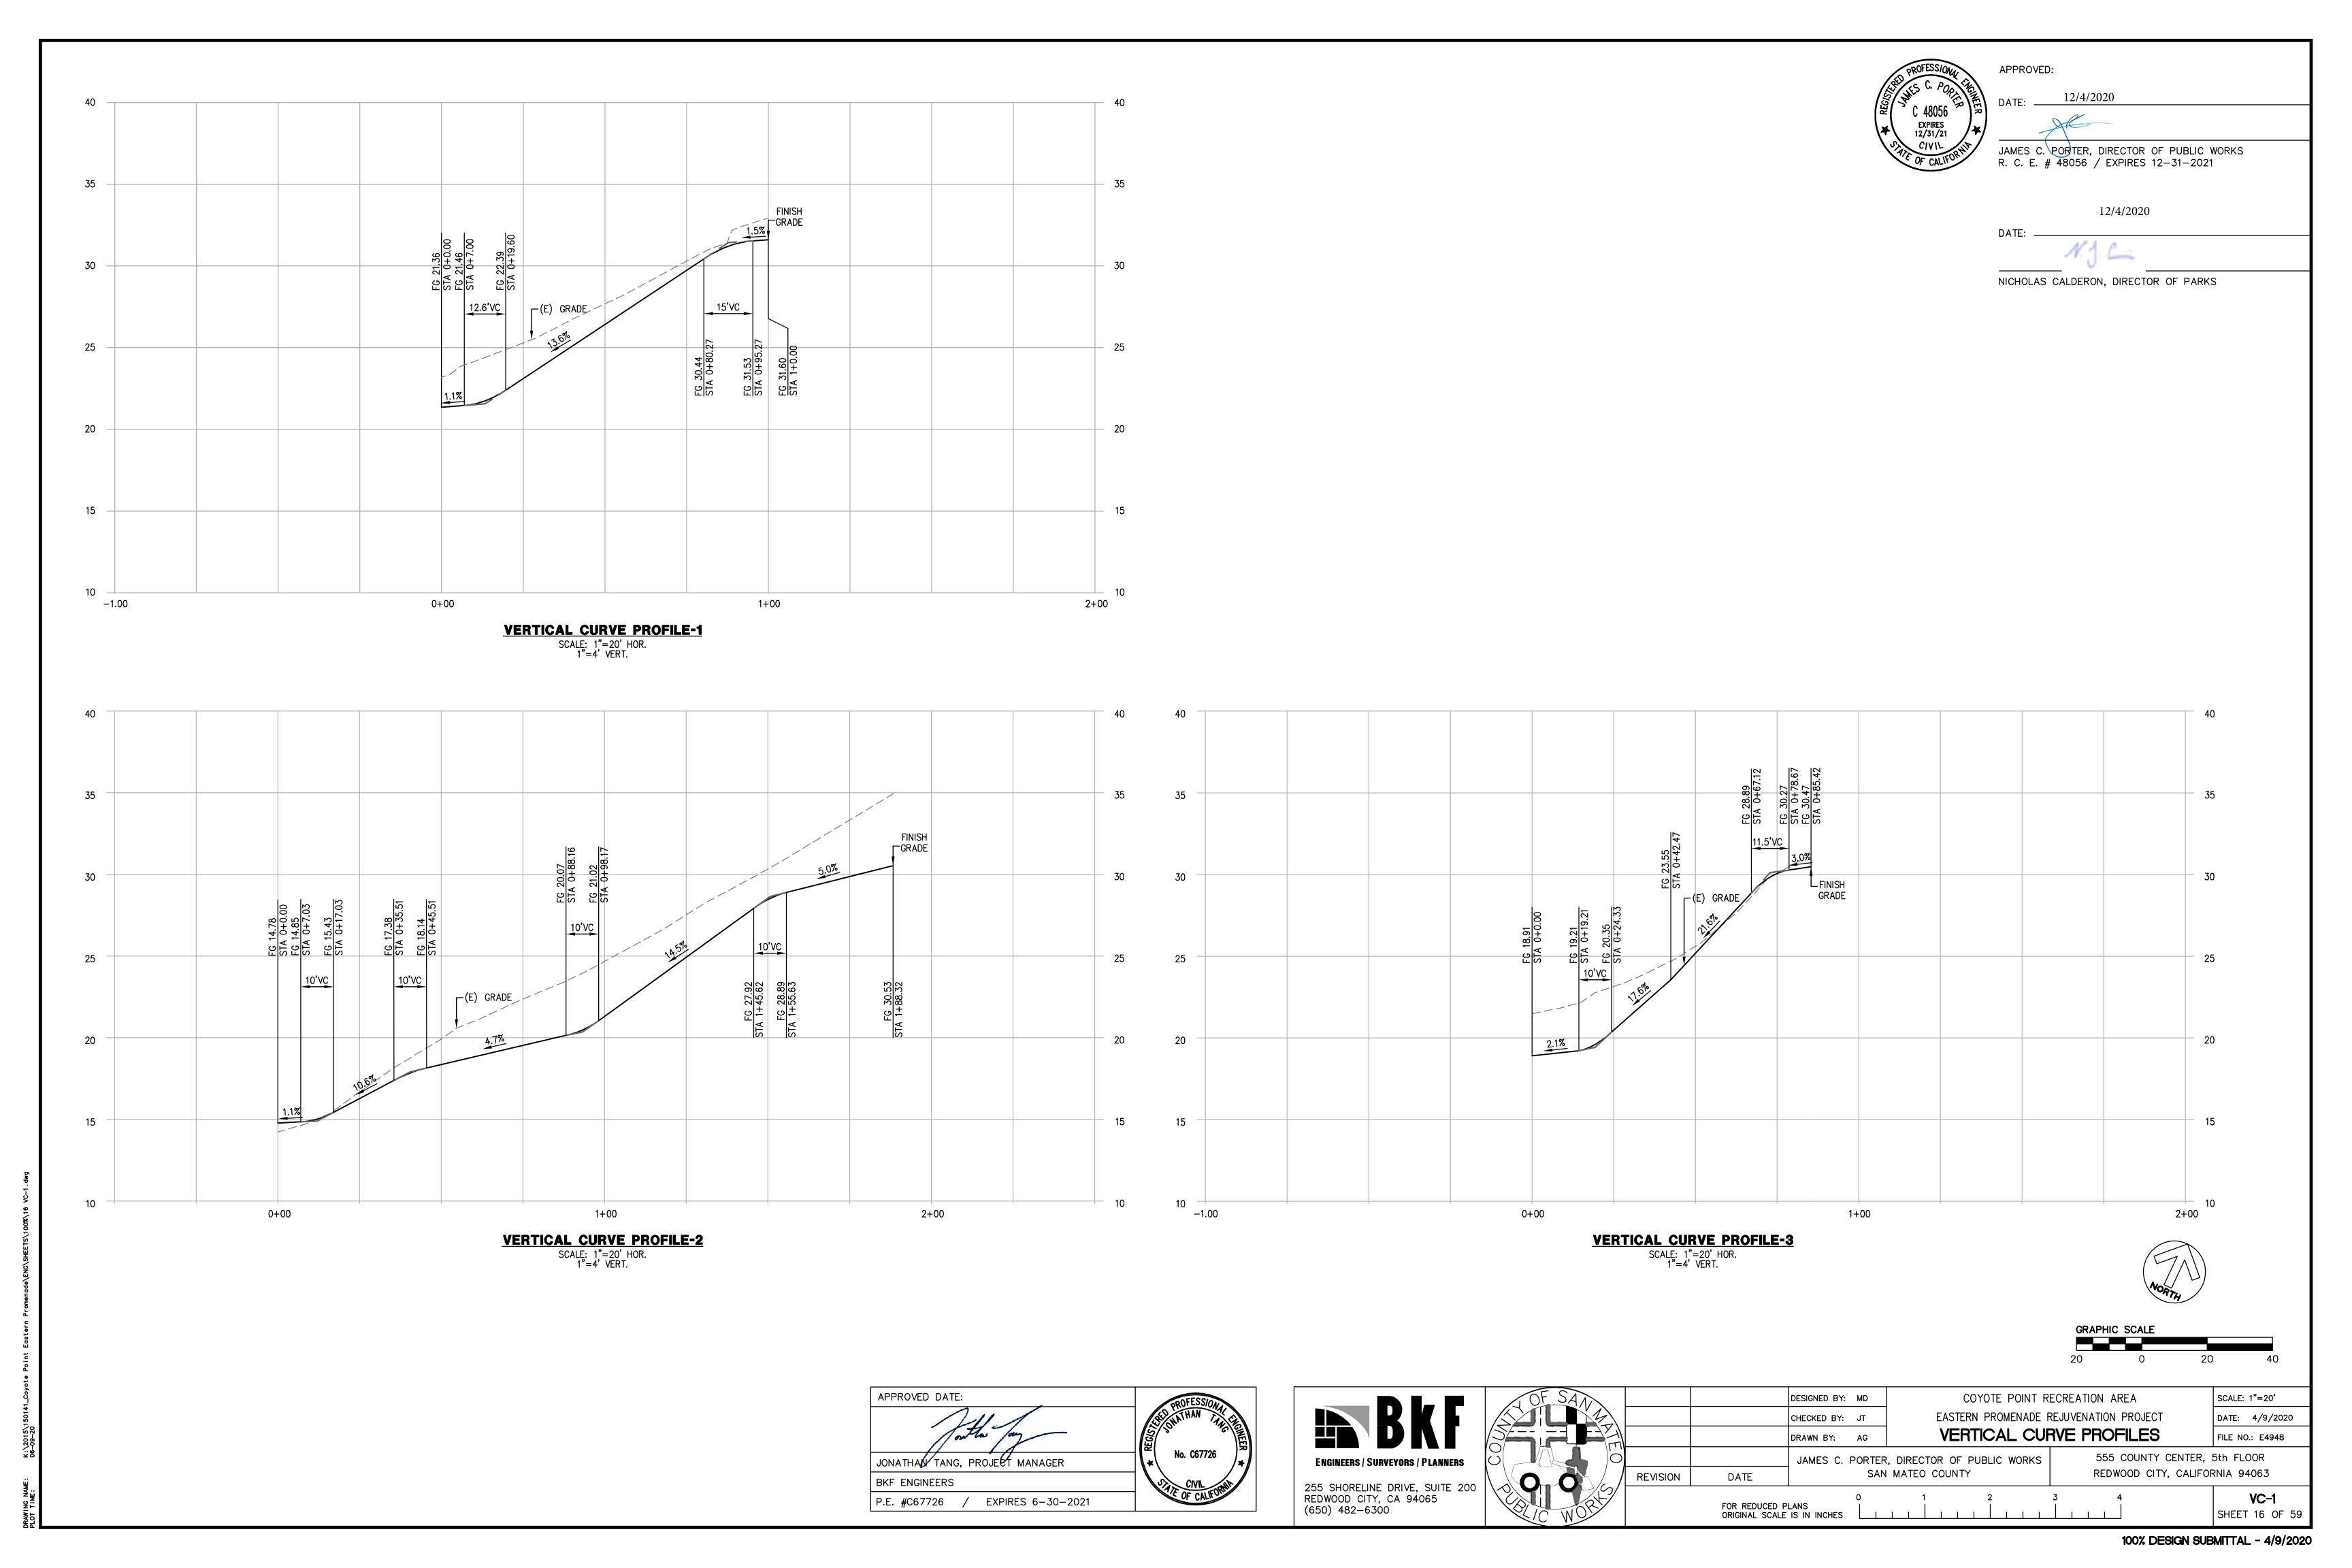


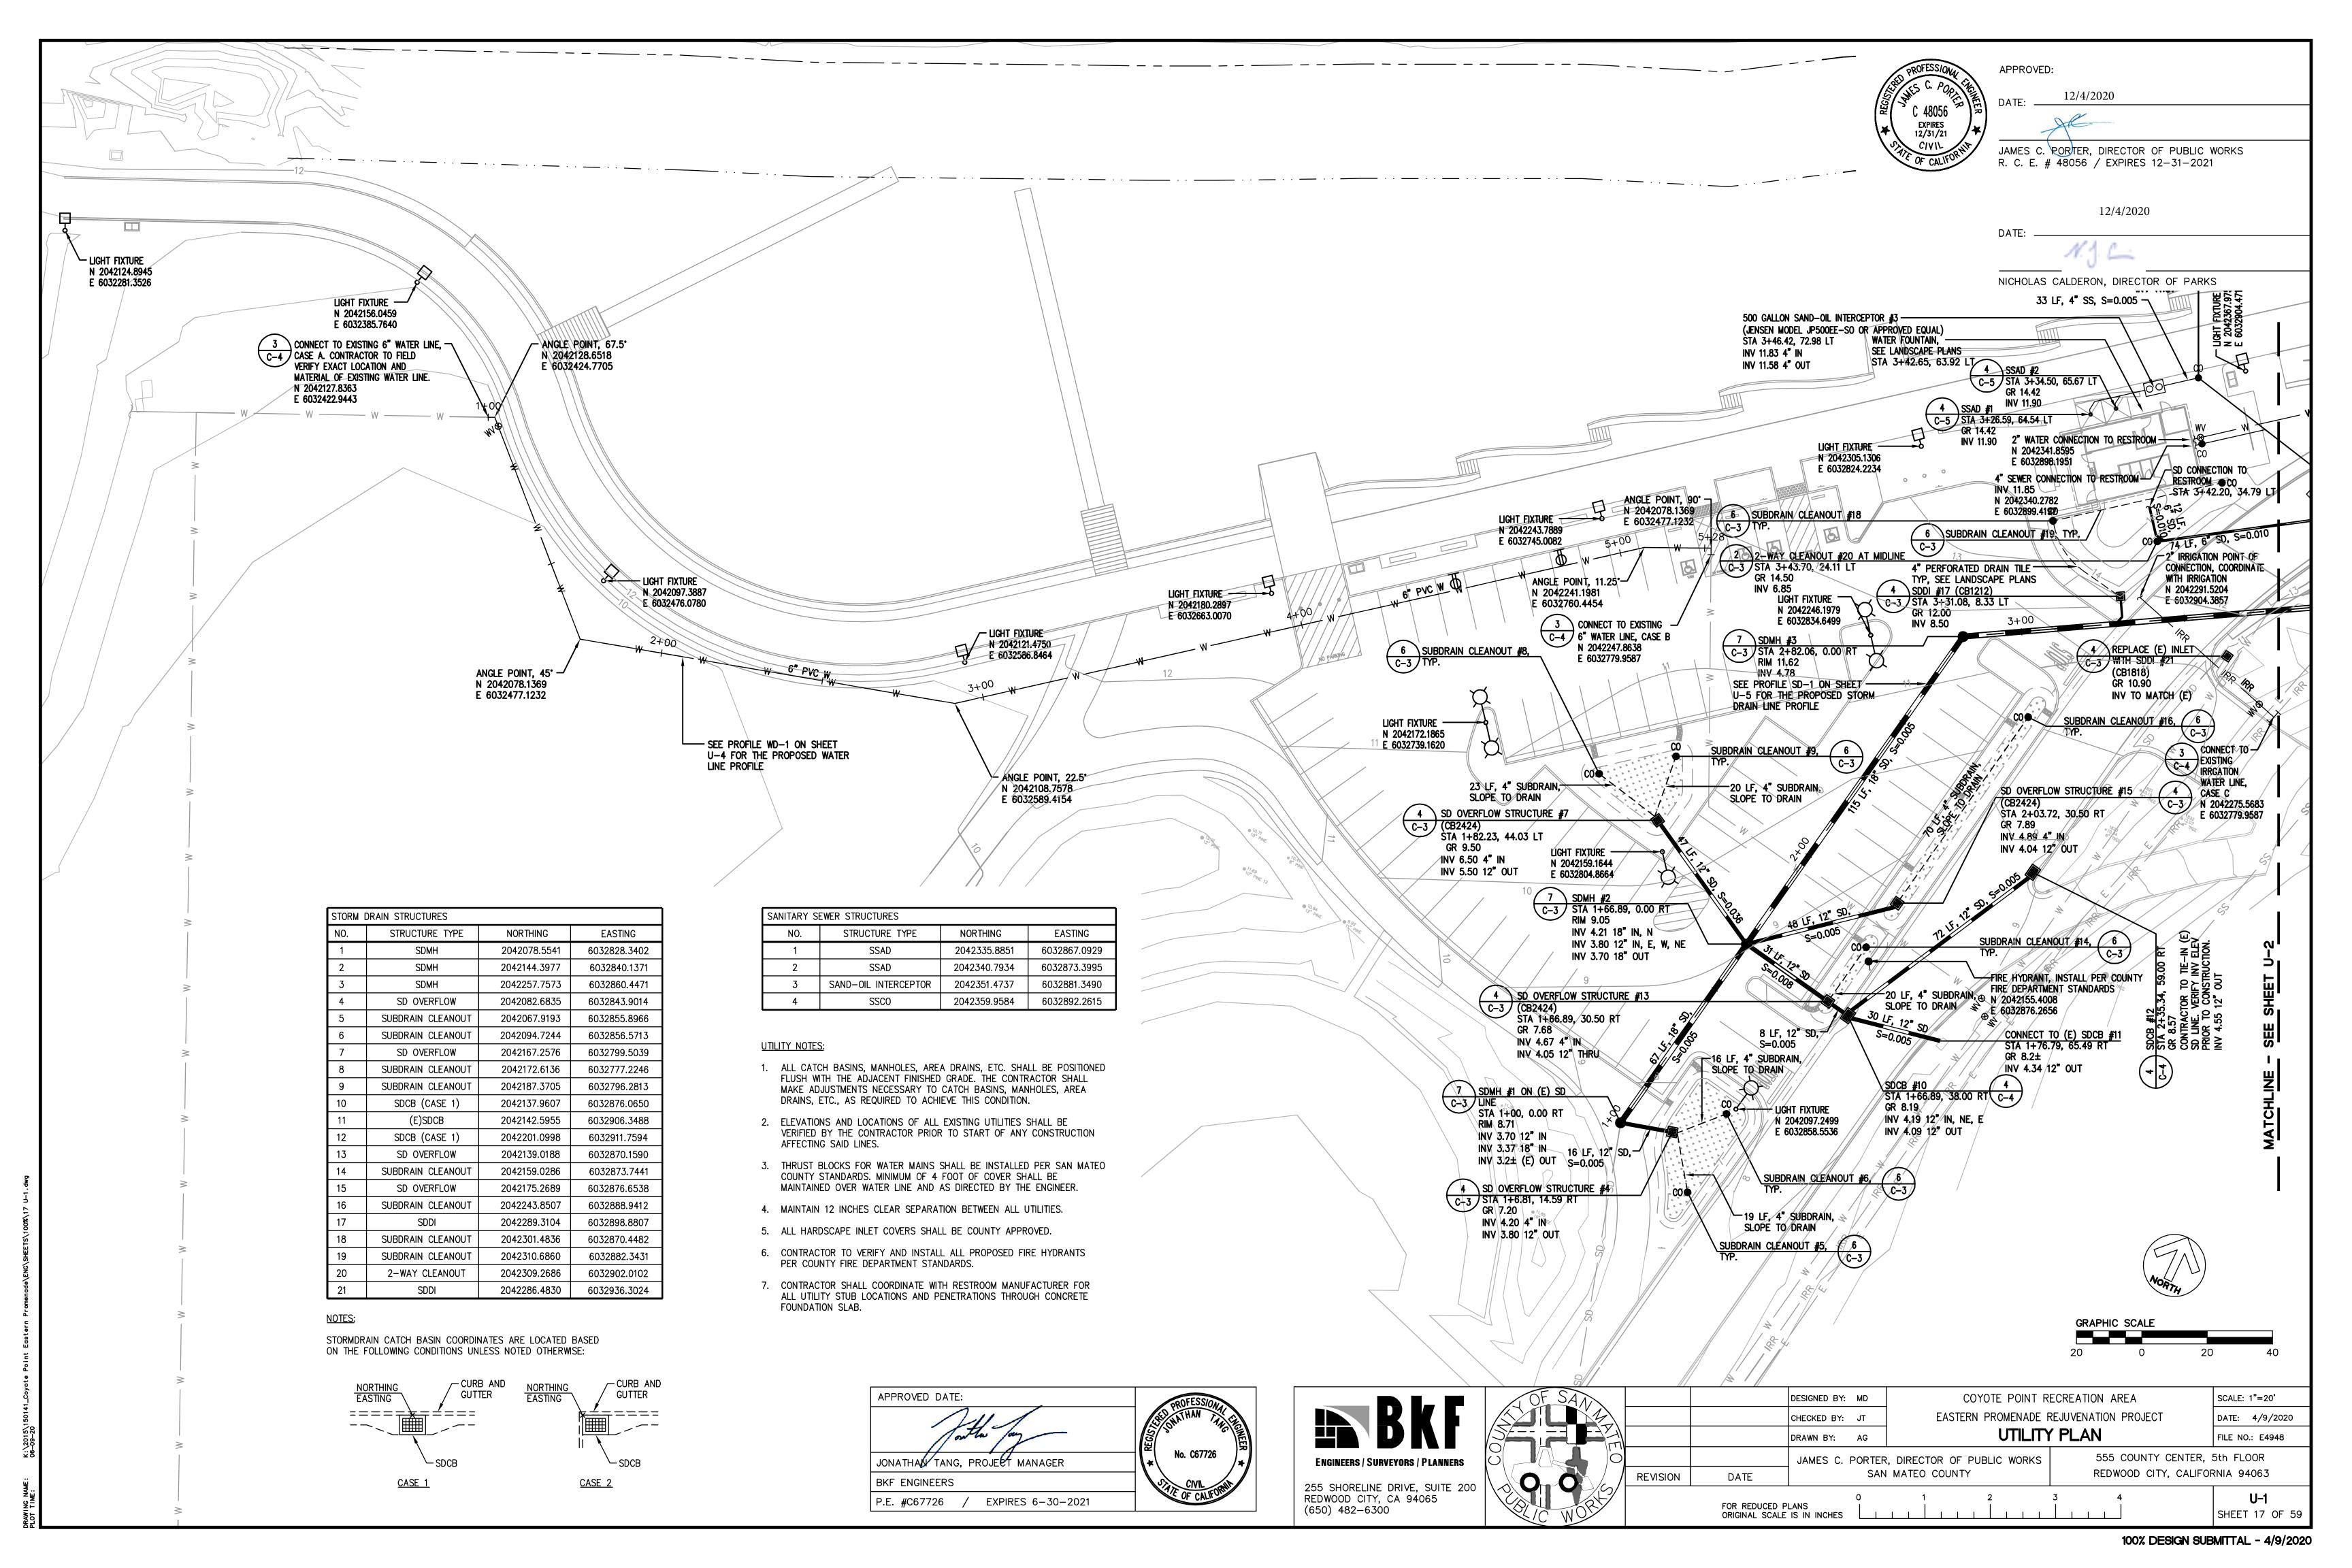


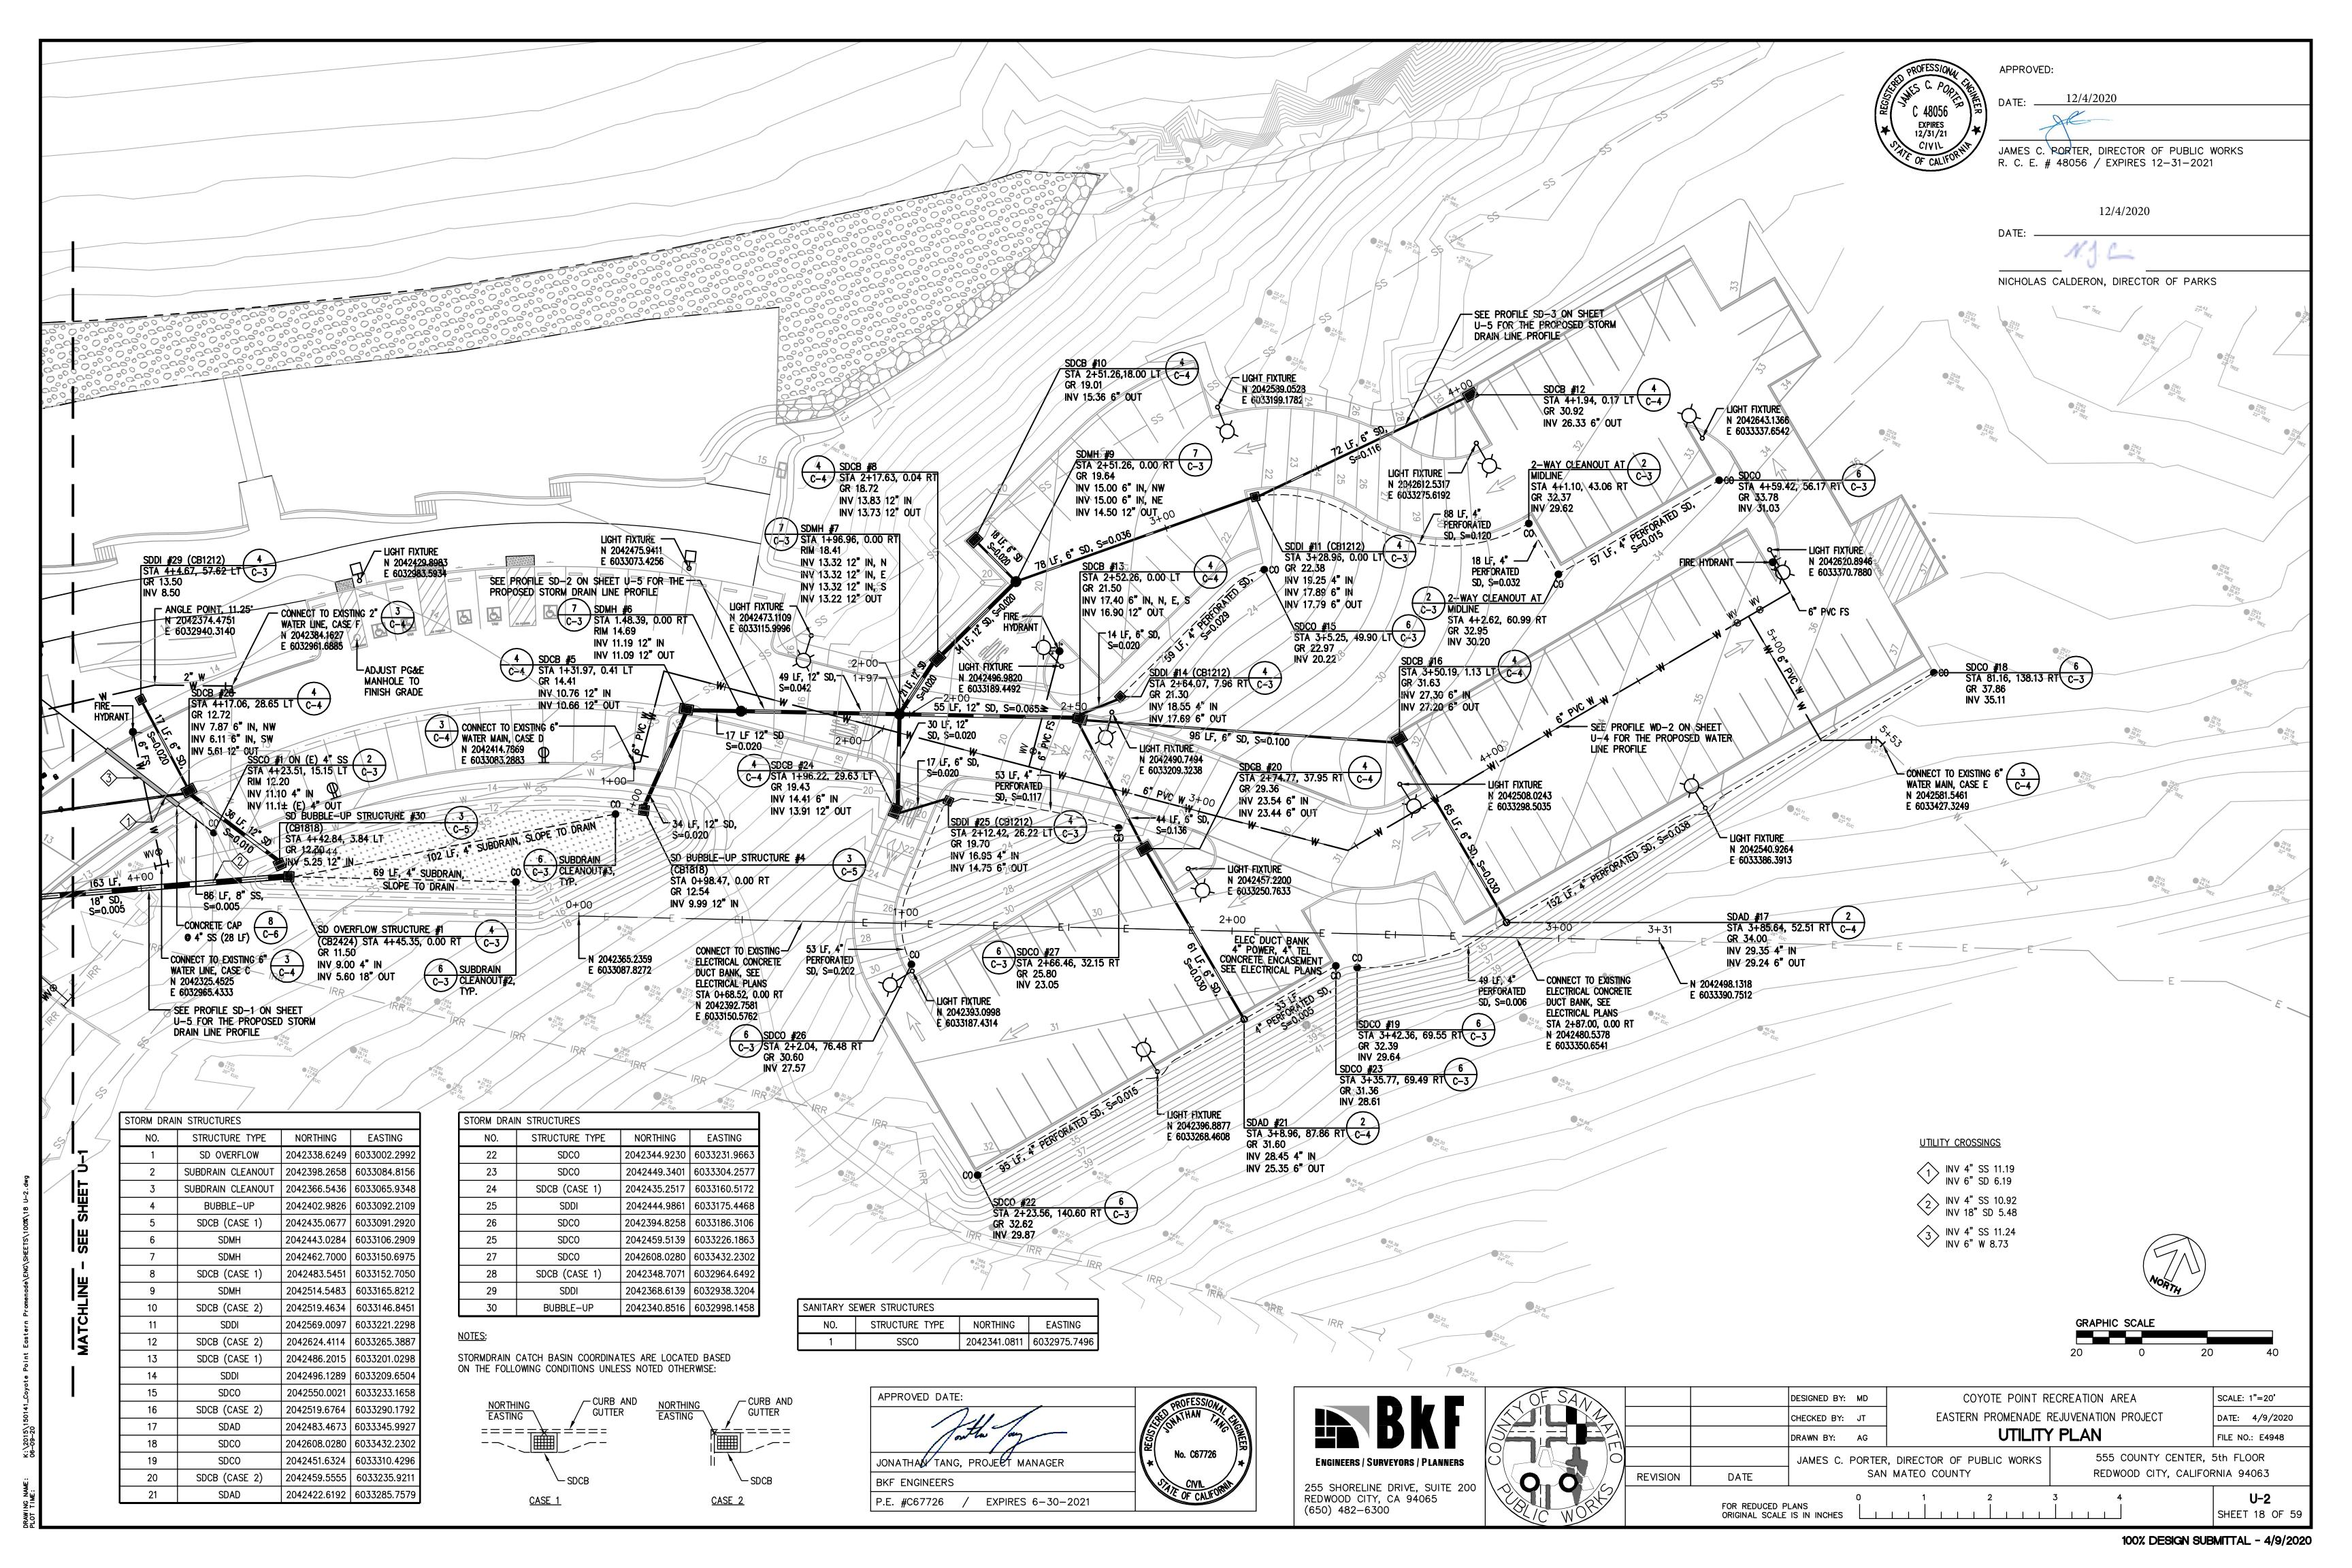

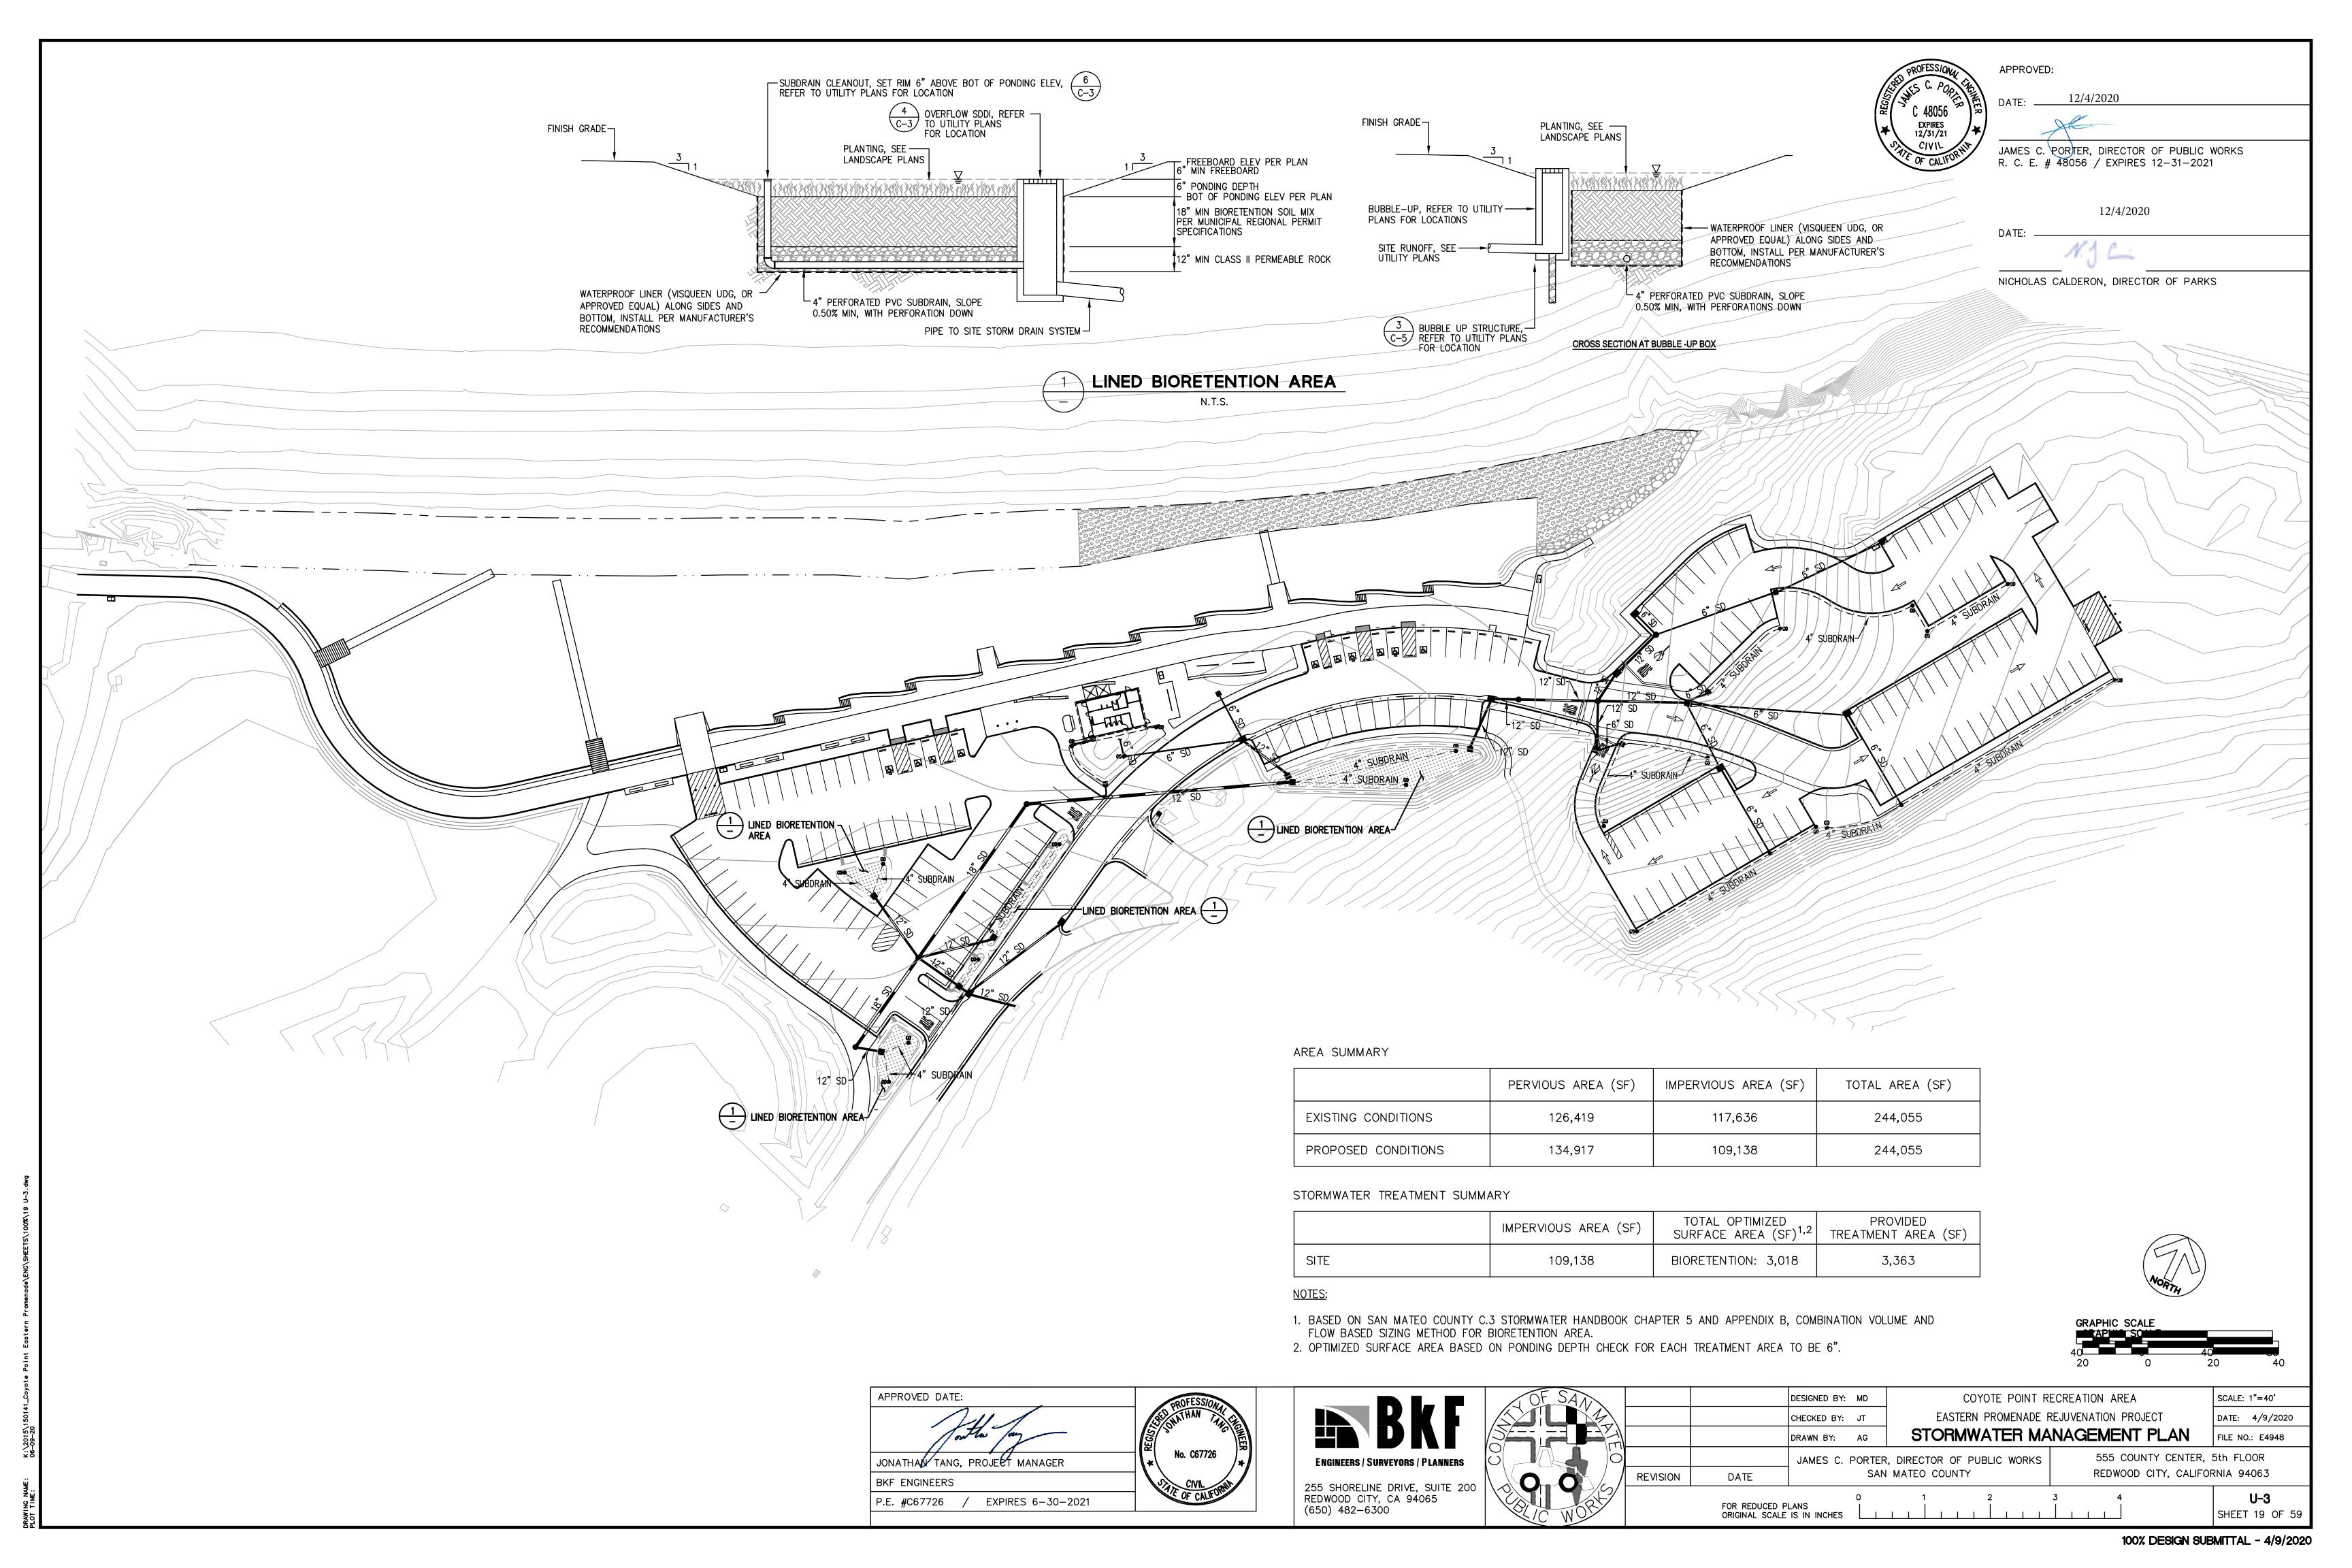

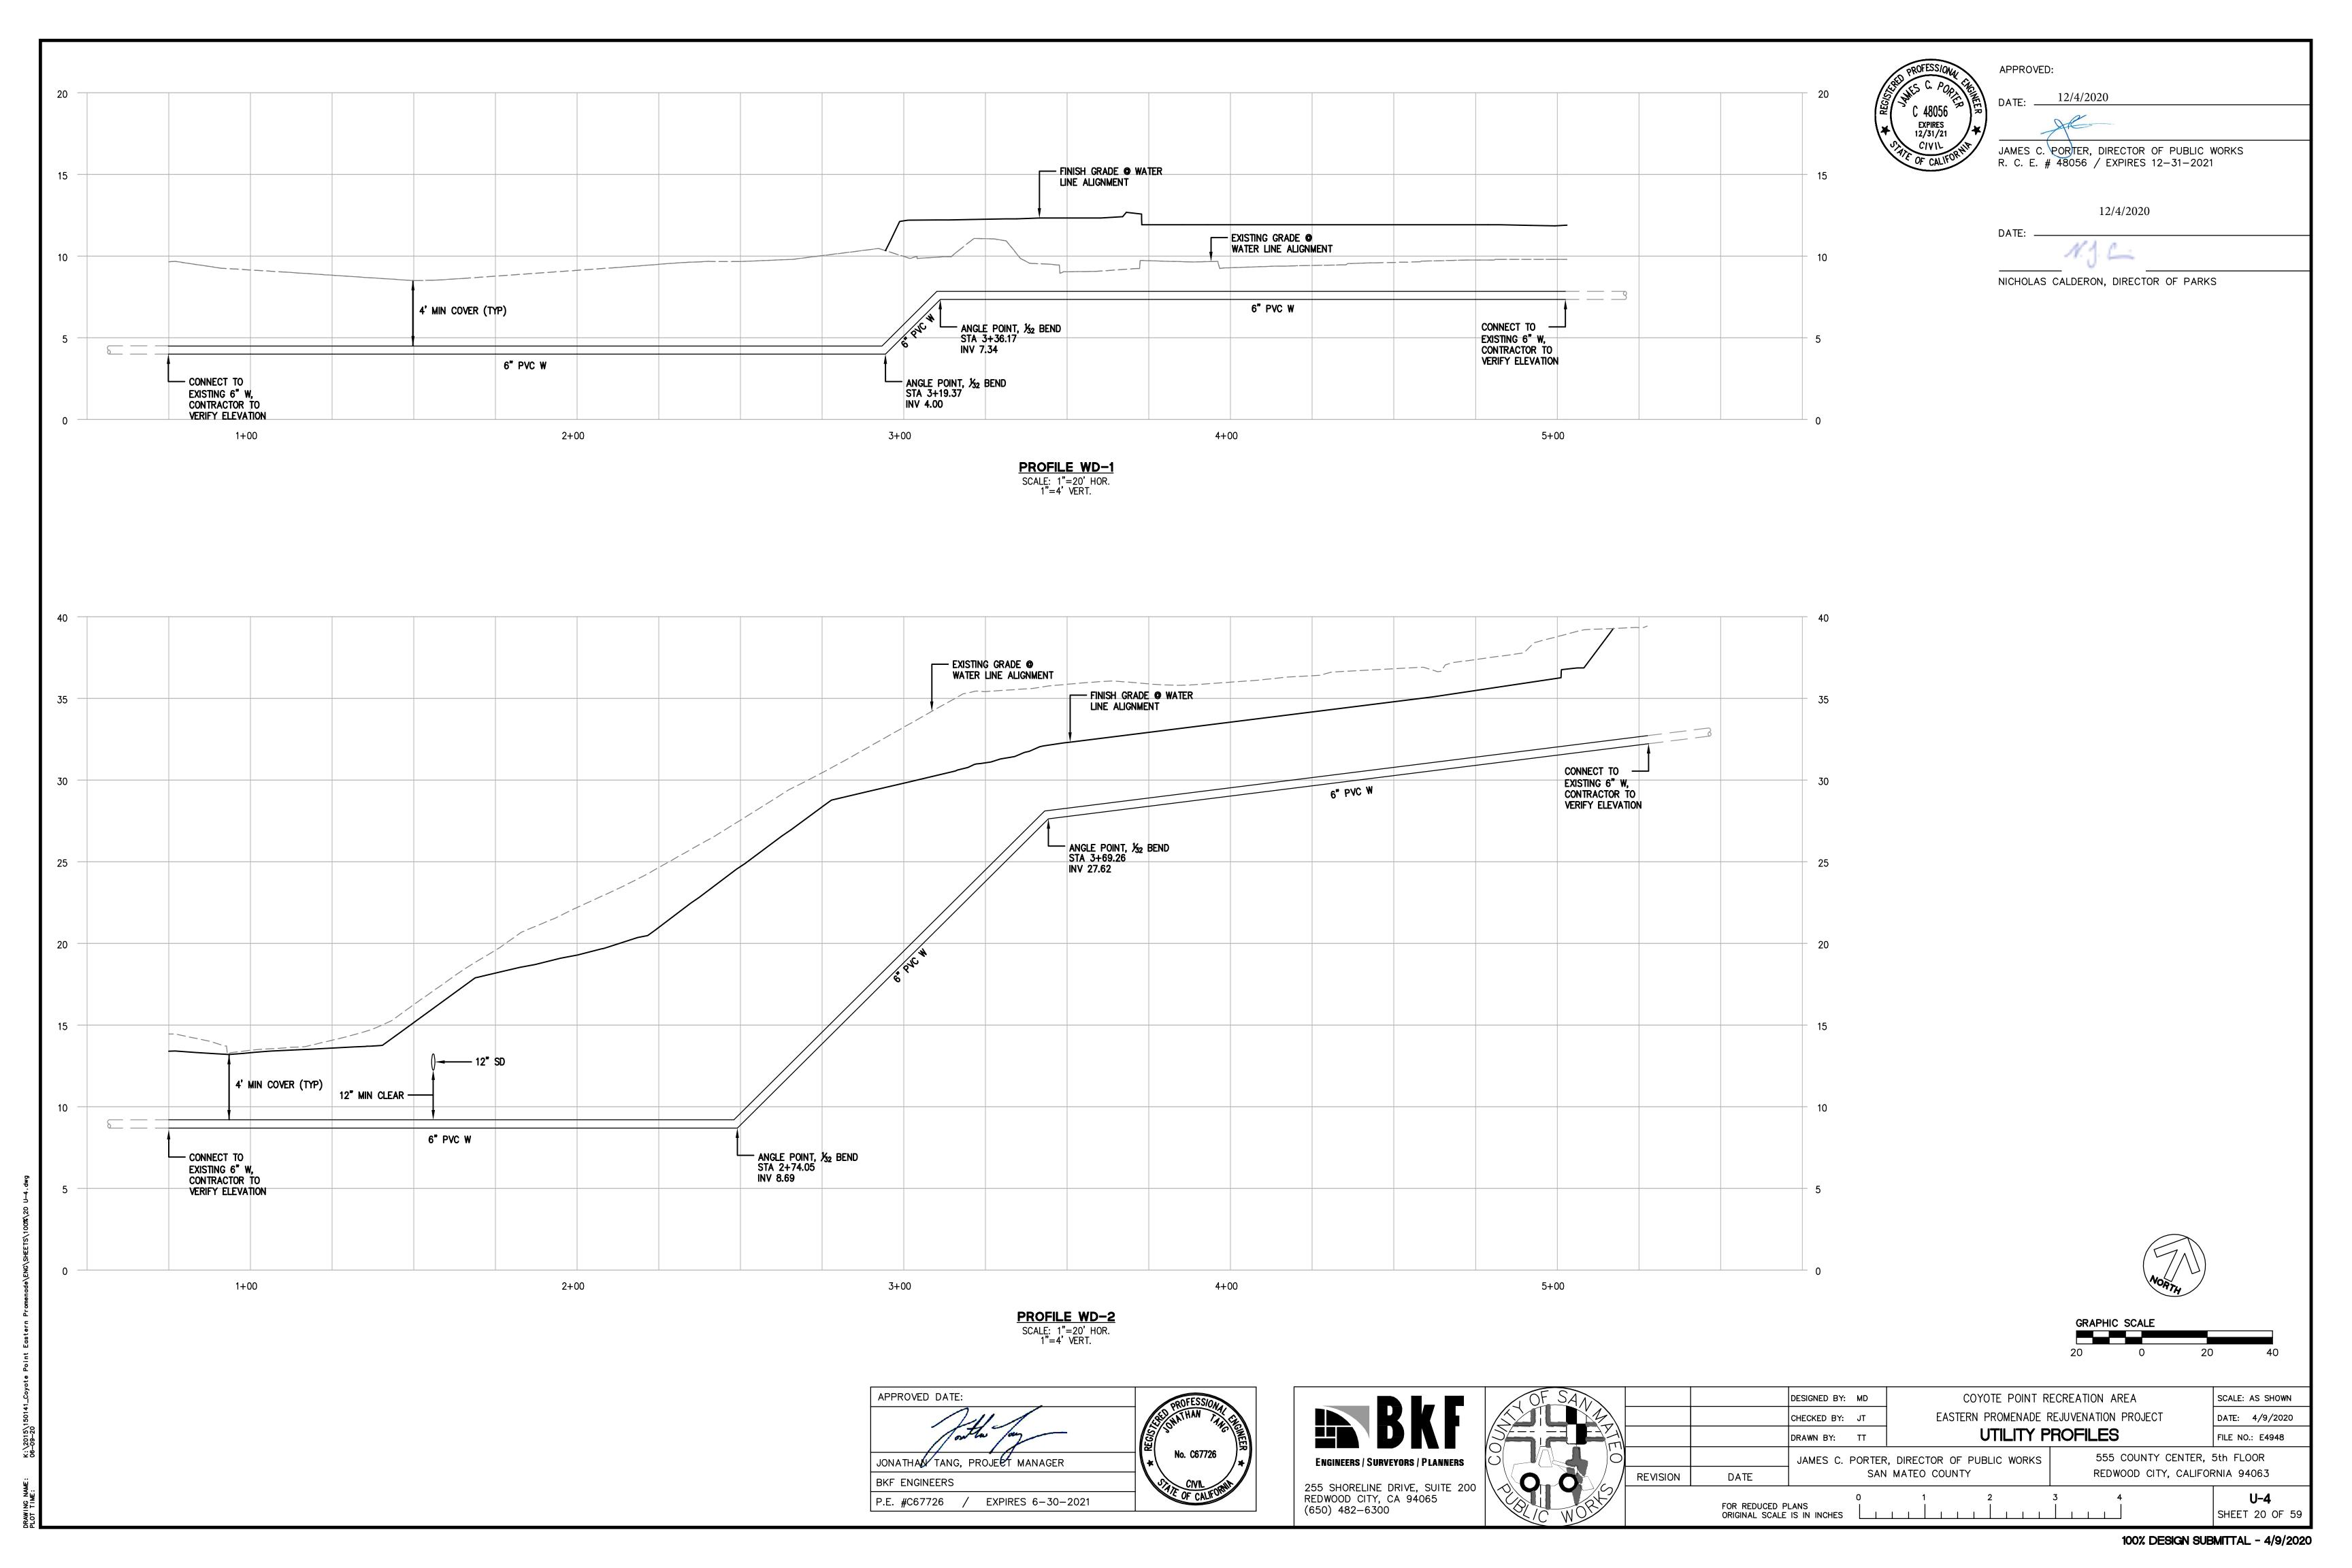


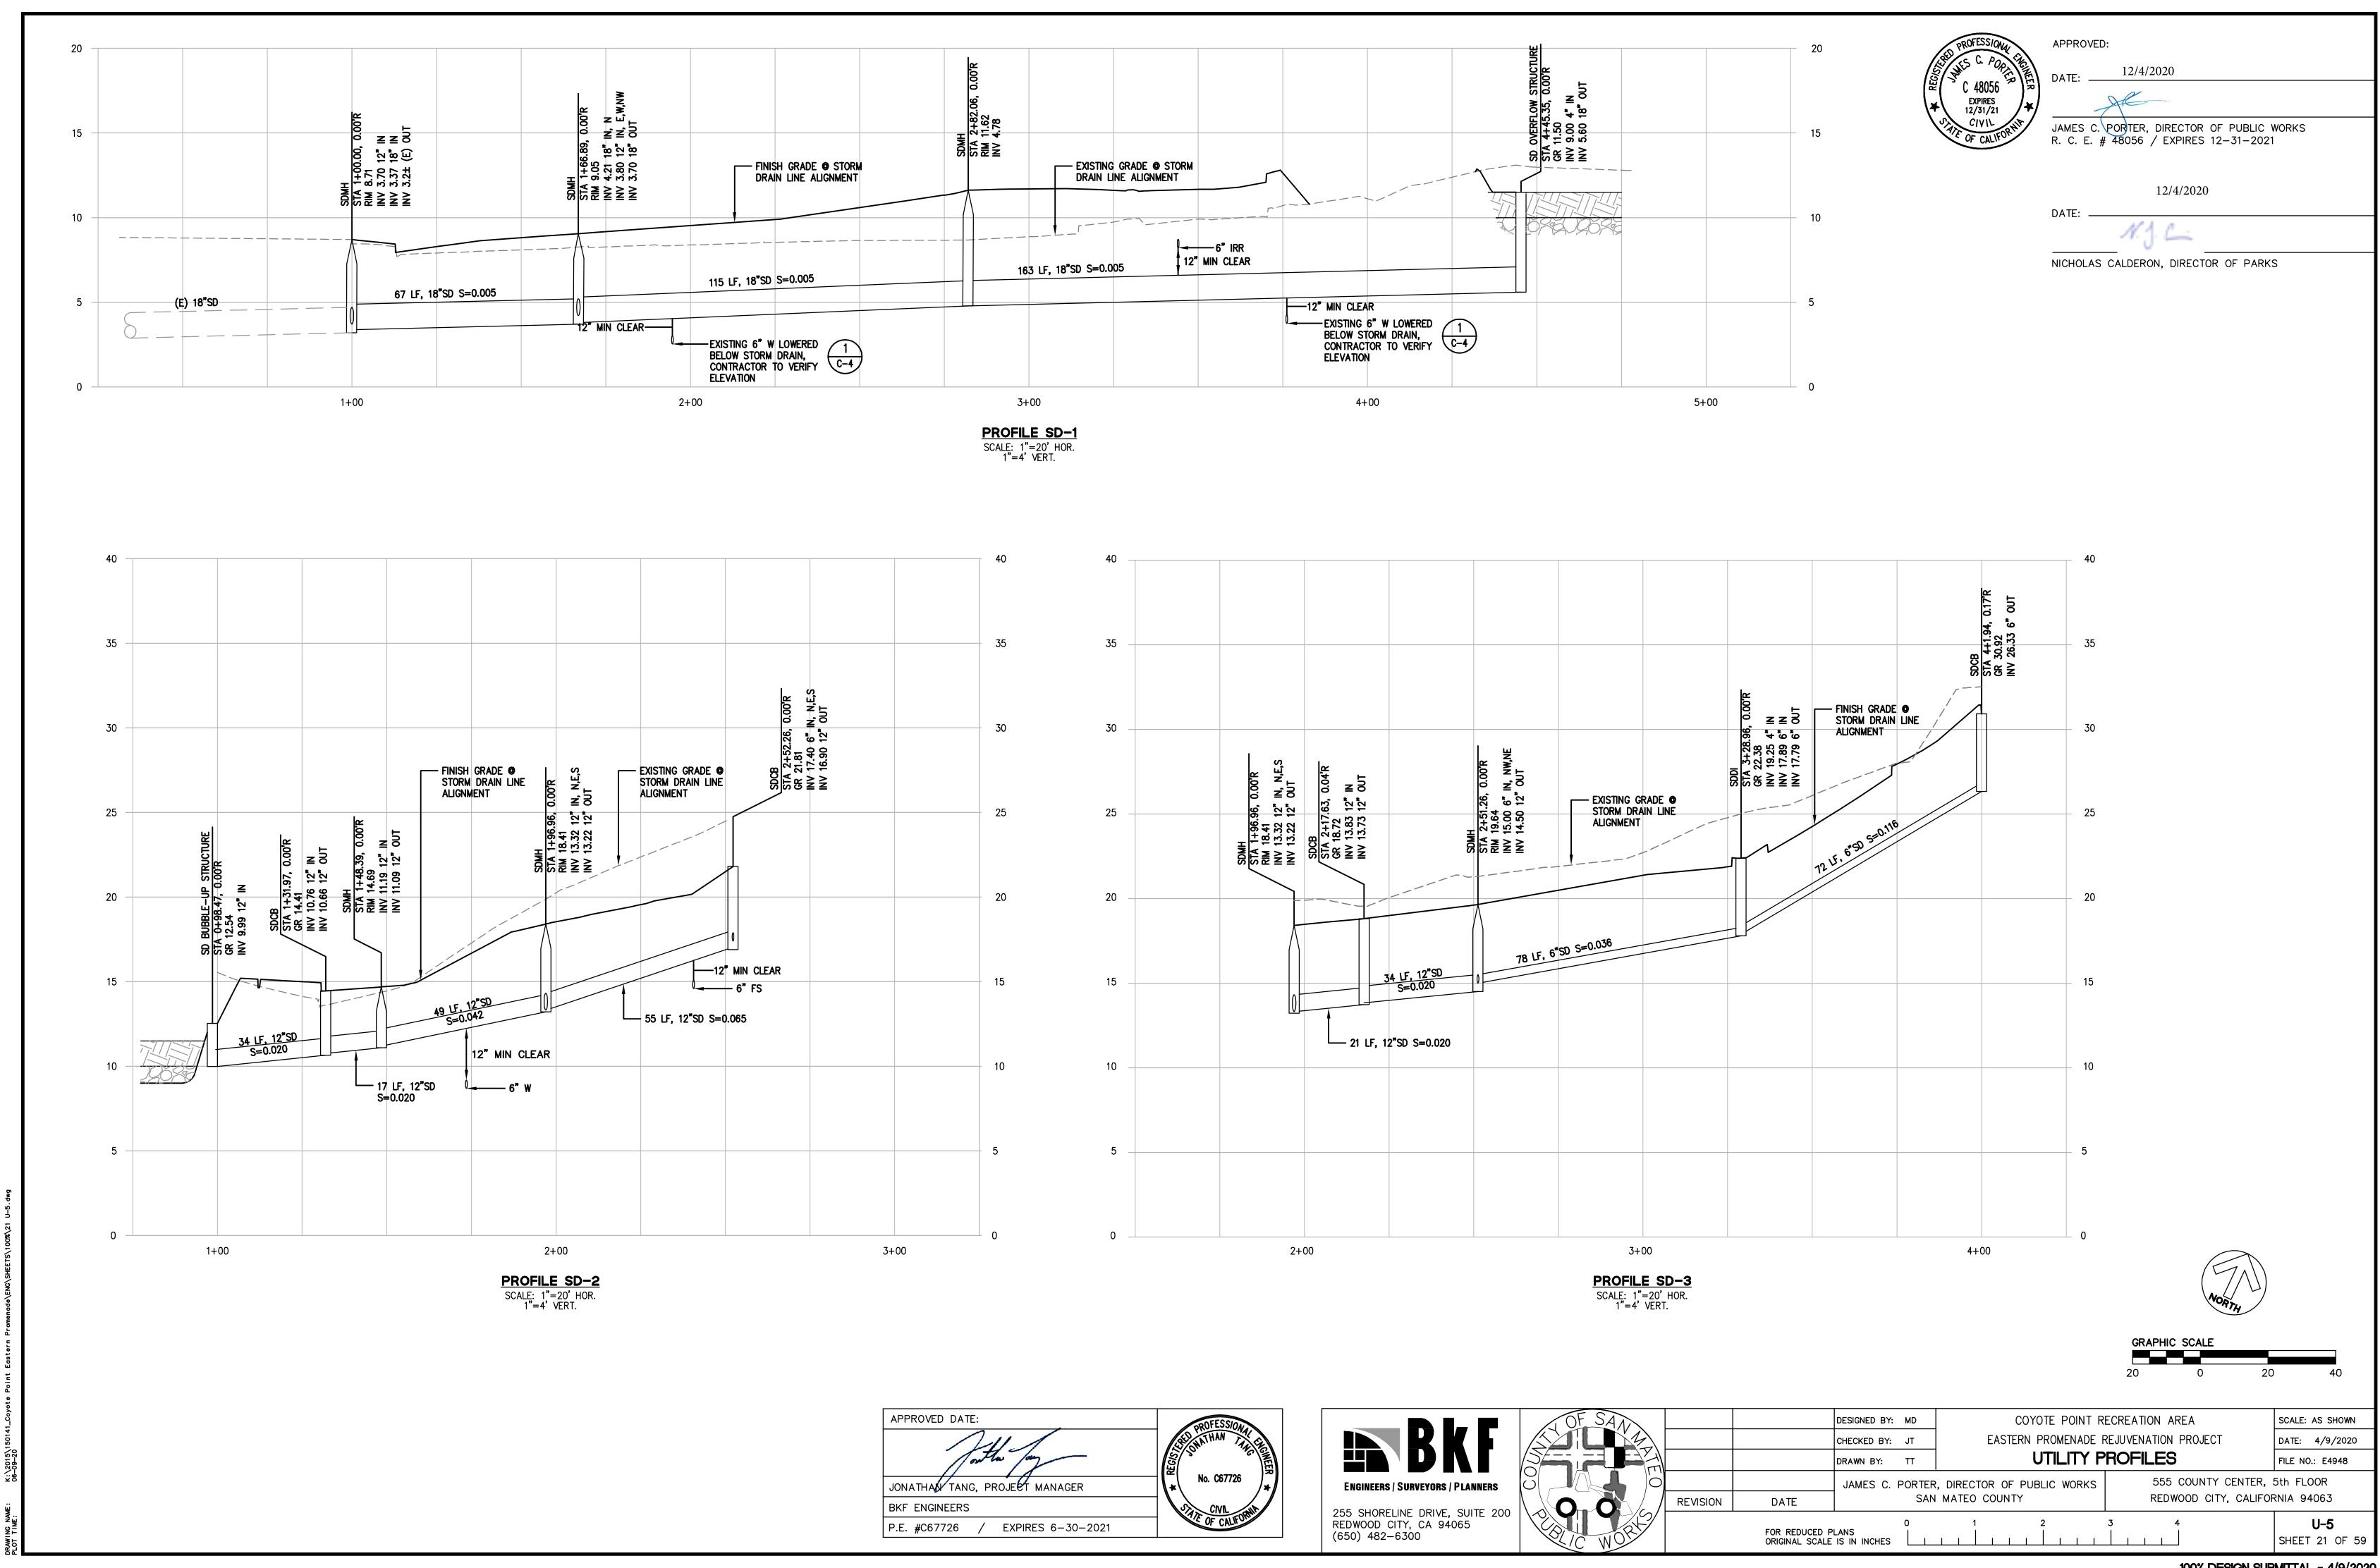

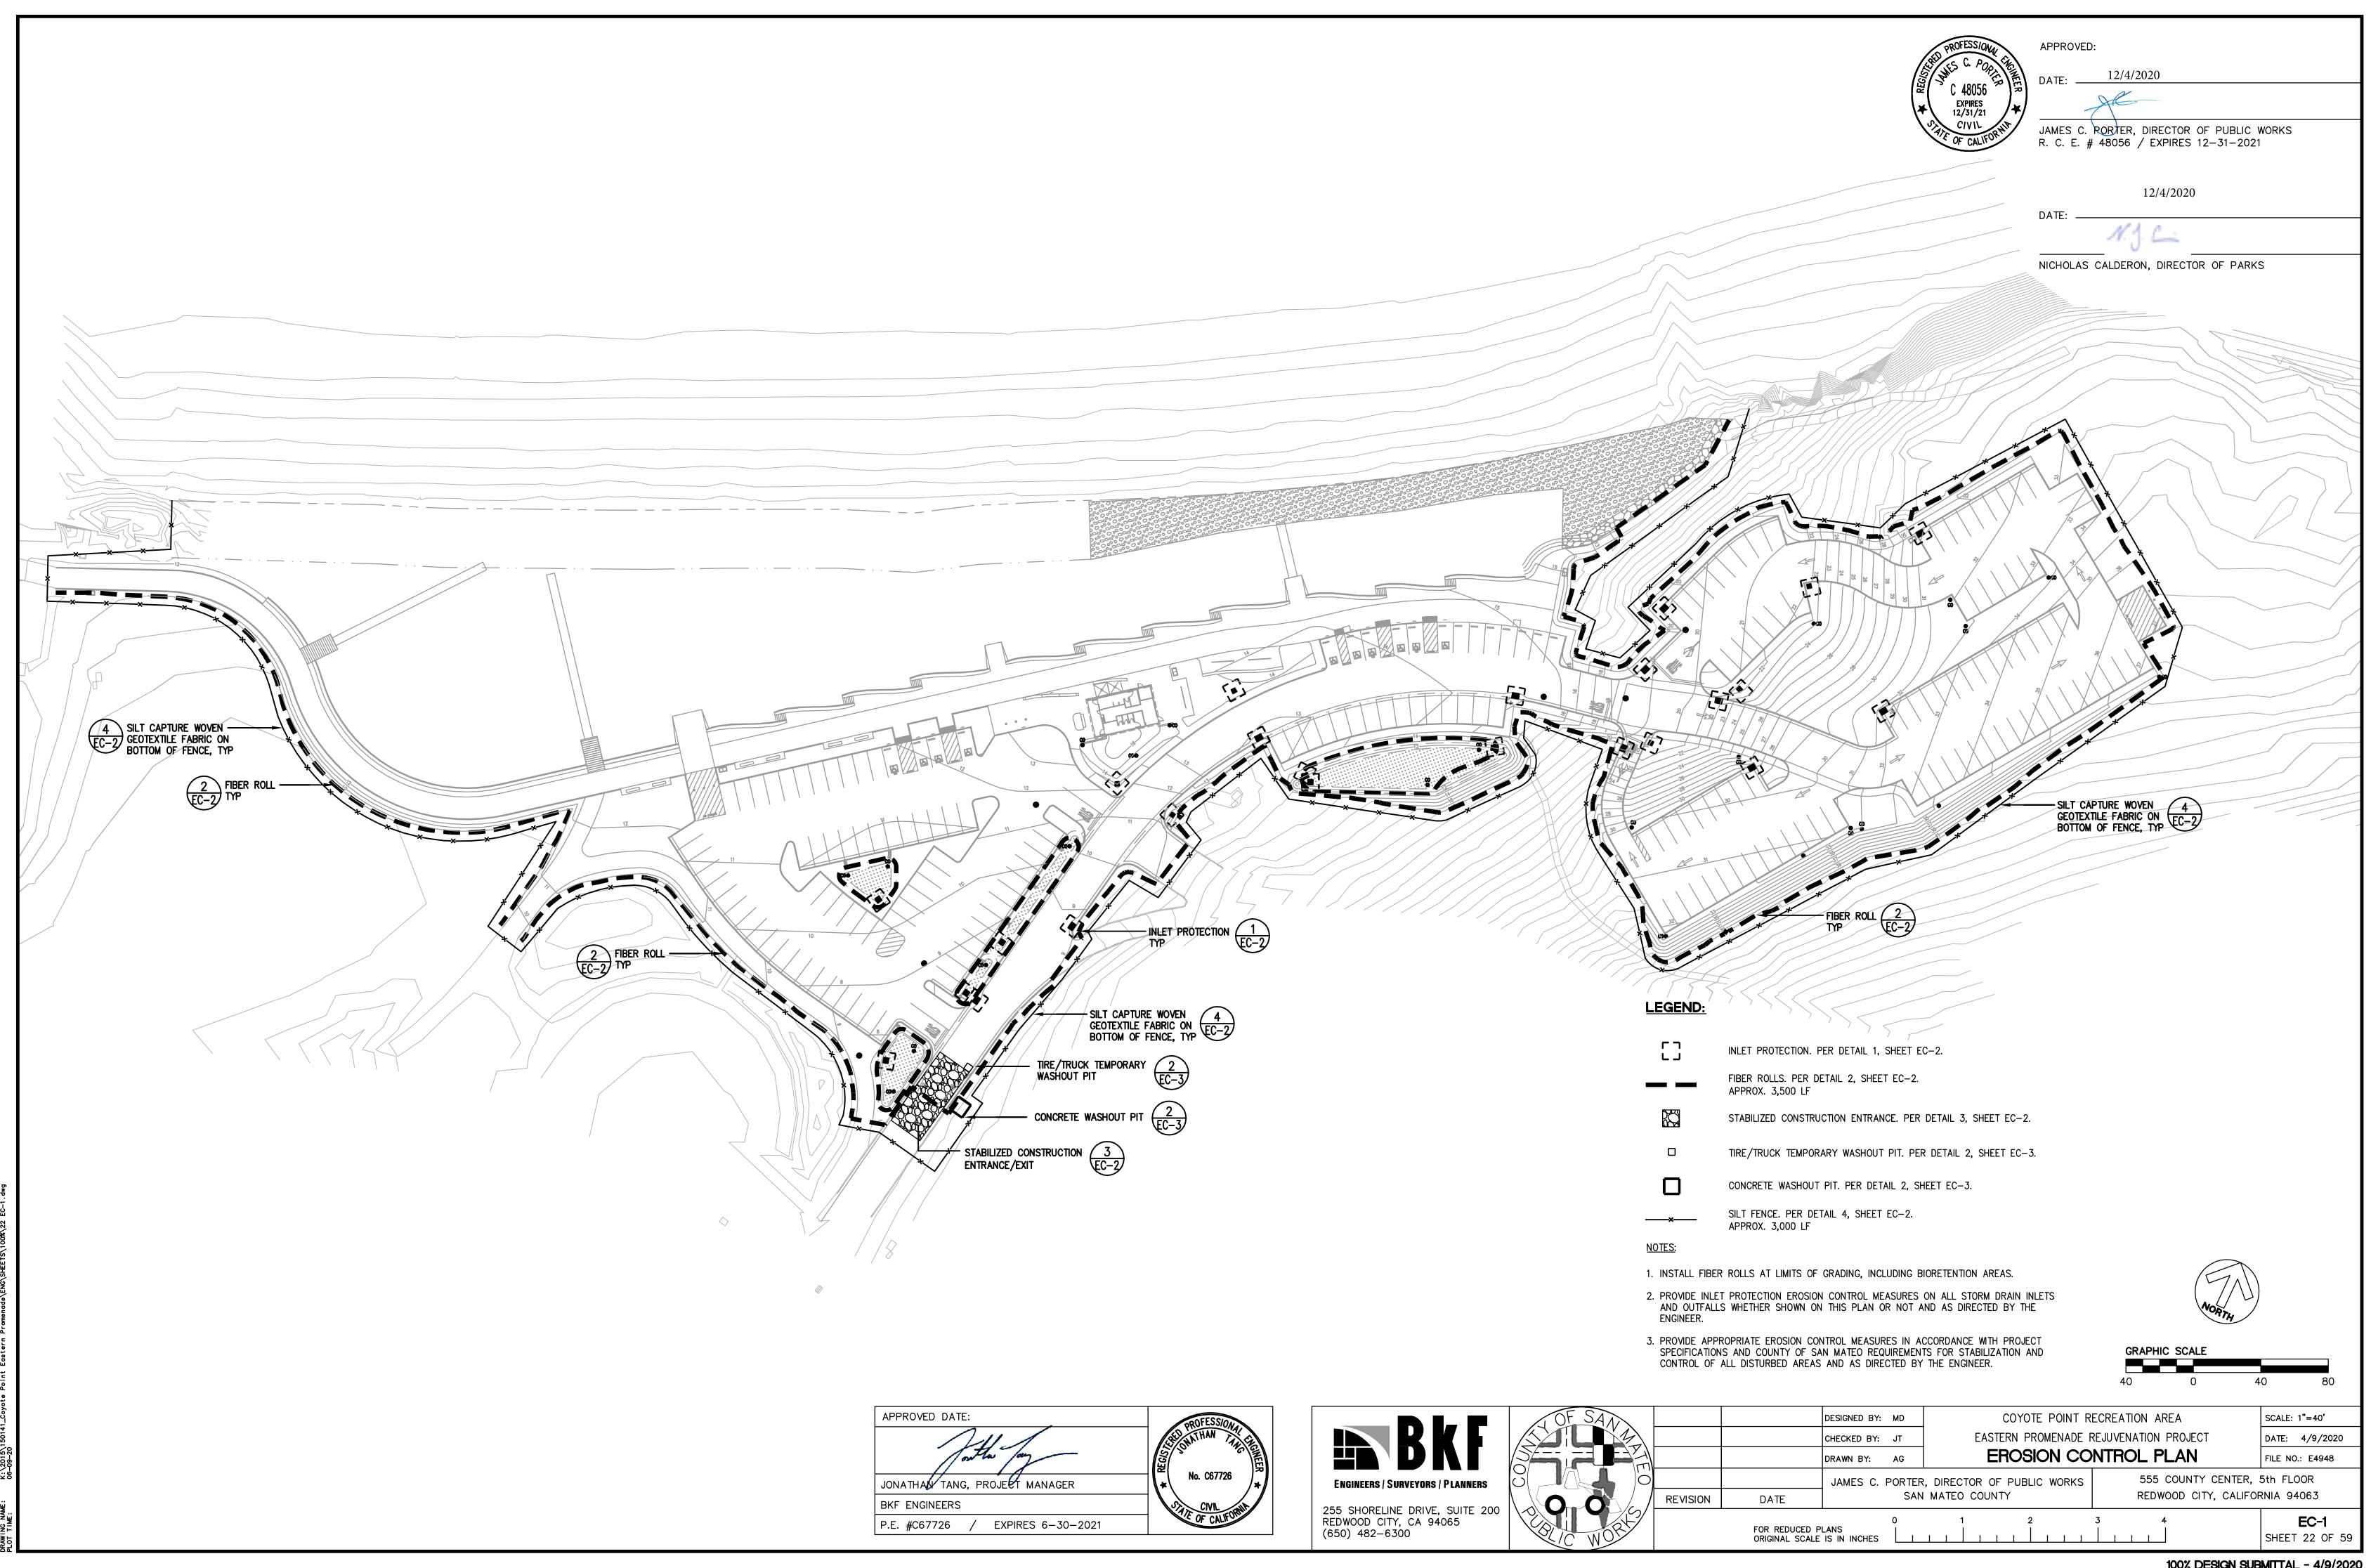

WHEN NECESSARY TO MEET FIELD CONDITIONS.

- 3. THE INTENT OF THESE PLANS IS TO PROVIDE THE INITIAL CONCEPT FOR INTERIM EROSION CONTROL. THE CONTRACTOR SHALL UPDATE THE PLANS TO REFLECT CHANGING SITE CONDITIONS. PLAN UPDATES SHALL BE BASED UPON GENERAL SURVEY DATA. EROSION CONTROL EFFECTIVENESS SHALL ALSO BE MONITORED AND THE PLANS UPGRADED AS REQUIRED TO PREVENT SIGNIFICANT QUANTITIES OF SEDIMENT FROM ENTERING THE DOWNSTREAM DRAINAGE SYSTEM.
- 4. THIS PLAN MAY NOT COVER ALL THE SITUATIONS THAT ARISE DURING CONSTRUCTION DUE TO UNANTICIPATED FIELD CONDITIONS. IN GENERAL, THE CONTRACTOR IS RESPONSIBLE FOR KEEPING THE STORM RUN OFF SEDIMENT FROM LEAVING THE SITE. FIBER ROLLS, SAND BAGS, AND SILT FENCES SHALL BE USED BY THE CONTRACTOR ON AN AS NEEDED BASIS TO INHIBIT SILT FROM LEAVING THE SITE AND ENTERING THE STORM DRAIN SYSTEM. ALL EXISTING, TEMPORARY, OR PERMANENT CATCH BASINS SHALL USE ONE OF THE SEDIMENT
- 5. THE CONTRACTOR WILL BE LIABLE FOR ANY AND ALL DAMAGES TO PUBLIC AND/OR PRIVATE OWNED AND MAINTAINED ROAD CAUSED BY THE CONTRACTOR'S PAVING ACTIVITIES. AND WILL BE RESPONSIBLE FOR THE CLEANUP OF ANY MATERIAL SPILLED ON ANY PUBLIC ROAD ON THE HAUL ROUTE. ADJACENT PUBLIC ROADS SHALL BE CLEANED AT THE END OF EACH WORKING DAY.
- 6. BEST MANAGEMENT PRACTICES SHALL BE OPERABLE YEAR AROUND.
- 7. DURING THE RAINY SEASON, ALL PAVED AREAS ARE TO BE KEPT CLEAR OF EARTH MATERIAL AND DEBRIS. THE SITE IS TO BE MAINTAINED SO AS TO MINIMIZE SEDIMENT-LADEN RUNOFF TO ANY STORM DRAIN SYSTEM.
- 8. ALL EROSION CONTROL FACILITIES MUST BE INSPECTED AND REPAIRED DAILY DURING THE RAINY SEASON. ALL SLOPES SHALL BE REPAIRED AS SOON AS POSSIBLE WHEN DAMAGED.
- 9. WATER ALL ACTIVE CONSTRUCTION AREAS AT LEAST TWICE DAILY.
- 10. COVER ALL TRUCKS HAULING SOIL, SAND, AND OTHER LOOSE MATERIALS OR REQUIRE ALL TRUCKS TO MAINTAIN AT LEAST TWO FEET OF FREEBOARD.
- 11. APPLY WATER AS NEEDED, OR AS DIRECTED BY ENGINEER, OR APPLY NON-TOXIC SOIL STABILIZERS ON ALL UNPAVED ACCESS ROADS, PARKING AREAS, AND STAGING AREAS AT THE CONSTRUCTION SITE.
- 12. SWEEP (WITH WATER SWEEPERS) AS NEEDED, OR AS DIRECTED BY ENGINEER, ALL PAVED ACCESS ROADS, PARKING AREAS, AND STAGING AREAS AT THE CONSTRUCTION SITES.
- 13. SWEEP PUBLIC STREETS ADJACENT TO CONSTRUCTION SITES DAILY (WITH WATER SWEEPERS) IF VISIBLE SOIL MATERIAL IS CARRIED ONTO THE STREETS.
- 14. LIMIT TRAFFIC SPEEDS ON UNPAVED ROADS TO 15 MILES PER HOUR.
- 15. INSTALL SANDBAGS OR OTHER EROSION CONTROL MEASURES TO PREVENT SILT RUNOFF TO PUBLIC ROADWAYS.
- 16. REPLANT VEGETATION IN DISTURBED AREAS AS SOON AS POSSIBLE.
- 17. INSTALL WHEEL WASHERS FOR ALL EXITING TRUCKS OR WASH OFF THE TIRES OR TRACKS OF ALL TRUCKS AND EQUIPMENT LEAVING THE CONSTRUCTION SITE AS NEEDED. OR AS DIRECTED BY ENGINEER.
- 18. INSTALL WIND BREAKS AT THE WINDWARD SIDES OF THE CONSTRUCTION AREAS. CONTRACTOR SHALL INSTALL HDPE WINDBREAK SHADE NETTING ON CONSTRUCTION FENCING AT THE WINDWARD SIDES OF THE CONSTRUCTION
- 19. MAINTAIN EROSION CONTROL MEASURES CONTINUOUSLY YEAR ROUND DURING CONSTRUCTION ACTIVITIES. STABILIZING SHALL INCLUDE BOTH PROACTIVE MEASURES, SUCH AS THE PLACEMENT OF STRAW BALES OR COIR NETTING, AND PASSIVE MEASURES, SUCH AS MINIMIZING VEGETATION REMOVAL AND REVEGETATING DISTURBED AREAS WITH VEGETATION THAT IS COMPATIBLE WITH THE SURROUNDING ENVIRONMENT.
- 20. STORE, HANDLE, AND DISPOSE OF CONSTRUCTION MATERIALS AND WASTES PROPERLY, SO AS TO PREVENT THEIR CONTACT WITH STORMWATER.
- 21. CONTROL AND PREVENT THE DISCHARGE OF ALL POTENTIAL POLLUTANTS, INCLUDING PAVEMENT CUTTING WASTES, PAINTS, CONCRETE, PETROLEUM PRODUCTS, CHEMICALS, WASH WATER OR SEDIMENTS, AND NON-STORMWATER DISCHARGES TO STORM DRAINS AND WATERCOURSES.
- 22. USE SEDIMENT CONTROLS OR FILTRATION TO REMOVE SEDIMENT WHEN DEWATERING SITE AND OBTAINING ALL NECESSARY PERMITS.
- 23. AVOID CLEANING, FUELING, OR MAINTAINING VEHICLES ON-SITE, EXCEPT IN A DESIGNATED AREA WHERE WASH WATER IS CONTAINED AND TREATED.
- 24. DELINEATE WITH FIELD MARKERS CLEARING LIMITS, SETBACKS, AND DRAINAGE COURSES.
- 25. PROTECT ADJACENT PROPERTIES AND UNDISTURBED AREAS FROM CONSTRUCTION IMPACTS USING VEGETATIVE BUFFER STRIPS, SEDIMENT BARRIERS OR FILTERS, DIKES, MULCHING, OR OTHER MEASURES AS APPROPRIATE.
- 26. PERFORM CLEARING AND EARTH-MOVING ACTIVITIES ONLY DURING DRY
- 27. LIMIT AND TIME APPLICATIONS OF PESTICIDES AND FERTILIZERS TO PREVENT
- POLLUTED RUNOFF 28. LIMIT CONSTRUCTION ACCESS ROUTES AND STABILIZE DESIGNATED ACCESS
- 29. IF NO WORK HAS PROGRESSED FOR A PERIOD OF 6-WEEKS, FINAL DRAINAGE AND EROSION CONTROL IMPROVEMENTS SHALL BE INSTALLED IN ACCORDANCE WITH AN APPROVED WINTERIZATION PLAN.
- 30. HAUL ROADS ARE CURRENTLY NOT SHOWN ON THE PLANS. EROSION CONTROL MEASURES SHALL BE TAKEN TO MINIMIZE EROSION RELATED TO HAUL ROADS.
- 31. THE NAME, ADDRESS, AND 24 HOUR TELEPHONE NUMBER OF THE PERSON RESPONSIBLE FOR IMPLEMENTATION OF EROSION AND SEDIMENTATION CONTROL PLAN SHALL BE PROVIDED TO THE COUNTY.
- 32. SHOULD IT APPEAR THAT THE EROSION CONTROL PLAN, OR ANY OTHER MATTER THERETO, IS NOT SUFFICIENTLY DETAILED OR EXPLAINED ON THESE PLANS, THE CONTRACTOR SHALL CONTACT THE ENGINEER FOR SUCH FURTHER EXPLANATIONS AS MAY BE NECESSARY.
- 33. ALL EROSION CONTROL WORK AND MEASURES SHALL BE TO THE SATISFACTION OF AND AS DIRECTED BY THE ENGINEER.

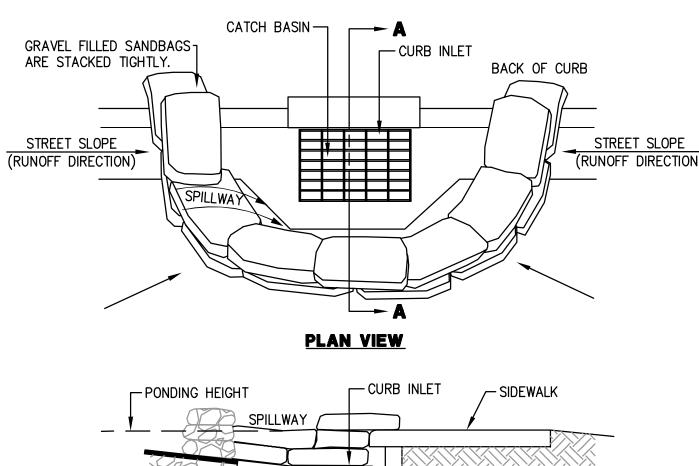

CATCH BASIN

#### **SECTION A-A**

- 1. PLACE CURB TYPE SEDIMENT BARRIERS ON GENTLY SLOPING STREETS, WHERE WATER CAN POND AND ALLOW SEDIMENT TO SEPARATE FROM RUNOFF.
- 2. BAGS OF EITHER BURLAP OR WOVEN GEOTEXTILE FABRIC, ARE FILLED WITH GRAVEL, LAYERED AND PACKED TIGHTLY. 3. LEAVE ONE BAG GAP IN THE TOP ROW TO PROVIDE A SPILLWAY OVERFLOW.
- 4. PLACE FIBER ROLLS ALONG OUTER EDGE OF GRAVEL FILLED BAGS. 5. CATCH BASIN INSERTS SHALL BE PROVIDED AT ALL CATCH BASINS YEAR ROUND, INSERTS ARE NO LONGER NEEDED
- ONCE THE ADJACENT STREET IS PAVED AND UPSTREAM SOILS ARE STABILIZED.
- 6. INSPECT BARRIERS AND REMOVE SEDIMENT AFTER EACH STORM EVENT, SEDIMENT AND GRAVEL MUST BE REMOVED FROM THE TRAVELED WAY IMMEDIATELY AND AS DIRECTED BY THE ENGINEER.

**CURB INLET SEDIMENT BARRIER - SUMP** 

## - CATCH BASIN, SEE NOTE 5. - BURLAP SACKS TO - CURB INLET OVERLAP ONTO CURB. -BACK OF CURB STREET SLOPE (RUNOFF DIRECTION) (RUNOFF DIRECTION) PILLWAY GRAVEL FILLED SANDBAGS STACKED TIGHTLY.

#### PLAN VIEW

- 1. PLACE CURB TYPE SEDIMENT BARRIERS ON GENTLY SLOPING STREETS, WHERE WATER CAN POND AND ALLOW SEDIMENT
- 2. BAGS OF EITHER BURLAP OR WOVEN GEOTEXTILE FABRIC, ARE FILLED WITH GRAVEL, LAYERED AND PACKED TIGHTLY. 3. LEAVE ONE BAG GAP IN THE TOP ROW TO PROVIDE A SPILLWAY OVERFLOW. TOP OF SPILLWAY SHALL BE LOWER THAN
- 4. PLACE FIBER ROLLS ALONG UPSTREAM EDGE OF GRAVEL FILLED BAGS. 5. CATCH BASIN INSERTS SHALL BE PROVIDED AT ALL CATCH BASINS YEAR ROUND. INSERTS ARE NO LONGER NEEDED
- ONCE THE ADJACENT STREET IS PAVED AND UPSTREAM SOILS ARE STABILIZED. 6. INSPECT BARRIERS AND REMOVE SEDIMENT AFTER EACH STORM EVENT, SEDIMENT AND GRAVEL MUST BE REMOVED FROM THE TRAVELED WAY IMMEDIATELY AND AS DIRECTED BY THE ENGINEER.

#### <u>CURB INLET SEDIMENT BARRIER - CONTINUOUS GRADE</u>



#### -WOOD STAKE FIBER ROLL -FIBER ROLL 3/4"x3/4" MAX WITH SEDIMENT FINISHED GRADE 4' SPACING RUNOFF WATER WITH SEDIMENT FINISHED -GRADE WOOD STAKE 3/4"x3/4" MAX 4' SPACING

#### **SLOPE AREA**

ENTRENCHMENT DETAIL IN

#### **ENTRENCHMENT DETAIL IN** FLAT AREA

- 1. PREPARE SLOPE BEFORE THE FIBER ROLL PROCEDURE IS STARTED. FIBER ROLL INSTALLATION REQUIRES THE PLACEMENT AND SECURE STAKING OF THE ROLL IN A
- TRENCH, 3" TO 4" DEEP, RUN PARALLEL TO THE CONTOUR. 2. INSTALL FIBER ROLL FROM THE BOTTOM OF THE SLOPE AND WORK UP. USE A STRAIGHT BAR TO DRIVE HOLES THROUGH THE FIBER ROLL AND INTO THE SOIL FOR WOODEN STAKES. DRIVE THE STAKE THROUGH THE PREPARED HOLE INTO THE SOIL.
- 3. LEAVE ONLY ONE OR TWO INCHES OF STAKE EXPOSED ABOVE FIBER ROLL. 4. INSTALL STAKES AT LEAST EVERY THREE FEET APART THROUGH THE FIBER ROLL.
- 5. ADJACENT FIBER ROLLS SHALL BE TIGHTLY ABUT. 6. RUNOFF MUST NOT BE ALLOWED TO RUN UNDER OR AROUND FIBER ROLL
- 7. INSTALL AT LOCATIONS SHOWN ON PLANS. 8. IN SLOPE AREAS SPACE FIBER ROLLS EVERY 10 VERTICAL FEET ON SLOPE.
  - FIBER ROLL

#### WIDTH AS REQUIRED TO ACCOMMODATE ANTICIPATED TRAFFIC 50' MINIMUM OR FOUR TIMES THE CIRCUMFERENCE OF THE LARGEST CONSTRUCTION VEHICLE TIRE, WHICHEVER IS GREATER - MATCH EXISTING GRADE **PLAN** 3"-6" CRUSHED **AGGREGATE** 12" MIN. -─FILTER FABRIC SECTION A-A

3"-6" CRUSHED AGGREGATE -

MINIMUM 12" THICK

- ALL CONSTRUCTION ENTRANCES SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAYS. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND, AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USE TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PUBLIC RIGHT-OF-WAYS SHALL BE REMOVED IMMEDIATELY.
- WHEELS SHALL BE CLEAN PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAYS. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH OR WATERCOURSE THROUGH USE OF INLET PROTECTION (E.G. SAND BAGS OR OTHER APPROVED METHODS).
- 3. THE MATERIAL FOR CONSTRUCTION OF THE PAD SHALL BE 3" TO 6" STONE.
- 4. THE THICKNESS OF THE PAD SHALL NOT BE LESS THAN 12".
- 5. THE WIDTH OF THE PAD SHALL NOT BE LESS THAN THE FULL WIDTH OF ALL POINTS OF INGRESS OR EGRESS. 6. THE LENGTH OF THE PAD SHALL NOT BE LESS THAN 50'.

STABILIZED CONSTRUCTION ENTRANCE/EXIT

## STEEL OR WOOD --EXTRA STRENGTH FILTER FABRIC NEEDED POST, TYP. WITHOUT WIRE MESH SUPPORT PONDING HT PONDING HT STEEL OR WOOD POST -FILTER FABRIC ATTACH SECURELY TO UPSTREAM SIDE OF POST (ACCOUNT) 9" MAX. (RECOMMENDED STORAGE HT

STANDARD DETAIL TRENCH WITH NATIVE BACKFILL

**ALTERNATE DETAIL** TRENCH WITH GRAVEL

∕— GRAVEL

#### NOTES:

INSPECT AND REPAIR FENCE AFTER EACH STORM EVENT AND REMOVE SEDIMENT WHEN NECESSARY. REMOVED SEDIMENT SHALL BE DEPOSITED TO AN AREA THAT WILL NOT CONTRIBUTE SEDIMENT OFF-SITE

APPROVED:

DATE: \_\_\_

EXPIRES

12/31/21

12/4/2020

JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS

12/4/2020

R. C. E. # 48056 / EXPIRES 12-31-2021


NICHOLAS CALDERON, DIRECTOR OF PARKS


- AND CAN BE PERMANENTLY STABILIZED AND AS DIRECTED BY THE ENGINEER.
- SILT FENCE SHALL BE PLACED ON SLOPE CONTOURS TO MAXIMIZE PONDING EFFICIENCY.


-4"x6" TRENCH WITH COMPACTED BACKFILL



ALL EROSION CONTROL MEASURES SHALL BE IN PLACE PRIOR TO ANY CONSTRUCTION WORK AND MAINTAINED DURING ALL PHASES OF CONSTRUCTION AND AS DIRECTED BY THE ENGINEER.

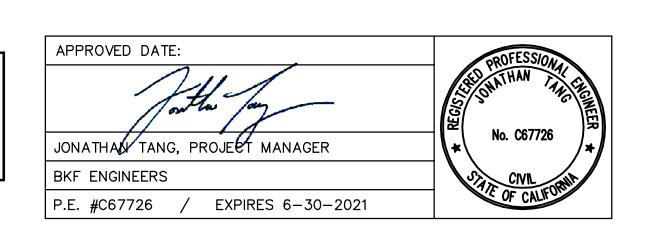

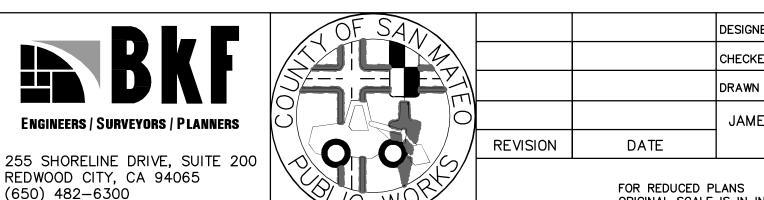

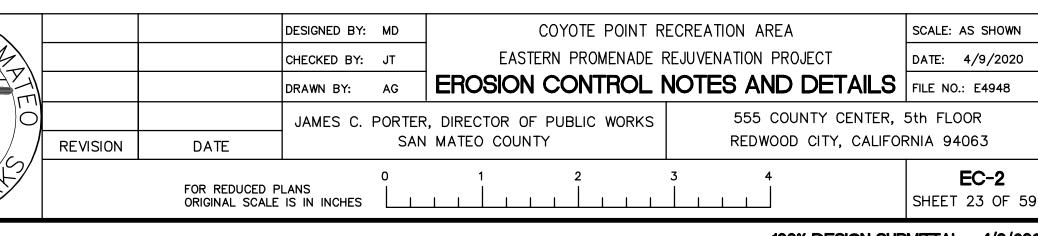

Legend: Primary Category Secondary Category

Potential Alternatives

**Targeted Constituents** Description and Purpose

Stockpile management procedures and practices are designed to reduce or eliminate air and stormwater pollution from stockpiles of soil, soil amendments, sand, paving materials such as portland cement concrete (PCC) rubble, asphalt concrete (AC), asphalt concrete rubble, aggregate base, aggregate sub base or pre-mixed aggregate, asphalt minder (so called "cold Oil and Grease mix" asphalt), and pressure treated wood. Organics

Suitable Applications Implement in all projects that stockpile soil and other loose materials.

Limitations

- Plastic sheeting as a stockpile protection is temporary and hard to manage in windy conditions. Where plastic is used, consider use of plastic tarps with nylon reinforcement which may be more durable than standard sheeting.
- Plastic sheeting can increase runoff volume due to lack of infiltration and potentially cause perimeter control failure.
- Plastic sheeting breaks down faster in sunlight.
- The use of plastic materials should be avoided when feasible and photodegradable plastics should not be used.

Implementation

Protection of stockpiles is a year-round requirement. To properly manage stockpiles:

January 2011

Construction www.casqa.org **Stockpile Management** 

 On larger sites, a minimum of 50 ft separation from concentrated flows of stormwater, drainage courses, and inlets is recommended.

 All stockpiles are required to be protected immediately if they are not scheduled to be used within 14 days.

 Protect all stockpiles from stormwater run-on using temporary perimeter sediment barriers such as compost berms (SE-13), temporary silt dikes (SE-12), fiber rolls (SE-5), silt fences (SE-1), sandbags (SE-8), gravel bags (SE-6), or biofilter bags (SE-14). Refer to the individual fact sheet for each of these controls for installation information.

WM-3

- Implement wind erosion control practices as appropriate on all stockpiled material. For specific information, see WE-1, Wind Erosion Control.
- Manage stockpiles of contaminated soil in accordance with WM-7, Contaminated Soil
- Place bagged materials on pallets and under cover.
- Ensure that stockpile coverings are installed securely to protect from wind and rain.
- Some plastic covers withstand weather and sunlight better than others. Select cover materials or methods based on anticipated duration of use.

Protection of Non-Active Stockpiles

Non-active stockpiles of the identified materials should be protected further as follows:

Soil stockpiles

■ Cover and project soil stockpiles with soil stabilization measures and a temporary perimeter sediment barrier at all times.

■ Consider temporary vegetation for topsoil piles that will be stockpiled for extended periods. Stockpiles of Portland cement concrete rubble, asphalt concrete, asphalt concrete rubble, aggregate base, or aggregate sub base

■ Provide covers and protect these stockpiles with a temporary perimeter sediment barrier at all times.

Stockpiles of "cold mix"

■ Cover cold mix stockpiles and place them on plastic sheeting (or comparable material) and surround the stockpiles with a berm all times.

Stockpiles of fly ash, stucco, hydrated lime

■ Cover stockpiles of materials that may raise the pH of runoff (i.e., basic materials) with plastic and surround the stockpiles with a berm at all times.

January 2011

Construction www.casqa.org

WM-3 - STOCKPILE MANAGEMENT

**Stockpile Management** 

Stockpiles/Storage of wood (Pressure treated with chromated copper arsenate or ammoniacal

 Cover treated wood with plastic sheeting (or comparable material) and surround with a berm at all times.

Protection of Active Stockpiles

Active stockpiles of the identified materials should be protected as follows:

prior to the onset of precipitation.

All stockpiles should be covered and protected with a temporary linear sediment barrier

- Stockpiles of "cold mix" and treated wood, and basic materials should be placed on and covered with plastic sheeting or comparable material and surrounded by a berm prior to the
- The downstream perimeter of an active stockpile should be protected with a linear sediment barrier or berm and runoff should be diverted around or away from the stockpile on the upstream perimeter.

For cost information associated with stockpile protection refer to the individual erosion or

Costs

sediment control BMP fact sheet considered for implementation (For example, refer to SE-1 Silt Fence for installation of silt fence around the perimeter of a stockpile.)

Inspection and Maintenance

- Stockpiles must be inspected in accordance with General Permit requirements for the associated project type and risk level. It is recommended that at a minimum, BMPs be inspected weekly, prior to forecasted rain events, daily during extended rain events, and after the conclusion of rain events.
- It may be necessary to inspect stockpiles covered with plastic sheeting more frequently during certain conditions (for example, high winds or extreme heat).
- Repair and/or replace perimeter controls and covers as needed to keep them functioning
- Sediment shall be removed when it reaches one-third of the barrier height.

January 2011

MAX. WATER LEVEL. PUMP OUT WHEN IT REACHES THIS LEVEL.

WATERPROOF PLASTIC MEMBRANE, MIRAFI, MCF1212, OR APPROVED

No. C67726

**SECTION A-A** 

TIRE/TRUCK TEMPORARY WASHOUT PIT

(PER CASQA STANDARD WM-8, CONCRETE WASTE MANAGEMENT, SEE RIGHT)

N.T.S.

JONATHAN TANG, PROJECT MANAGER

P.E. #C67726 / EXPIRES 6-30-2021


APPROVED DATE:

BKF ENGINEERS

Stormwater Quality Handbooks - Construction Site Best Management Practices (BMPs) Manual, State of California Department of Transportation (Caltrans), March 2003.

Construction

www.casqa.org

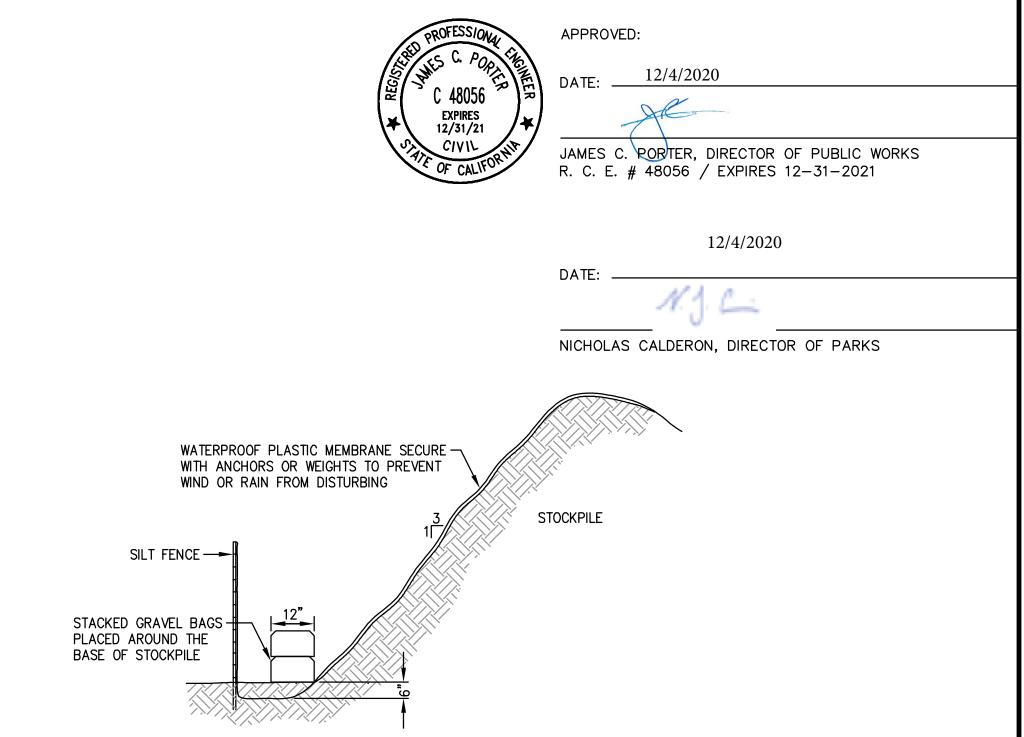

STOCKPILE COVERING


(PER CASQA STANDARD WM-3, STOCKPILE MANAGEMENT, SEE LEFT) N.T.S.


**Concrete Waste Management** 

WM-3

WM-8


Concrete Waste Management WM-8

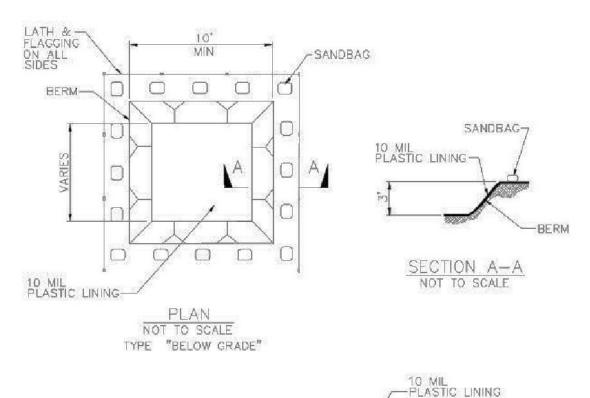

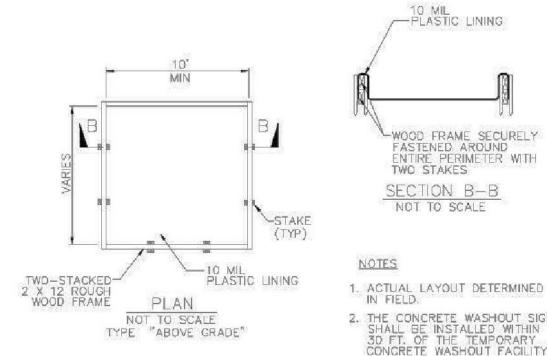

1. ACTUAL LAYOUT DETERMINED THE CONCRETE WASHOUT SIGN SHALL BE INSTALLED WITHIN 30 FT. OF THE TEMPORARY CONCRETE WASHOUT FACILITY. November 2009 6 of 7 California Stormwater BMP Handbook Construction

www.casqa.org

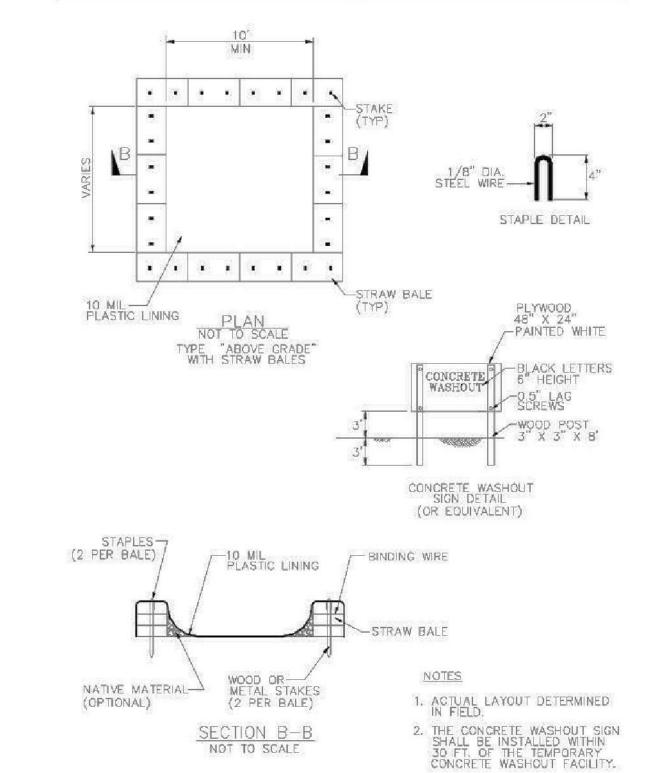


## WM-8 - CONCRETE WASTE MANAGEMENT

FOR REDUCED PLANS ORIGINAL SCALE IS IN INCHES

November 2009

SAN MATEO COUNTY





N.T.S. DESIGNED BY: JT CHECKED BY: JT JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS REVISION DATE

COYOTE POINT RECREATION AREA EASTERN PROMENADE REJUVENATION PROJECT CASQA STANDARD DETAILS

California Stormwater BMP Handbook

Construction

www.casqa.org

SCALE: AS SHOWN DATE: 4/9/2020 FILE NO.: E4948 555 COUNTY CENTER, 5th FLOOR REDWOOD CITY, CALIFORNIA 94063


> SHEET 24 OF 59 100% DESIGN SUBMITTAL - 4/9/2020

EC-3

# Construction Best Management Practices (BMPs)

Construction projects are required to implement the stormwater best management practices (BMP) on this page, as they apply to your project, all year long.

# **Materials & Waste Management**

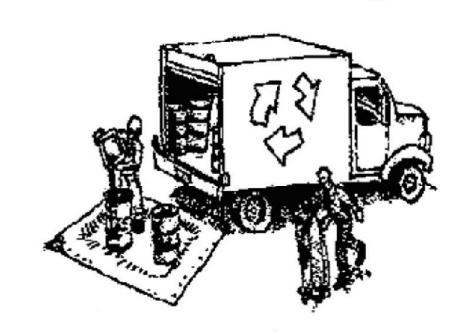

#### **Non-Hazardous Materials**

- ☐ Berm and cover stockpiles of sand, dirt or other construction material with tarps when rain is forecast or if not actively being used within 14 days.
- ☐ Use (but don't overuse) reclaimed water for dust control.

#### **Hazardous Materials**

- ☐ Label all hazardous materials and hazardous wastes (such as pesticides, paints, thinners, solvents, fuel, oil, and antifreeze) in accordance with city, county, state and federal regulations.
- ☐ Store hazardous materials and wastes in water tight containers, store in appropriate secondary containment, and cover them at the end of every work day or during wet weather or when rain is forecast.
- ☐ Follow manufacturer's application instructions for hazardous materials and be careful not to use more than necessary. Do not apply chemicals outdoors when rain is forecast within 24 hours.
- ☐ Arrange for appropriate disposal of all hazardous wastes.

#### Waste Management

- ☐ Cover waste disposal containers securely with tarps at the end of every work day and during wet weather.
- ☐ Check waste disposal containers frequently for leaks and to make sure they are not overfilled. Never hose down a dumpster on the construction site.
- ☐ Clean or replace portable toilets, and inspect them frequently for leaks and spills.
- ☐ Dispose of all wastes and debris properly. Recycle materials and wastes that can be recycled (such as asphalt, concrete, aggregate base materials, wood, gyp board, pipe, etc.)
- ☐ Dispose of liquid residues from paints, thinners, solvents, glues, and cleaning fluids as hazardous waste.

#### **Construction Entrances and Perimeter**

- ☐ Establish and maintain effective perimeter controls and stabilize all construction entrances and exits to sufficiently control erosion and sediment discharges from site and tracking off site.
- ☐ Sweep or vacuum any street tracking immediately and secure sediment source to prevent further tracking. Never hose down streets to clean up tracking.

### **Equipment Management & Spill Control**




#### Maintenance and Parking

- ☐ Designate an area, fitted with appropriate BMPs, for vehicle and equipment parking and storage.
- ☐ Perform major maintenance, repair jobs, and vehicle and equipment washing off site.
- ☐ If refueling or vehicle maintenance must be done onsite, work in a bermed area away from storm drains and over a drip pan or drop cloths big enough to collect fluids. Recycle or dispose of fluids as hazardous waste.
- ☐ If vehicle or equipment cleaning must be done onsite, clean with water only in a bermed area that will not allow rinse water to run into gutters, streets, storm drains, or surface waters.
- ☐ Do not clean vehicle or equipment onsite using soaps, solvents, degreasers, or steam cleaning equipment.

#### **Spill Prevention and Control**

- ☐ Keep spill cleanup materials (e.g., rags, absorbents and cat litter) available at the construction site at all times.
- ☐ Inspect vehicles and equipment frequently for and repair leaks promptly. Use drip pans to catch leaks until repairs are made.
- ☐ Clean up spills or leaks immediately and dispose of cleanup materials properly.
- ☐ Do not hose down surfaces where fluids have spilled. Use dry cleanup methods (absorbent materials, cat litter, and/or rags).
- ☐ Sweep up spilled dry materials immediately. Do not try to wash them away with water, or bury them.
- ☐ Clean up spills on dirt areas by digging up and properly disposing of contaminated soil.
- ☐ Report significant spills immediately. You are required by law to report all significant releases of hazardous materials, including oil. To report a spill: 1) Dial 911 or your local emergency response number, 2) Call the Governor's Office of Emergency Services Warning Center, (800) 852-7550 (24 hours).

## **Earthmoving**

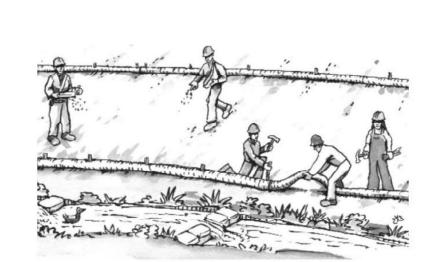

- ☐ Schedule grading and excavation work during dry weather.
- ☐ Stabilize all denuded areas, install and maintain temporary erosion controls (such as erosion control fabric or bonded fiber matrix) until vegetation is established.
- ☐ Remove existing vegetation only when absolutely necessary, and seed or plant vegetation for erosion control on slopes or where construction is not immediately planned.
- ☐ Prevent sediment from migrating offsite and protect storm drain inlets, gutters, ditches, and drainage courses by installing and maintaining appropriate BMPs, such as fiber rolls, silt fences, sediment basins, gravel bags, berms, etc.
- ☐ Keep excavated soil on site and transfer it to dump trucks on site, not in the streets.

#### **Contaminated Soils**

- ☐ If any of the following conditions are observed, test for contamination and contact the Regional Water Quality Control Board:
- Unusual soil conditions, discoloration, or odor.
- Abandoned underground tanks.
- Abandoned wells
- Buried barrels, debris, or trash.

## Paving/Asphalt Work




- ☐ Avoid paving and seal coating in wet weather or when rain is forecast, to prevent materials that have not cured from contacting stormwater runoff.
- ☐ Cover storm drain inlets and manholes when applying seal coat, tack coat, slurry seal, fog seal, etc.
- ☐ Collect and recycle or appropriately dispose of excess abrasive gravel or sand. Do NOT sweep or wash it into gutters.
- ☐ Do not use water to wash down fresh asphalt concrete pavement.

#### Sawcutting & Asphalt/Concrete Removal


- ☐ Protect nearby storm drain inlets when saw cutting. Use filter fabric, catch basin inlet filters, or gravel bags to keep slurry out of the storm drain system.
- ☐ Shovel, abosorb, or vacuum saw-cut slurry and dispose of all waste as soon as you are finished in one location or at the end of each work day (whichever is sooner!)
- ☐ If sawcut slurry enters a catch basin, clean it up immediately.

#### Concrete, Grout & Mortar **Application**

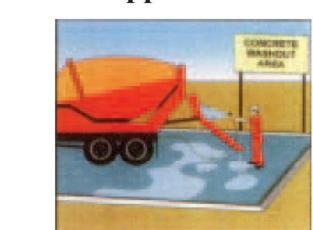

- ☐ Store concrete, grout, and mortar away rain, runoff, and wind.
- offsite or in a designated washout area, where the water will flow into a temporary waste pit, and in a manner that will prevent leaching into the underlying soil or onto surrounding areas. Let concrete harden and dispose of as garbage.
- prevent washwater from entering storm drains. Block any inlets and vacuum gutters, hose washwater onto dirt areas, or drain onto a bermed surface to be pumped and disposed of properly.

## Landscaping

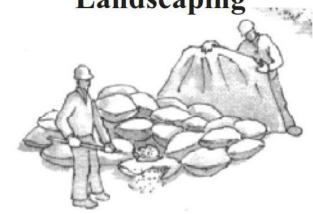

☐ Discontinue application of any erodible landscape material within 2 days before a forecast rain event or during wet weather.

**Painting & Paint Removal** 

Painting Cleanup and Removal

drain, or stream.

☐ Never clean brushes or rinse paint

containers into a street, gutter, storm

☐ For water-based paints, paint out brushes to the extent possible, and rinse into a drain that goes to the sanitary sewer. Never pour paint down a storm drain.

☐ For oil-based paints, paint out brushes to

the extent possible and clean with thinner

or solvent in a proper container. Filter and

reuse thinners and solvents. Dispose of

☐ Paint chips and dust from non-hazardous

dry stripping and sand blasting may be

☐ Chemical paint stripping residue and chips

swept up or collected in plastic drop

and dust from marine paints or paints

containing lead, mercury, or tributyltin

must be disposed of as hazardous waste.

**Dewatering** 

Lead based paint removal requires a state-

cloths and disposed of as trash.

certified contractor.


excess liquids as hazardous waste.



- from storm drains or waterways, and on pallets under cover to protect them from
- ☐ Wash out concrete equipment/trucks
- ☐ When washing exposed aggregate,

- ☐ Protect stockpiled landscaping materials from wind and rain by storing them under tarps all year-round.
- ☐ Stack bagged material on pallets and under cover.



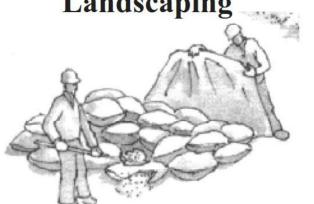

- be properly managed and disposed. When possible send dewatering discharge to landscaped area or sanitary sewer. If discharging to the sanitary sewer call your local wastewater treatment plant. ☐ Divert run-on water from offsite away
  - from all disturbed areas.

☐ Discharges of groundwater or captured

runoff from dewatering operations must


- ☐ When dewatering, notify and obtain approval from the local municipality before discharging water to a street gutter or storm drain. Filtration or diversion through a basin, tank, or sediment trap may be required.
- ☐ In areas of known or suspected contamination, call your local agency to determine whether the ground water must be tested. Pumped groundwater may need to be collected and hauled off-site for treatment and proper disposal.

# Storm drain polluters may be liable for fines of up to \$10,000 per day!





(650) 482-6300



	REVISION	DA
2/		

DESIGNED BY: MD COYOTE POINT RECREATION AREA CHECKED BY: JT JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS SAN MATEO COUNTY

EASTERN PROMENADE REJUVENATION PROJECT CONSTRUCTION BEST MANAGEMENT PRACTICES | FILE NO.: E4948

APPROVED:

12/4/2020

R. C. E. # 48056 / EXPIRES 12-31-2021

NICHOLAS CALDERON, DIRECTOR OF PARKS

12/4/2020


555 COUNTY CENTER, 5th FLOOR REDWOOD CITY, CALIFORNIA 94063 EC-4


SHEET 25 OF 59

SCALE: NONE

DATE: 4/9/2020

100% DESIGN SUBMITTAL - 4/9/2020

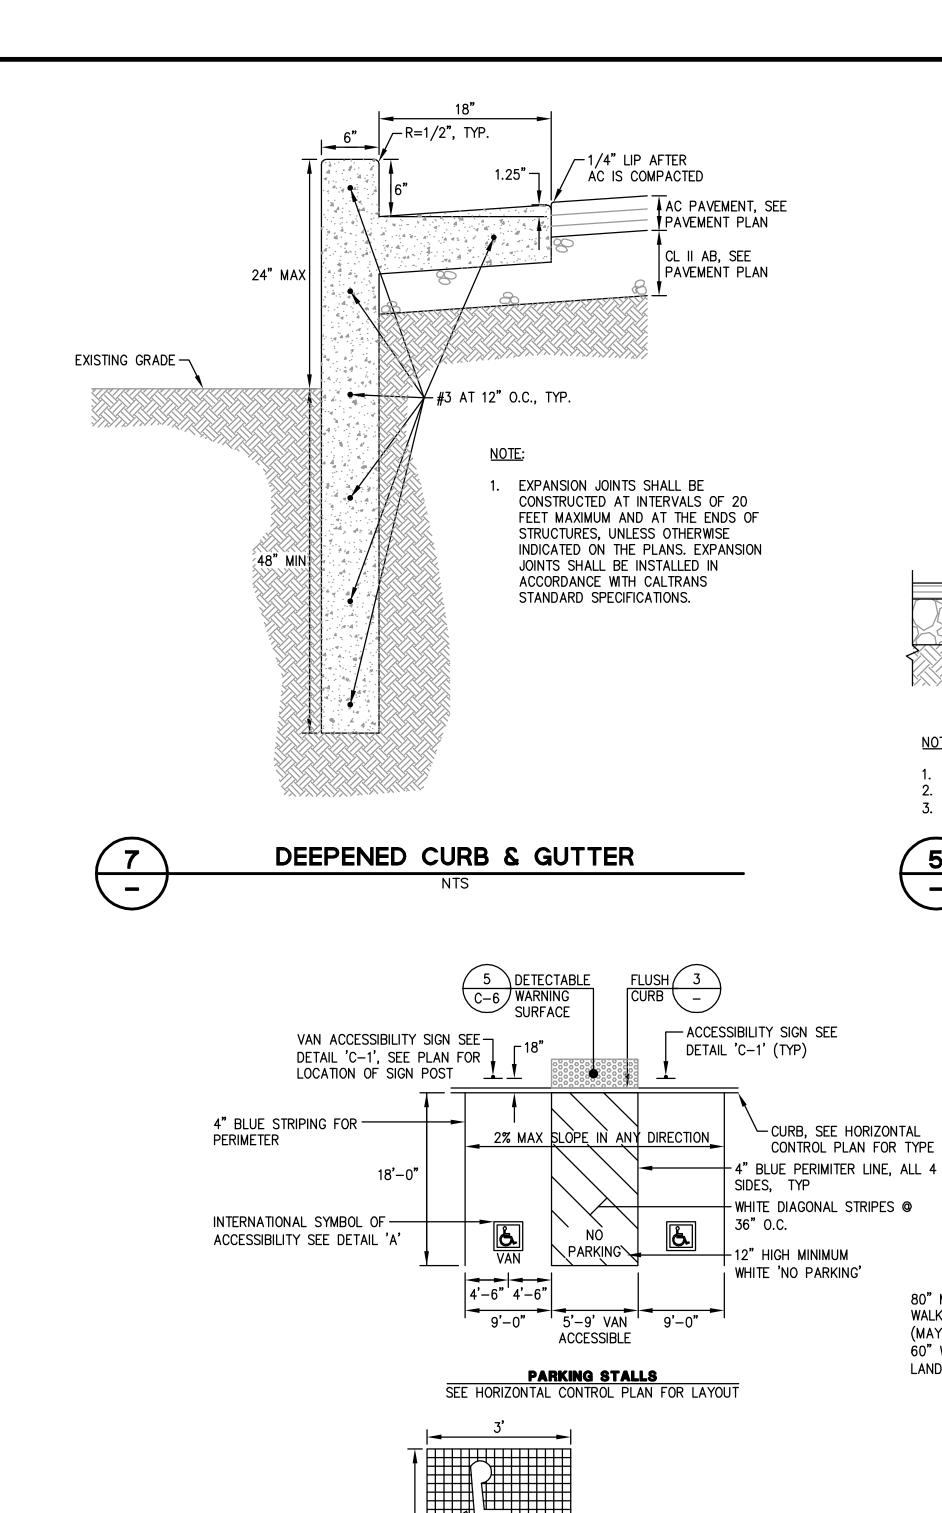

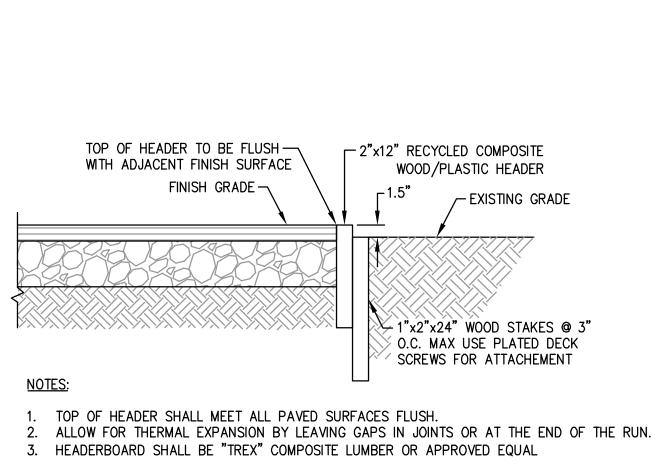

WOOD HEADER BOARD

**PARKING** 

ONLY

VAN ACCESSIBLE

MINIMUM FINE \$250

12" DIA

**ACCESSIBILITY SIGN** 

DETAIL 'C-1'

| 6" | MIN

6" MIN

80" MIN TO TOP OF

(MAY BE REDUCED TO

60" WHEN LOCATED IN

WALKING SURFACE

LANDSCAPE AREA)


- WHITE COLORED SYMBOL ON BLUE


PAINTED IN EACH ACCESSIBLE


PARKING STALL

DISPLAY CONDITION

BACKGROUND WITH WHITE BORDER

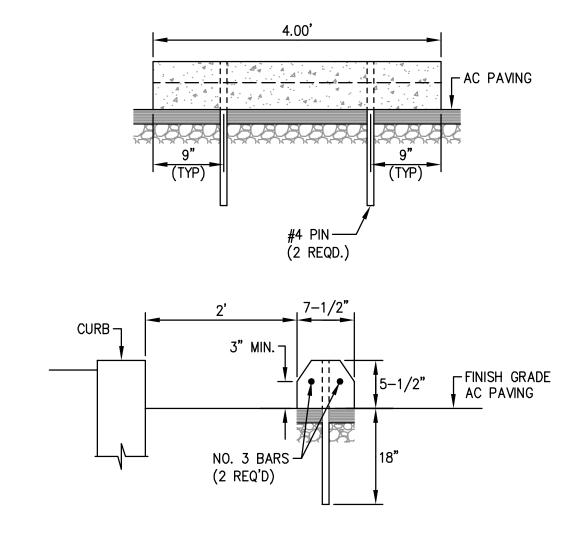



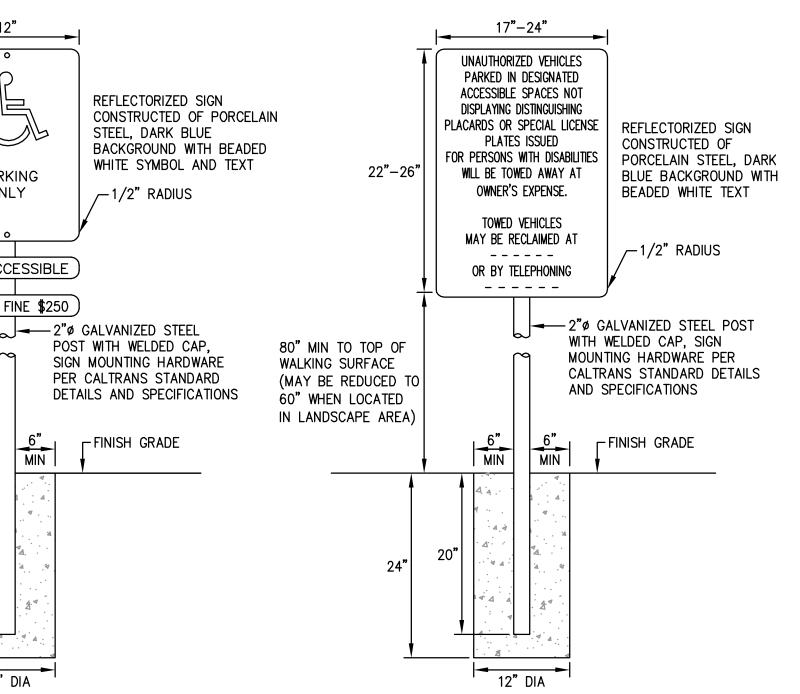

ACCESSIBILITY TOW AWAY SIGN

DETAIL 'C-2'




- 1. EACH PARKING SPACE RESERVED FOR PERSONS WITH DISABILITIES SHALL BE IDENTIFIED BY A REFLECTORIZED SIGN PERMANENTLY POSTED IMMEDIATELY ADJACENT TO AND VISIBLE FROM EACH STALL OR SPACE, CONSISTING OF A PROFILE VIEW OF A WHEELCHAIR OCCUPANT IN WHITE ON DARK BLUE BACKGROUND. THE SIGN SHALL NOT BE SMALLER THAN 70 SQUARE INCHES IN AREA AND WHEN IN A PATH OF TRAVEL, SHALL BE POSTED AT A MINIMUM HEIGHT OF 80 INCHES FROM THE BOTTOM OF THE SIGN TO THE PARKING SPACE FINISHED GRADE. SIGNS MAY ALSO BE CENTERED ON THE WALL AT THE INTERIOR OF THE PARKING SPACE AT A MINIMUM HEIGHT OF 60 INCHES FROM THE PARKING SPACE FINISHED GRADE, GROUND, OR SIDEWALK.
- 2. AN ADDITIONAL SIGN SHALL ALSO BE POSTED IN A CONSPICUOUS PLACE, AT EACH ENTRANCE TO THE OFF- STREET, PARKING FACILITY, OR IMMEDIATELY ADJACENT TO AND VISIBLE FROM EACH STALL. THE SIGN SHALL NOT BE LESS THAN 17 INCHES X 22 INCHES IN SIZE, LETTERING NOT LESS THAN 1 INCH IN HEIGHT, WHICH CLEARLY AND CONSPICUOUSLY STATES THE FOLLOWING:

"UNAUTHORIZED VEHICLES PARKED IN DESIGNATED ACCESSIBLE SPACES NOT DISPLAYING DISTINGUISHING PLACARDS OR SPECIAL LICENSE PLATES ISSUED FOR PERSONS WITH DISABILITIES WILL BE TOWED AWAY AT OWNER'S EXPENSE. TOWED VEHICLES MAY BE RECLAIMED AT - - - - OR BY TELEPHONING - -

CONTRACTOR SHALL COORDINATE INFORMATION AND LOCATION OF SIGN WITH COUNTY OF SAN MATEO.


- - -.

3. VAN STALLS SHALL BE DESIGNATED BY AN ADDITIONAL SIGN STATING "VAN ACCESSIBLE" MOUNTED BELOW THE REFLECTORIZED SIGN.

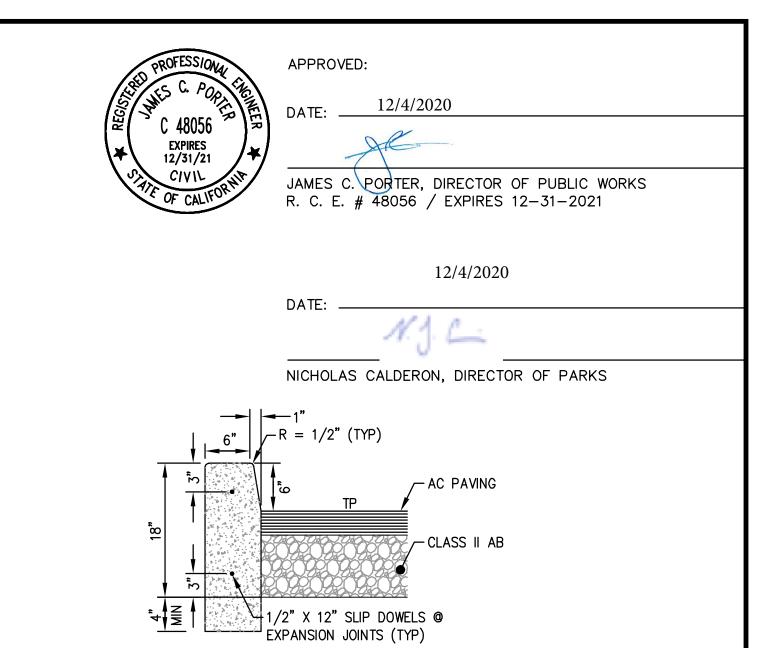


#### NOTE:

- 1. EXPANSION JOINTS SHALL BE CONSTRUCTED AT INTERVALS OF 20 FEET MAXIMUM AND AT THE ENDS OF STRUCTURES, UNLESS OTHERWISE INDICATED ON THE PLANS. EXPANSION JOINTS SHALL BE INSTALLED IN ACCORDANCE WITH CALTRANS STANDARD SPECIFICATIONS.
- 2. CONCRETE CURBS SHALL BE EMBEDDED AT LEAST 4 INCHES BELOW SOIL SUBGRADE (BELOW THE BOTTOM OF THE AGGREGATE BASE SECTION) IN ANY AREAS WHERE IRRIGATED LANDSCAPE AREAS ARE ADJACENT TO AC PAVEMENTS.

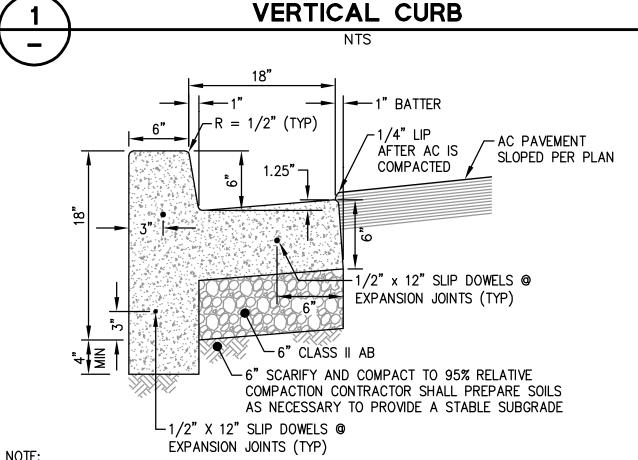


- 1. EXPANSION JOINTS SHALL BE CONSTRUCTED AT INTERVALS OF 20 FEET MAXIMUM AND AT THE ENDS OF STRUCTURES. UNLESS OTHERWISE INDICATED ON THE PLANS. EXPANSION JOINTS SHALL BE INSTALLED IN ACCORDANCE WITH CALTRANS STANDARD SPECIFICATIONS.
- 2. CONCRETE CURBS SHALL BE EMBEDDED AT LEAST 4 INCHES BELOW SOIL SUBGRADE (BELOW THE BOTTOM OF THE AGGREGATE BASE SECTION) IN ANY AREAS WHERE IRRIGATED LANDSCAPE AREAS ARE ADJACENT TO AC PAVEMENTS.

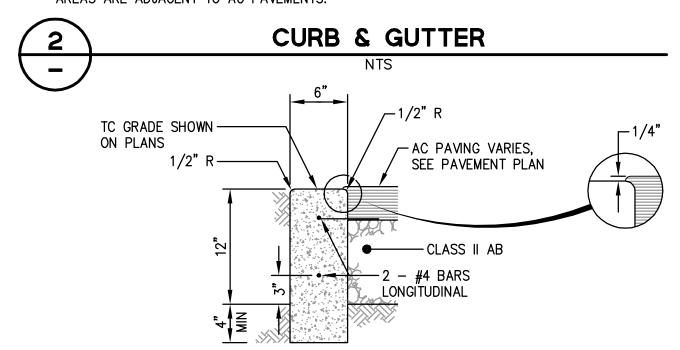

#### NOTE:

- 1. EXPANSION JOINTS SHALL BE CONSTRUCTED AT INTERVALS OF 20 FEET MAXIMUM AND AT THE ENDS OF STRUCTURES, UNLESS OTHERWISE INDICATED ON THE PLANS. EXPANSION JOINTS SHALL BE INSTALLED IN ACCORDANCE WITH CALTRANS STANDARD SPECIFICATIONS.
- 2. CONCRETE CURBS SHALL BE EMBEDDED AT LEAST 4 INCHES BELOW SOIL SUBGRADE (BELOW THE BOTTOM OF THE AGGREGATE BASE SECTION) IN ANY AREAS WHERE IRRIGATED LANDSCAPE AREAS ARE ADJACENT TO AC PAVEMENTS.



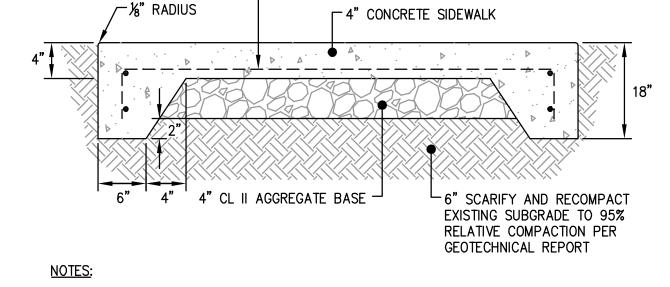

#4 REBAR @ 18" O.C. BOTH WAYS

**PROPORTIONS** 

INTERNATIONAL SYMBOL OF ACCESSIBILITY


DETAIL 'A'

- PROVIDE EXPANSION JOINT AT ALL VERTICAL SURFACES AND BACKS OF CURB. SEE LANDSCAPE PLANS FOR SCORING AND EXPANSION JOINT LAYOUT. 3. TURNED DOWN EDGE TO BE USED ALONG SIDEWALK EDGE ADJACENT TO LANDSCAPE.
- SIDEWALK WITH TURNED DOWN EDGE










			DESIGNED BY: M	MD		CC	OYOTE	POINT	RECR	EATION	AREA	SCALE:	AS SHOWN
			CHECKED BY: J	JT		EASTERN PROMENADE REJUVENATION PROJECT						DATE:	4/9/2020
			DRAWN BY: A	AG		C	SNC	TRUC		N DET	TAILS	FILE N	O.: E4948
			JAMES C. PC	ORTER,	DIRECTO	R OF P	UBLIC	WORKS	5	55	5 COUNTY CENTER,	5th FL	OOR
	REVISION	DATE		SAN	MATEO C	COUNTY				REI	DWOOD CITY, CALIFO	RNIA 9	4063
?/ [		FOR REDUCED P ORIGINAL SCALE		)	1		2 	1 1	3 		4	SHEE	<b>C-1</b> T 26 OF


100% DESIGN SUBMITTAL - 4/9/2020





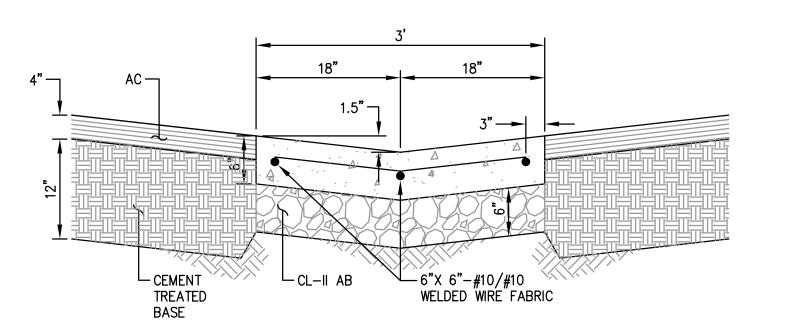




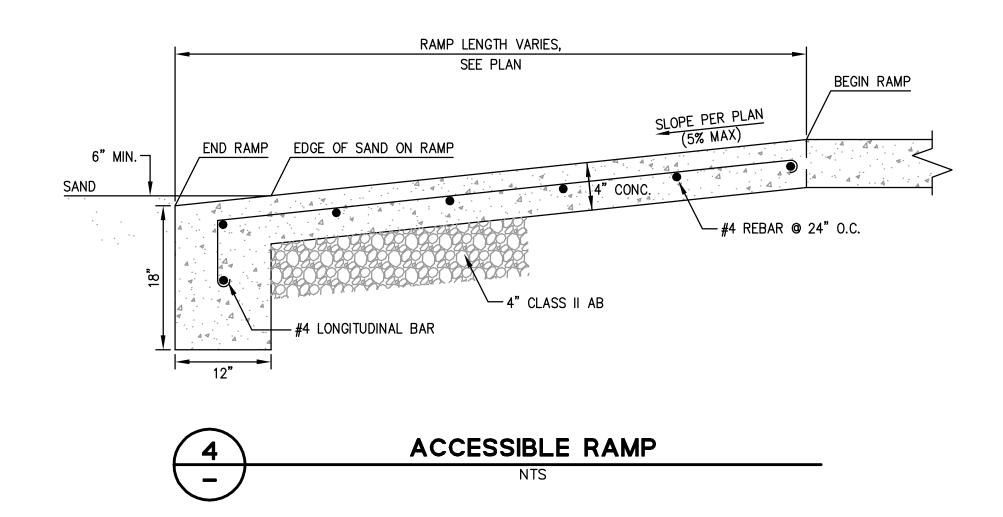


**CURB RAMP** 

#### NOTES:

- 1. A "CURB RAMP" IS DEFINED AS THE ENTIRE CONCRETE SURFACE AREA WHICH INCLUDES THE RAMP AND THE FLARED SIDES. THE "RAMP" IS DEFINED AS THE 4-FOOT WIDE MINIMUM CENTER PORTION INCLUDING THE DETECTABLE SURFACE, AND SHALL LIE IN A SLOPED PLANE OF 8.33% (1:12) MAXIMUM AND CROSS SLOPE NOT TO EXCEED 1.5%. THE "FLARED SIDE" IS DEFINED AS THE AREA ON EITHER SIDE OF THE RAMP AND SHALL LIE ON A SLOPED PLANE OF 9% MAXIMUM MEASURED ALONG THE CURB. THE CURB RAMP SURFACES SHALL HAVE A SURFACE FLATNESS TOLERANCE OF 1/4" PER 10-FOOT STRAIGHT EDGE MAXIMUM.
- 2. WHEN VERTICAL OBSTRUCTIONS ARE PRESENT NEAR THE CURB AT THE END OF THE FLARED SIDE, OR WHEN THE CURB RAMP IS DIAGONAL TO THE CURB THAT WILL RESULT IN AN EXTREMELY LONG FLARED SIDE SURFACE, THEN THE AFFECTED FLARED SIDE MAY BE CUT AND TERMINATED PERPENDICULAR TO THE CURB, PROVIDED THAT THE REQUIRED SLOPE IS ACHIEVED ON EACH OF THE RESULTING PLANES.
- 3. A LEVEL LANDING OF 4'-2" MINIMUM DEPTH, 1.5% MAXIMUM CROSS SLOPE, SHALL BE PROVIDED AT THE LOWER END OF THE RAMP AND OVER THE FULL WIDTH OF THE RAMP TO ALLOW SAFE EGRESS. THE ALGEBRAIC SUM OF THE OPPOSING SLOPES BETWEEN TWO ADJACENT SURFACES SHALL NOT EXCEED
- 4. THE CURB RAMP SHALL BE BOUNDED BY A 12-INCH WIDE GROOVED BORDER WITH A 1/4-INCH WIDE BY 1/4-INCH DEEP GROOVES SCORED 3/4-INCH APART EXCEPT ON THE CURB SECTION.
- 5. THE BOTTOM OF THE RAMP SHALL BE FLUSH WITH THE LOWER LANDING (NO HALF-INCH LIP).
- 6. A LEVEL LANDING 4'-2" DEEP MINIMUM, 1.5% MAXIMUM CROSS SLOPE IN EACH DIRECTION, SHALL BE PROVIDED AT THE UPPER END OF EACH CURB RAMP TO ALLOW SAFE EGRESS FROM THE RAMP SURFACE. THE WIDTH OF THE LEVEL LANDING SHALL BE AT LEAST AS WIDE AS THE WIDTH OF THE RAMP.
- 7. NO NEW VERTICAL OBSTRUCTIONS MAY BE LOCATED IN THE CURB RAMP OR GROOVED BORDER.
- 8. NEW UTILITY BOXES SHALL NOT BE PLACED WITHIN THE GROOVED BORDER OR THE RAMP.
- 9. THE SURFACE OF THE CURB RAMP AND DETECTABLE SURFACE MATERIAL SHALL BE STABLE, FIRM AND SLIP RESISTANT. THE CONCRETE CURB RAMP SURFACE SHALL BE BROOM FINISHED TRANSVERSE TO THE AXIS OF THE RAMP AND SHALL BE SLIGHTLY ROUGHER THAN THE FINISH ON THE ADJACENT SIDEWALK SURFACE. ALL CURB RAMP SURFACES SHALL BE SLIP RESISTANT, INCLUDING CONCRETE OR OTHER APPROVED SURFACE MATERIALS, AND THE DETECTABLE WARNING MATERIAL MEASURED AT THE TOP OF DOMES SURFACES AND THE SURFACE BETWEEN DOMES. SLIP RESISTANCE SHALL BE MEASURED IN ACCORDANCE WITH ASTM C1028 AND SHALL ACHIEVE A STATIC COEFFICIENT OF FRICTION OF 0.8 OR GREATER, WET OR
- 10. THE DEPTH OF THE COMBINED CONCRETE CURB AND GUTTER SHALL BE EQUAL TO THE DEPTH OF THE EXISTING PAVEMENT STRUCTURAL SECTION OR 6 INCHES, WHICHEVER IS GREATER.
- 11. THE RAMP CENTER LINE AND PATH OF TRAVEL MUST BE PARALLEL TO THE CROSSWALK. THE FULL WIDTH OF THE RAMP SHALL LIE WITHIN THE CROSSWALK AREA. IT IS DESIRABLE THAT THE LOCATION OF THE RAMP BE AS CLOSE AS POSSIBLE TO THE CENTER OF THE CROSSWALK.

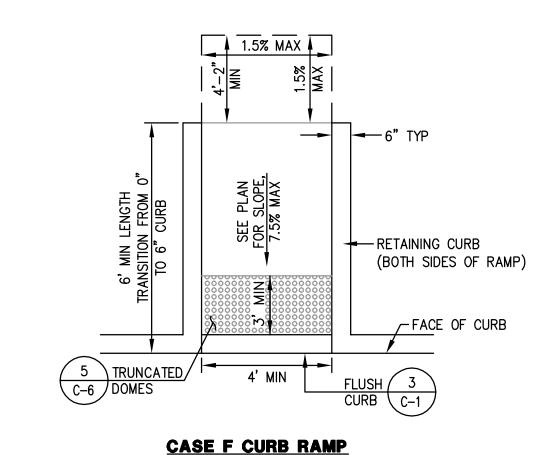





CASE F SIDE ELEVATION


# APPROVED DATE:





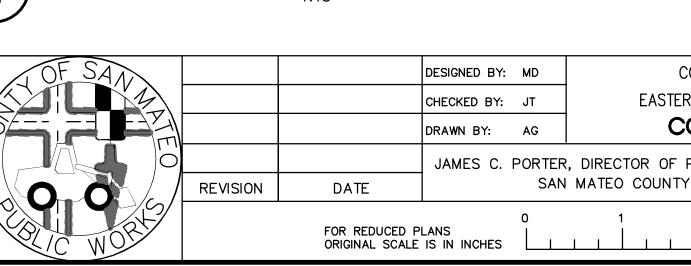

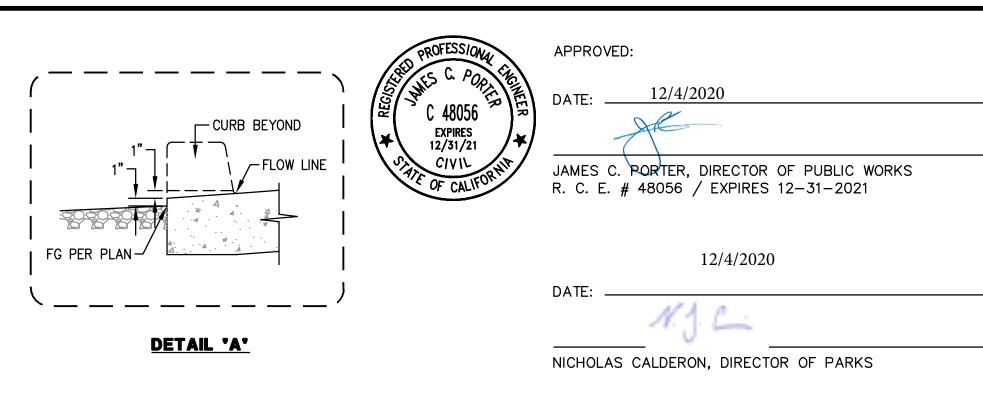

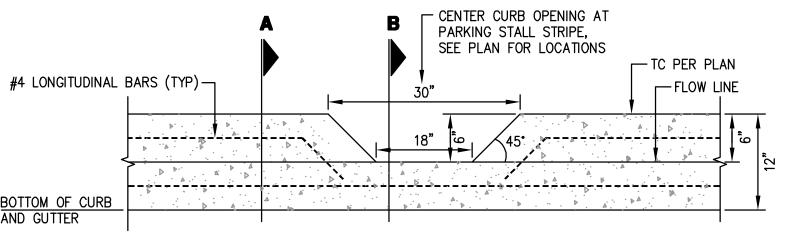

**FRONT VIEW** 

SECTION B

CURB BEYOND

- AC PAVING


SEE DETAIL "A"-


FG PER PLAN-

AC PAVING


SECTION A




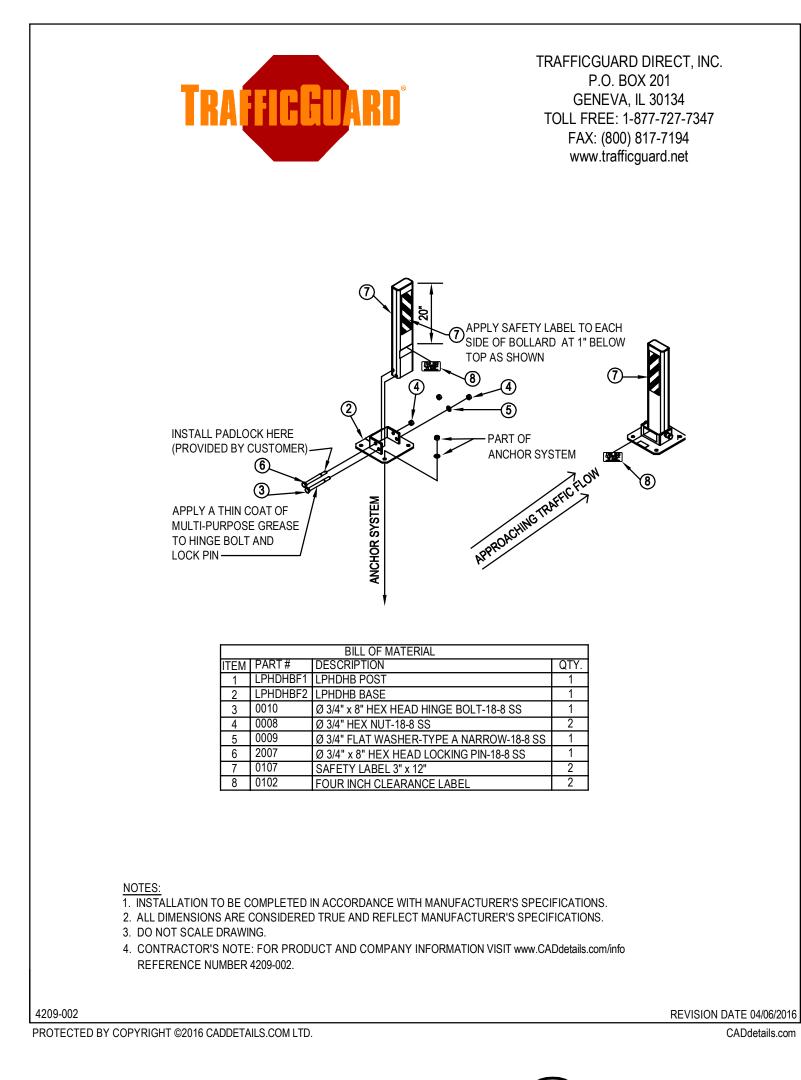


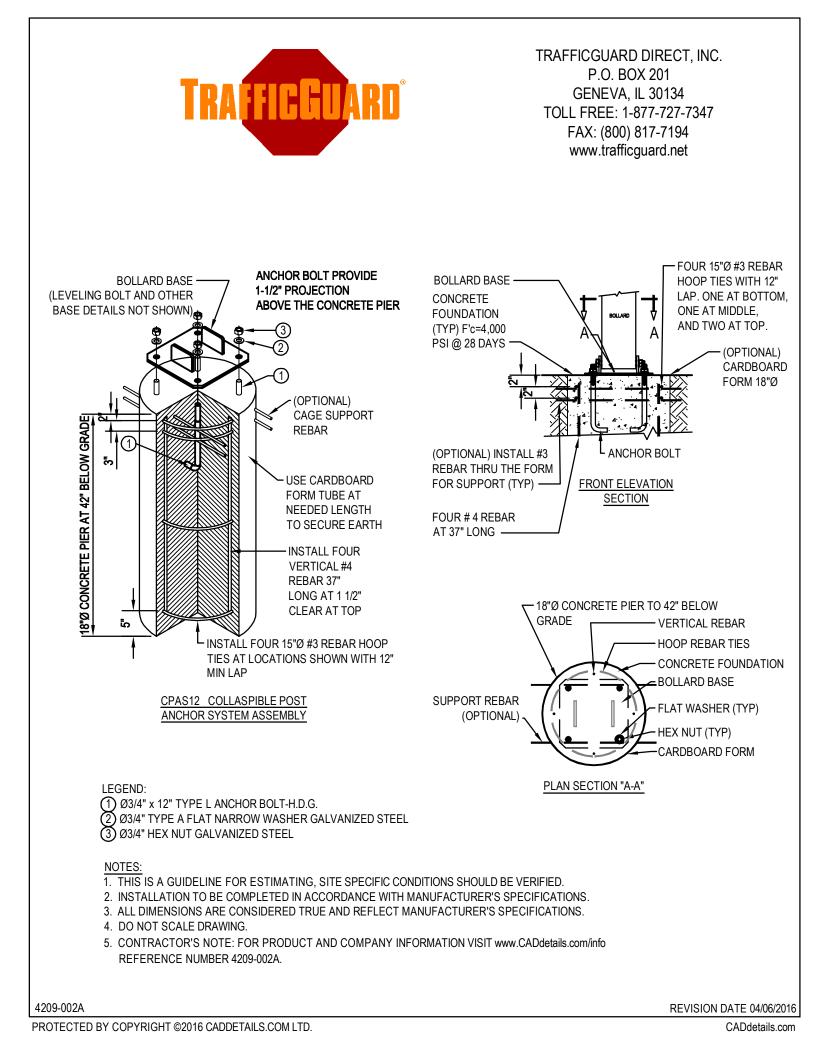




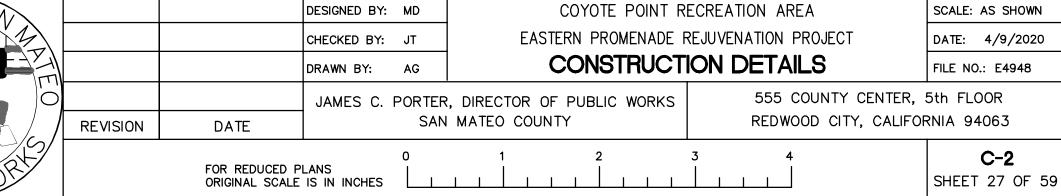

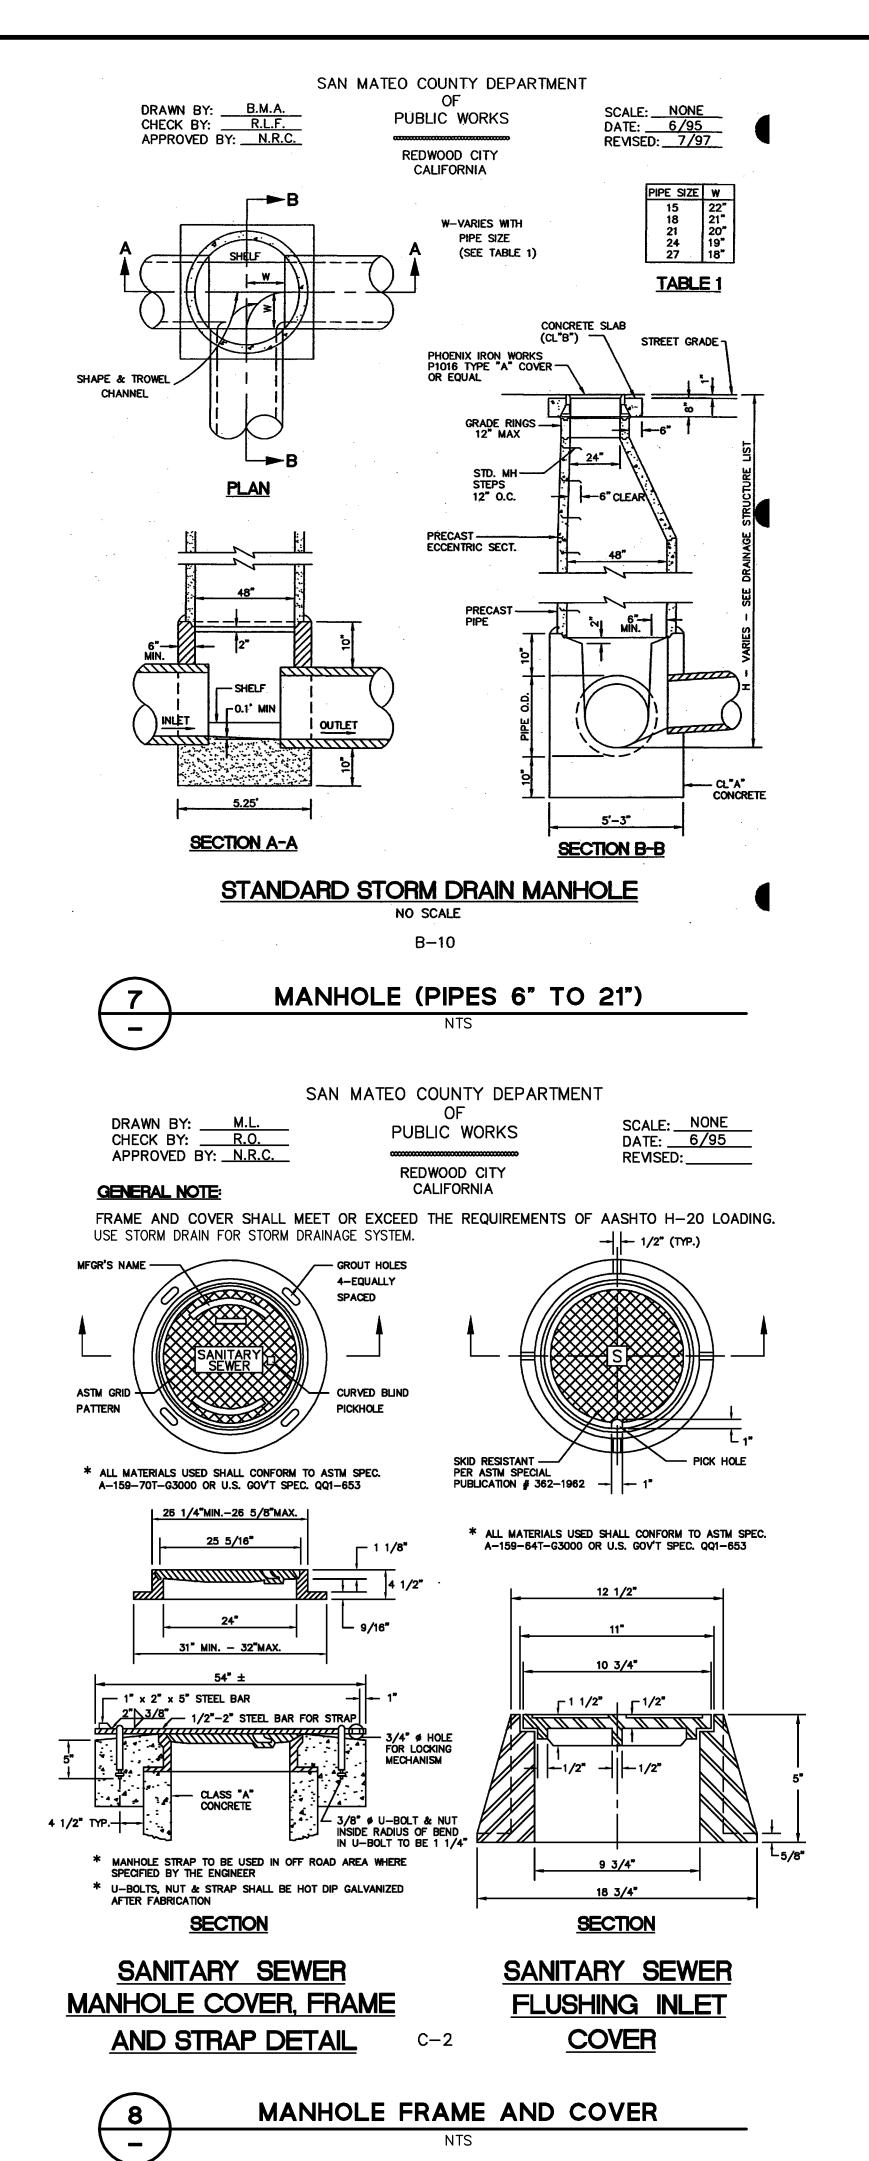

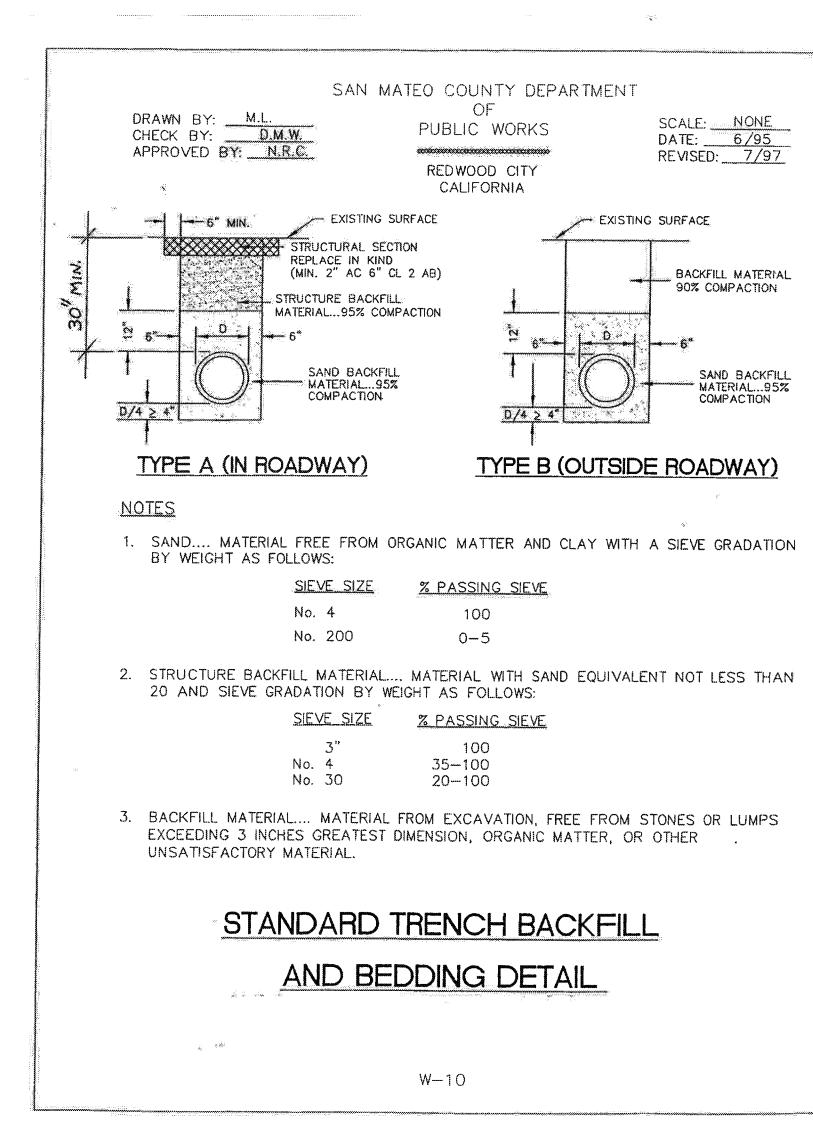


SAN MATEO COUNTY STANDARD TRENCH BACKFILL & BEDDING DETAIL

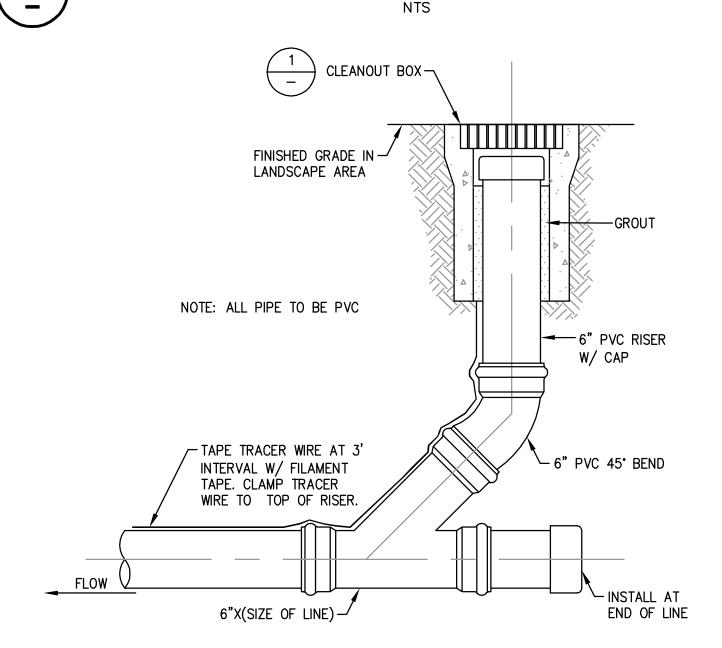

STORM DRAIN AND SANITARY SEWER **END-OF-LINE CLEANOUT** 




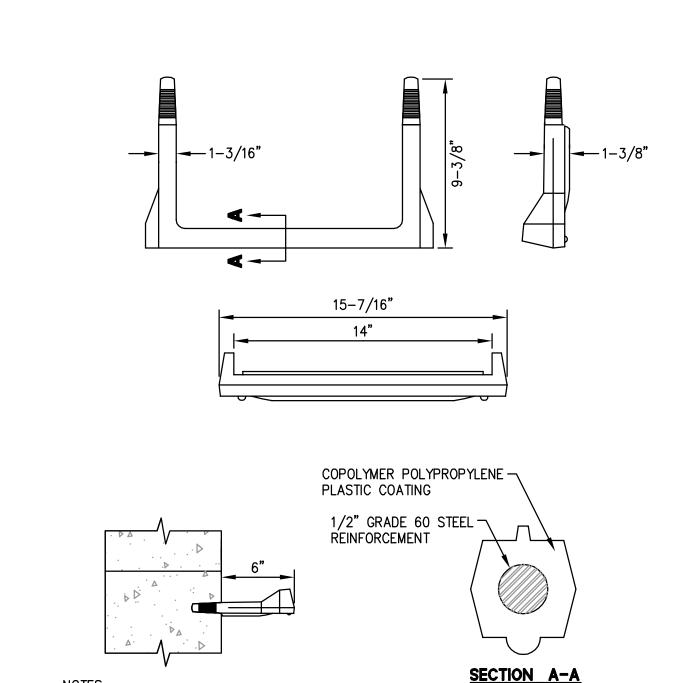

STEPS TO BE CAST IN PLACE DURING MANUFACTURE OF PRECAST PIPE RINGS. 2. INSERT STEPS THROUGH FORMWORK PRIOR TO POURING CAST-IN-PLACE STORM DRAIN AND SANITARY SEWER STRUCTURES.

3. STEPS ARE AS MANUFACTURED BY M.A. INDUSTRIES, INC. OR EQUAL




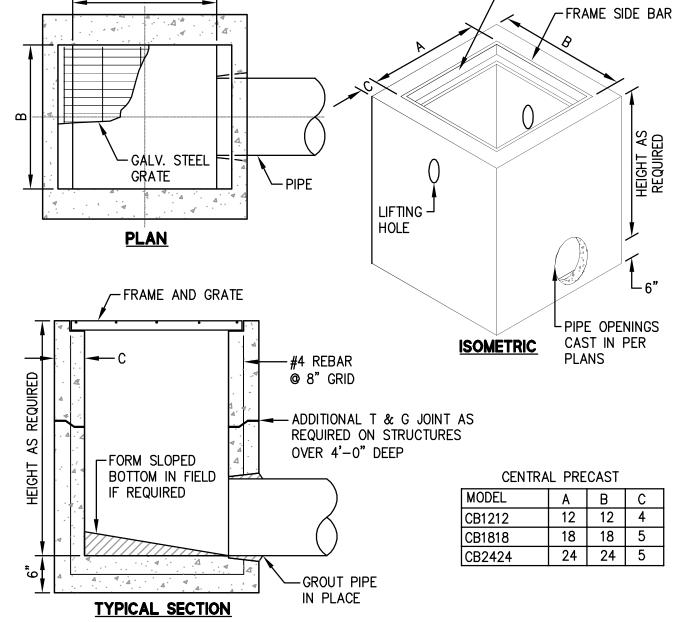



DROP INLET SHALL BE CENTRAL PRECAST OR APPROVED EQUAL. AN ENGINEERED PRECAST DROP INLET UNIT CAN BE USED AS AN ALTERNATE.

3. DROP INLETS LOCATED IN TRAFFIC AREAS SHALL HAVE FRAMES AND GRATES RATED FOR AASHTO H20 LOADING.




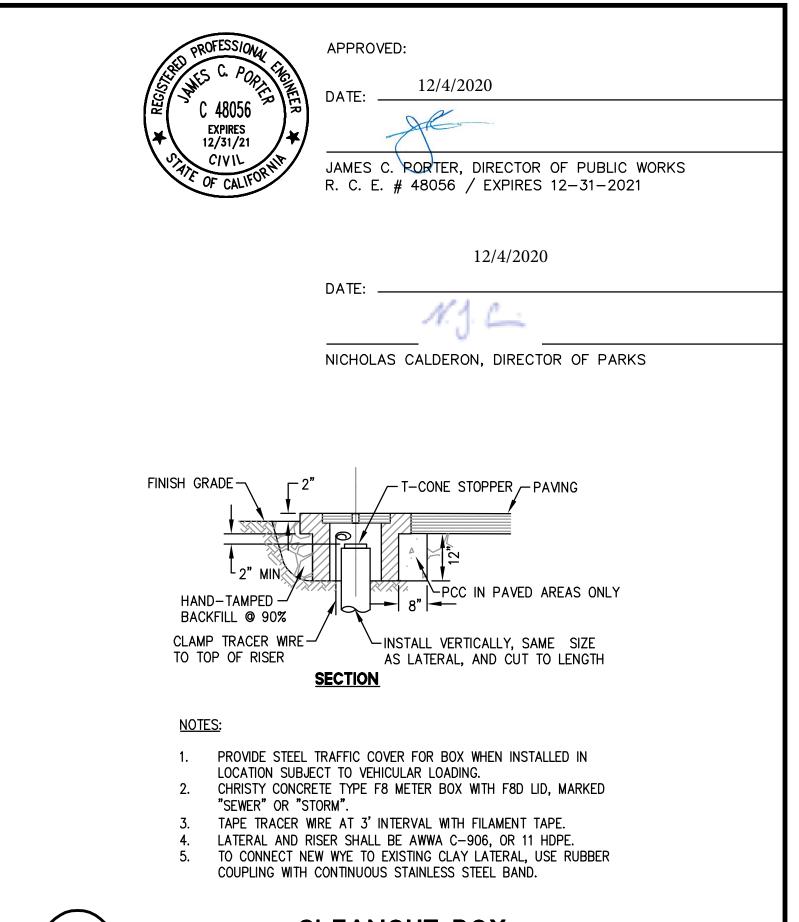


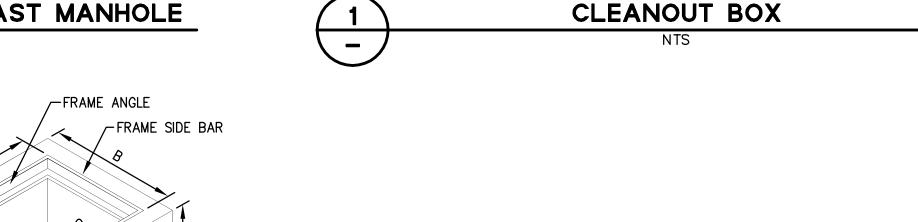

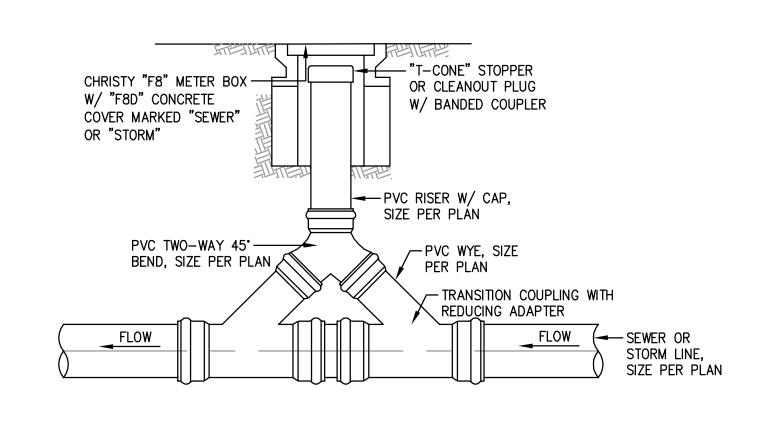



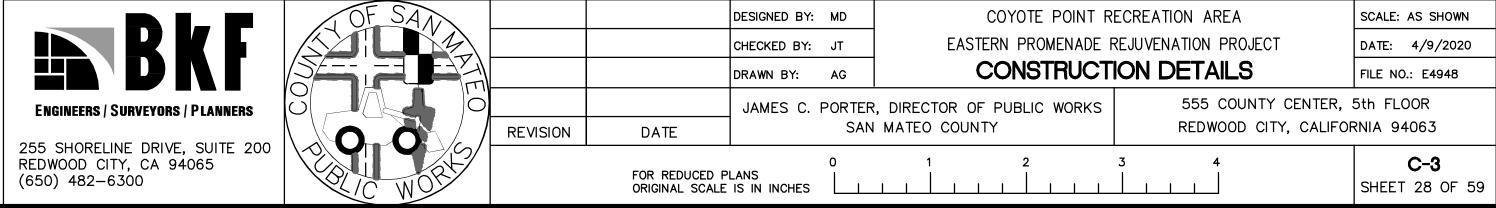

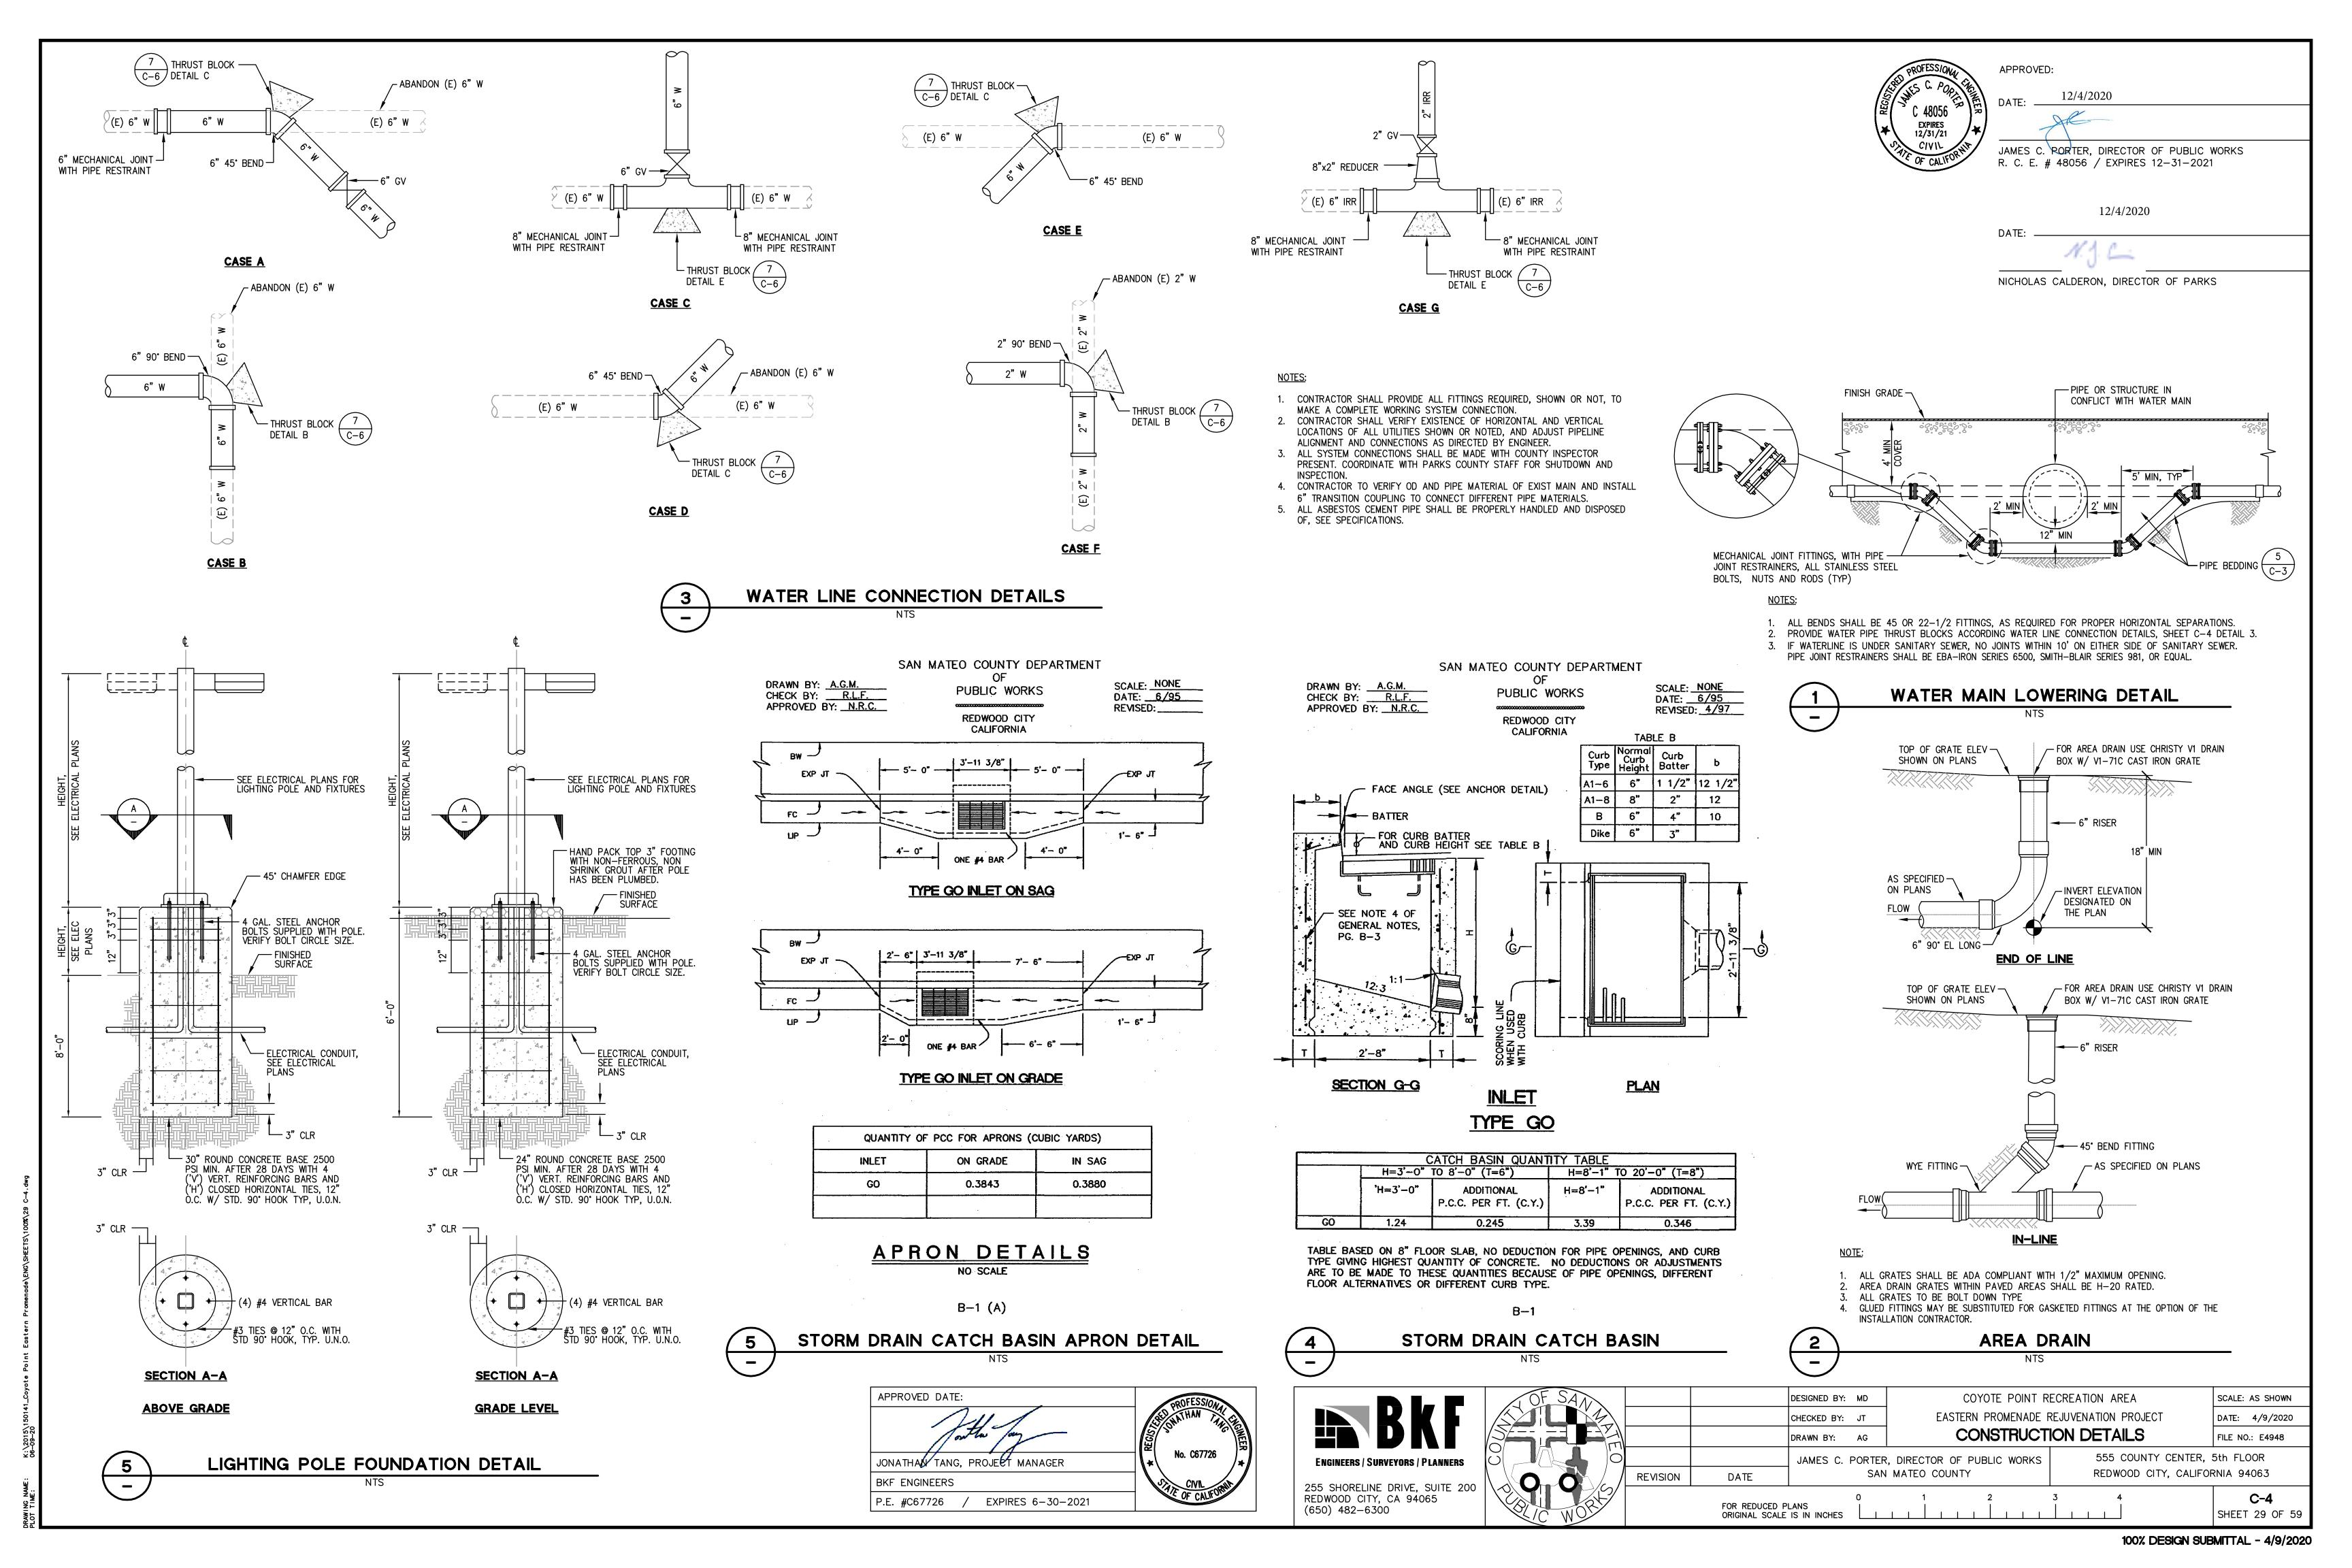

#### PRC (PUBLIC RESTROOM COMPANY)

1. PUBLIC RESTROOM COMPANY (PRC) WILL PROVIDE FULL ARCHITECTURAL PLANS AND ENGINEERING CALCULATIONS. STAMPED BY STATE GOVERNING AGENCY SUITABLE FOR GENERAL CONTRACTOR TO FILE FOR REQUIRED BUILDING

2. PUBLIC RESTROOM COMPANY WILL FURNISH AND INSTALL UNDERGROUND UTILITIES (UNDER SLAB) EXTENDING 6 FEET (MAX) BEYOND THE BUILDING LINE, MIN. OF 24" - MAX OF 36" BELOW GRADE.

#### **GENERAL PAD NOTES:**

1. THE DIFFERENCE IN THE ELEVATION BETWEEN THE FINISH FLOOR OF RESTROOMS AND THE SIDEWALK OUTSIDE CAN NOT BE GREATER THAN 1/4" MAX.

2. THE STRUCTURAL DESIGN DETAILS HEREIN ARE SPECIFIC TO THE BUILDING SIZE AND MODULE CONFIGURATION SHOWN ON THE FLOOR PLANS OF THESE DRAWINGS.

1. OWNER / GEN. CONTRACTOR SHALL PREPARE BUILDING PAD PER DETAILS ON THIS SHEET AND SCOPE OF WORK.

2. OWNER / GEN. CONTRACTOR SHALL ATTACH SITE PLAN TO THE PUBLIC RESTROOM COMPANY'S DEPARTMENT OF HOUSING APPROVED DOCUMENTS AND FILE BUILDING PERMIT FOR PLUMBING PERMIT/INSPECTION UNDER BUILDING SLAB

3. OWNER / GEN. CONTRACTOR TO COORDINATE SEWER INVERT WITH THE PUBLIC RESTROOM COMPANY PRIOR TO BUILDING INSTALLATION, VERIFY & COORDINATE LOCATION OF EXISTING UTILITIES INCLUDING WATER METER SIZE, TYPE, AND LOCATION OF EXITING UTILITIES COMING INTO THE BUILDING SUPPLIED BY PRC

4. OWNER / GEN. CONTRACTOR IS RESPONSIBLE FOR UTILITY CONNECTIONS AND WILL MAKE FINAL CONNECTIONS TO SEWER, WATER AND POWER.

5. OWNER / GEN. CONTRACTOR TO PREPARE SITE FOR MINIMUM ALLOWABLE SOIL BEARING PRESSURE OF 1,500psf, WITH SUB-GRADE COMPACTED TO 90% M.D.D.


6. OWNER / GEN. CONTRACTOR TO SUPPLY AND STOCK PILE REQUIRED QUANTITY OF COARSE SAND WITHIN BUILDING PROXIMITY FOR USE BY PRC. (ELEVATION OF BASE TO BE DETERMINED AND VERIFIED BY THE GENERAL CONTRACTOR) PAD ELEVATION MUST BE LEVEL WITHIN 2% (=/-) AND COMPLY WITH ALL PERMISSIBLE CODES OF ACCESSIBILITY AND SAFETY. BEFORE BUILDING SET WET SAND FILL TO CONSOLIDATE AND / OR VIBRATE.


7. PROJECTS WITH FOOTINGS: OWNER / GEN. CONTRACTOR MUST PROVIDE SLEEVES IN FOOTINGS ACCORDING TO UTILITY LOCATION PLAN AND PAD / FOUNDATION PLAN


#### **GENERAL SITE CONDITION LIABILITY NOTE:**


PUBLIC RESTROOM COMPANY (PRC) PROVIDES BUILDING PAD PLAN DRAWINGS FOR PLACEMENT OF OUR BUILDING ON SITE PADS FOR REFERENCE ONLY. PRC DRAWINGS DO NOT INCORPORATE SITE DESIGN FOR LOCAL CODES, SOILS CONDITIONS, FOOTING REQUIREMENTS, AND/OR ANY OTHER CONTRIBUTING SITE FACTORS UP TO AN INCLUDING HIGH WATER TABLES. IT IS THE RESPONSIBILITY OF THE OWNER OR GENERAL CONTRACTOR TO PROVIDE A PROPER SITE DESIGN TO ACCOMMODATE THE BUILDING AS WELL AS PROVIDE PROPER SITE CRITERIA SO PRC MAY MODEL SEWER. WATER. AND ELECTRICAL DESIGNS WITHIN THE BUILDING. OUR BUILDING DESIGN INCLUDES AN 8" THICK REINFORCED CONCRETE SLAB AND ASSUMES FULL SLAB BEARING ON SOILS WITH A MINIMUM OF 1500 PSF BEARING CAPACITY. OUR BUILDING DESIGNS SURCHARGE THE SOIL BENEATH THE MAT SLAB AT APPROXIMATE 208 PSF. ANY BUILDING FOUNDATION IN ADDITION TO THE INTEGRAL MAT SLAB ARE SHOWN FOR REFERENCE ONLY AND SHOULD BE VERIFIED BY A LICENSED SOILS ENGINEER TO CONFORM WITH REQUIRED CODES. PRC ASSUMES NO LIABILITY FOR THE OWNER OR GENERAL CONTRACTOR ACCEPTANCE OF THESE TYPICAL DRAWINGS WITHOUT VERIFICATION BY A LICENSED SOILS / FOUNDATION ENGINEER.


				REVISION BY:	REVISIO	N DATE: RE\	VISION#
PUBLIC	COPYRIGHT 2016, PUBLIC RESTROOM COMPANY THIS MATERIAL IS THE EXCLUSIVE	BUILDING TYPE:	RESTROOM / STORAGE BU	ILDING		DATE: 09-07-2016 PROJECT #: <b>9827</b>	DRAWN BY: EVE
Building Better Place To Go. <sup>14</sup>	PROPERTY OF PUBLIC RESTROOM COMPANY AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS EXCEPT AS AUTHORIZED BY THE WRITTEN PERMISSION OF PUBLIC RESTROOM COMPANY.	PROJECT:	COYOTE POINT RECREATION COUNTY OF SAN MATEO			MAXIMUM PERSON AN H	N HOUR:

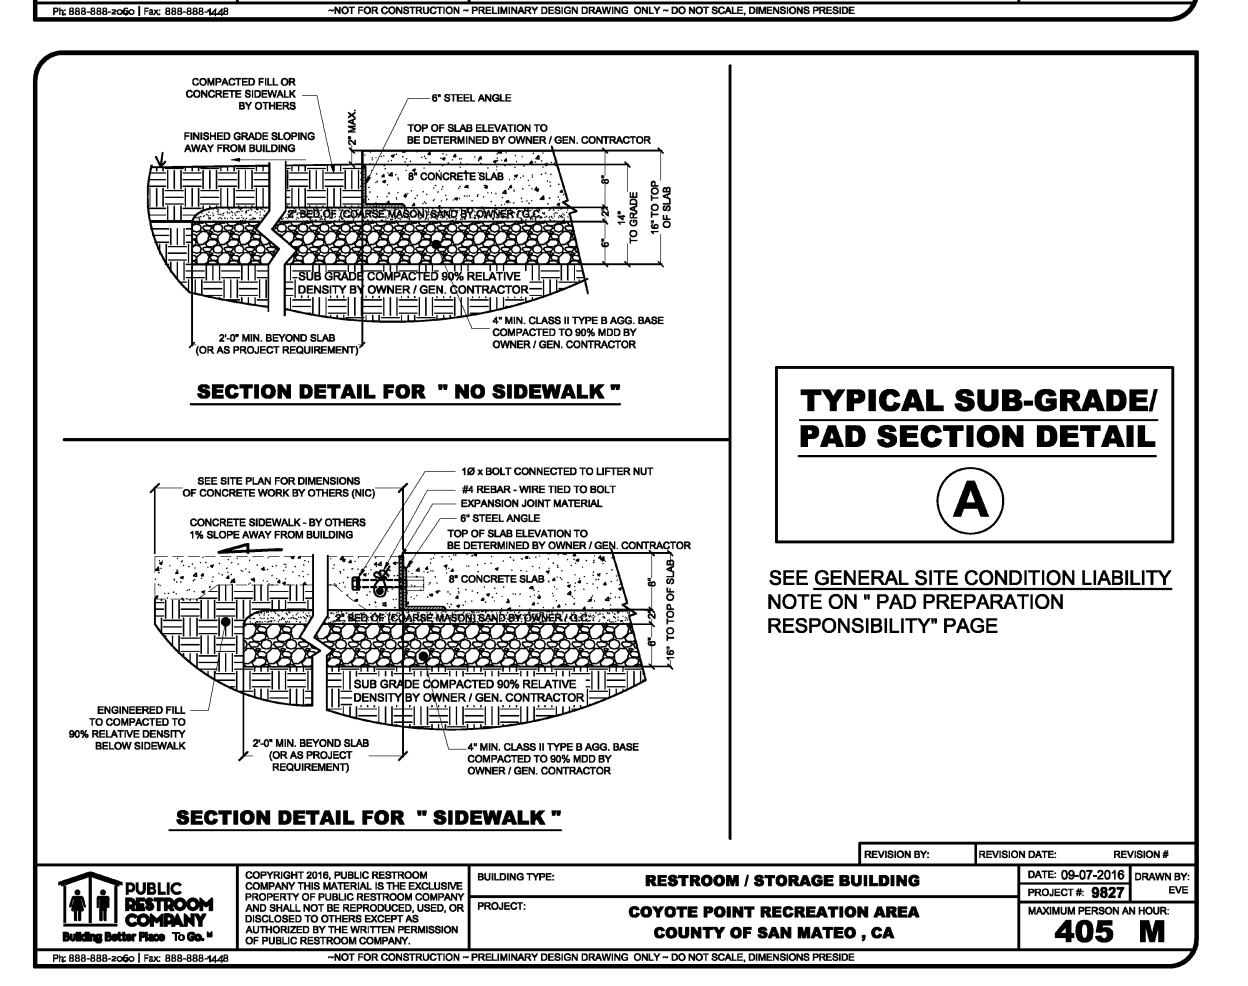


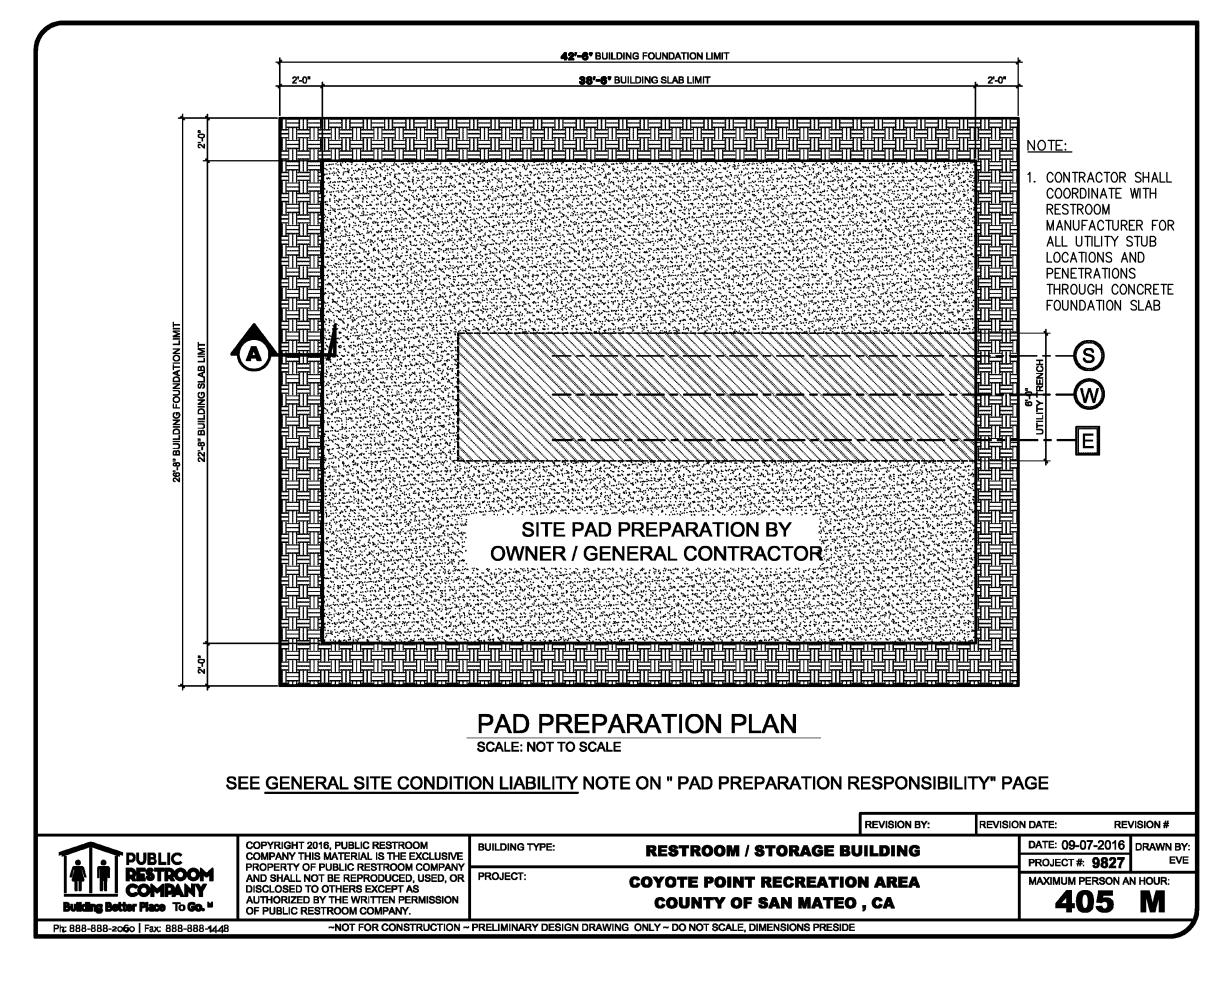

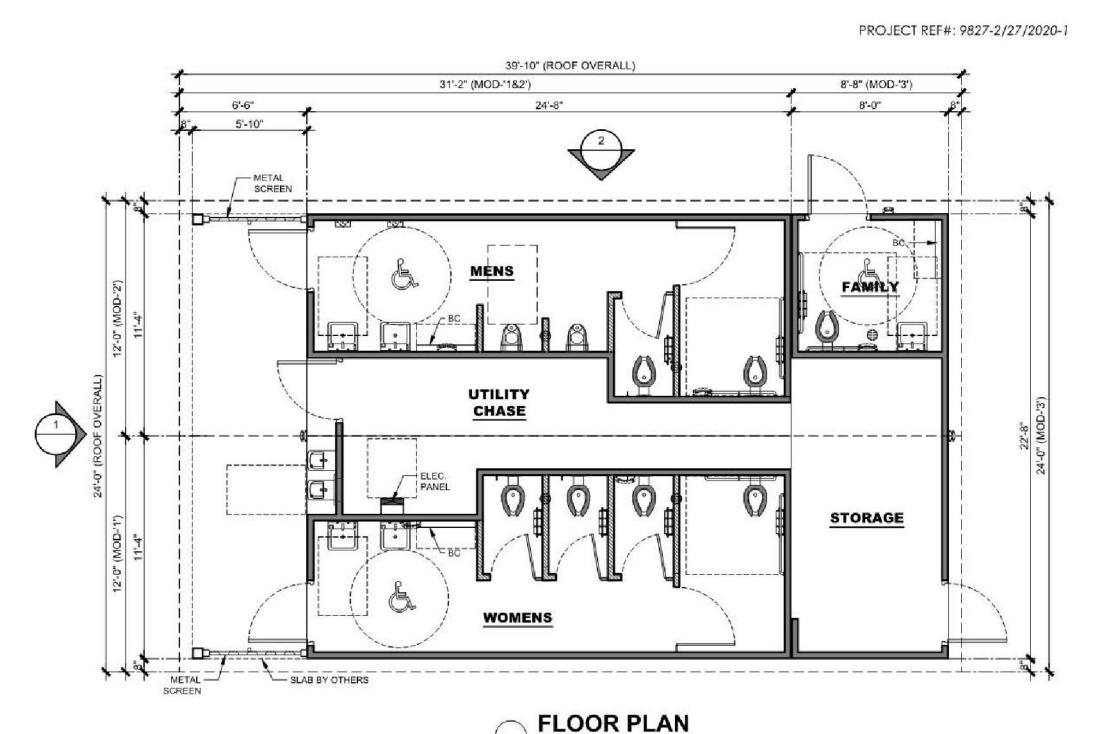

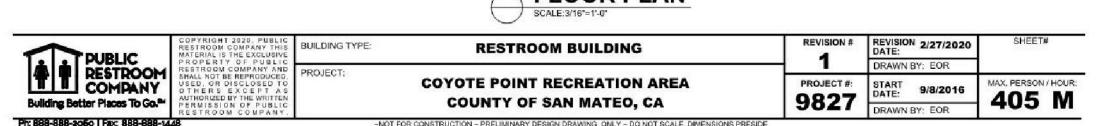


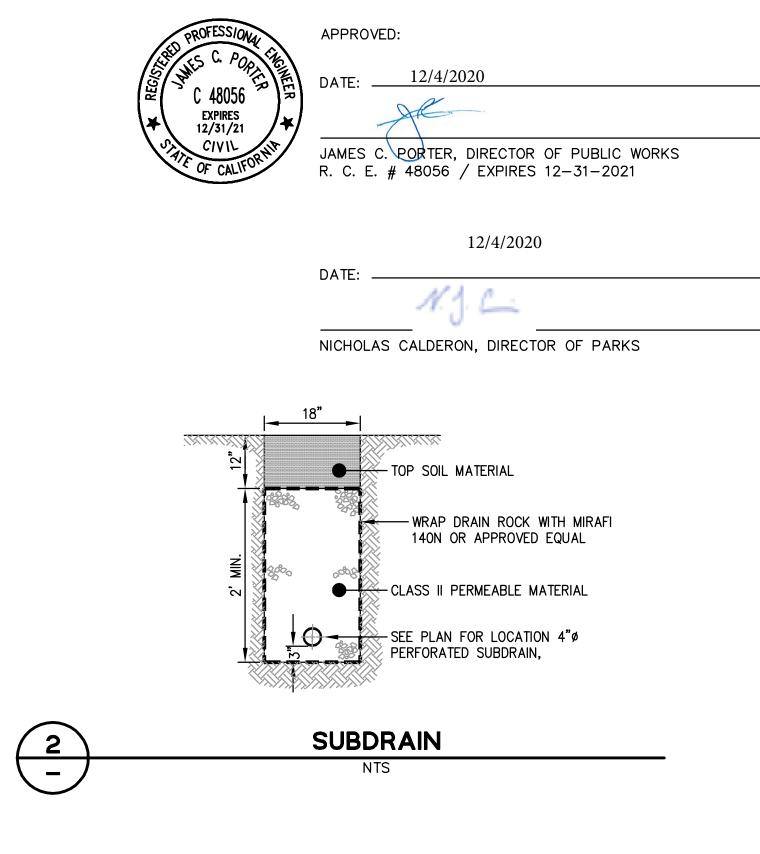

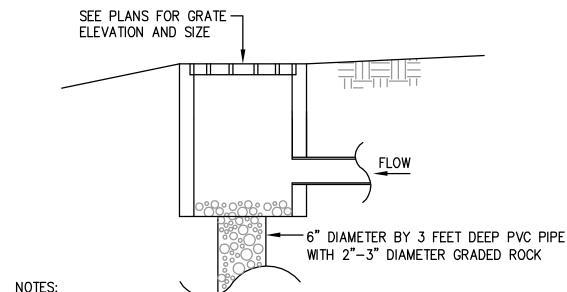

STORM DRAIN BUBBLE-UP BOX SHALL BE CENTRAL PRECAST OR APPROVED EQUAL.



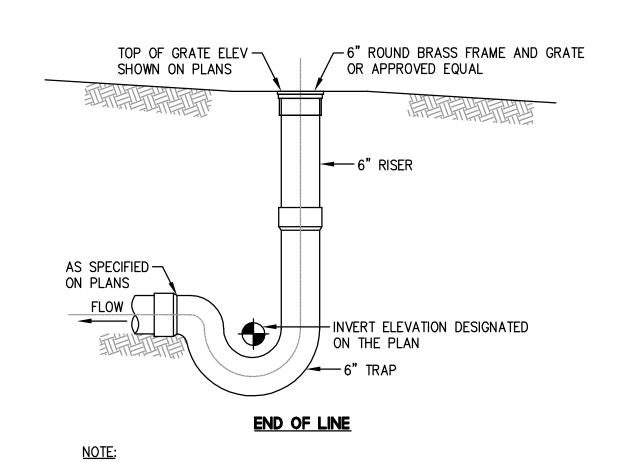



1. ALL GRATES SHALL BE ADA COMPLIANT WITH 1/2" MAXIMUM OPENING. 2. AREA DRAIN GRATES WITHIN PAVED AREAS SHALL BE H-20 RATED. 3. ALL GRATES TO BE BOLT DOWN TYPE.







P.E. #C67726 / EXPIRES 6-30-2021

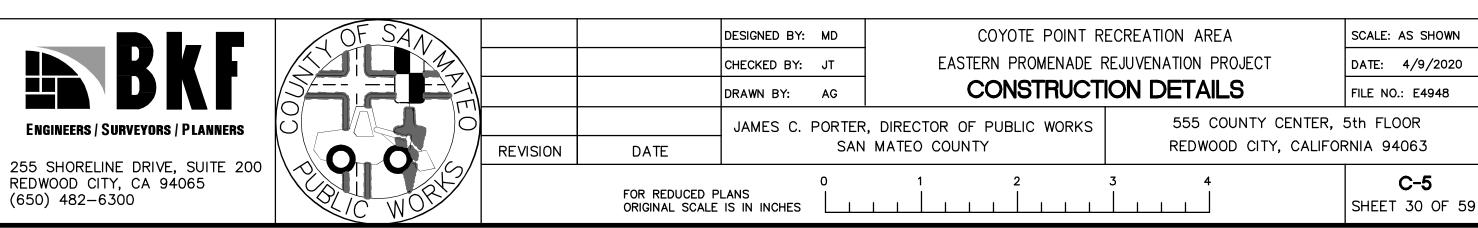


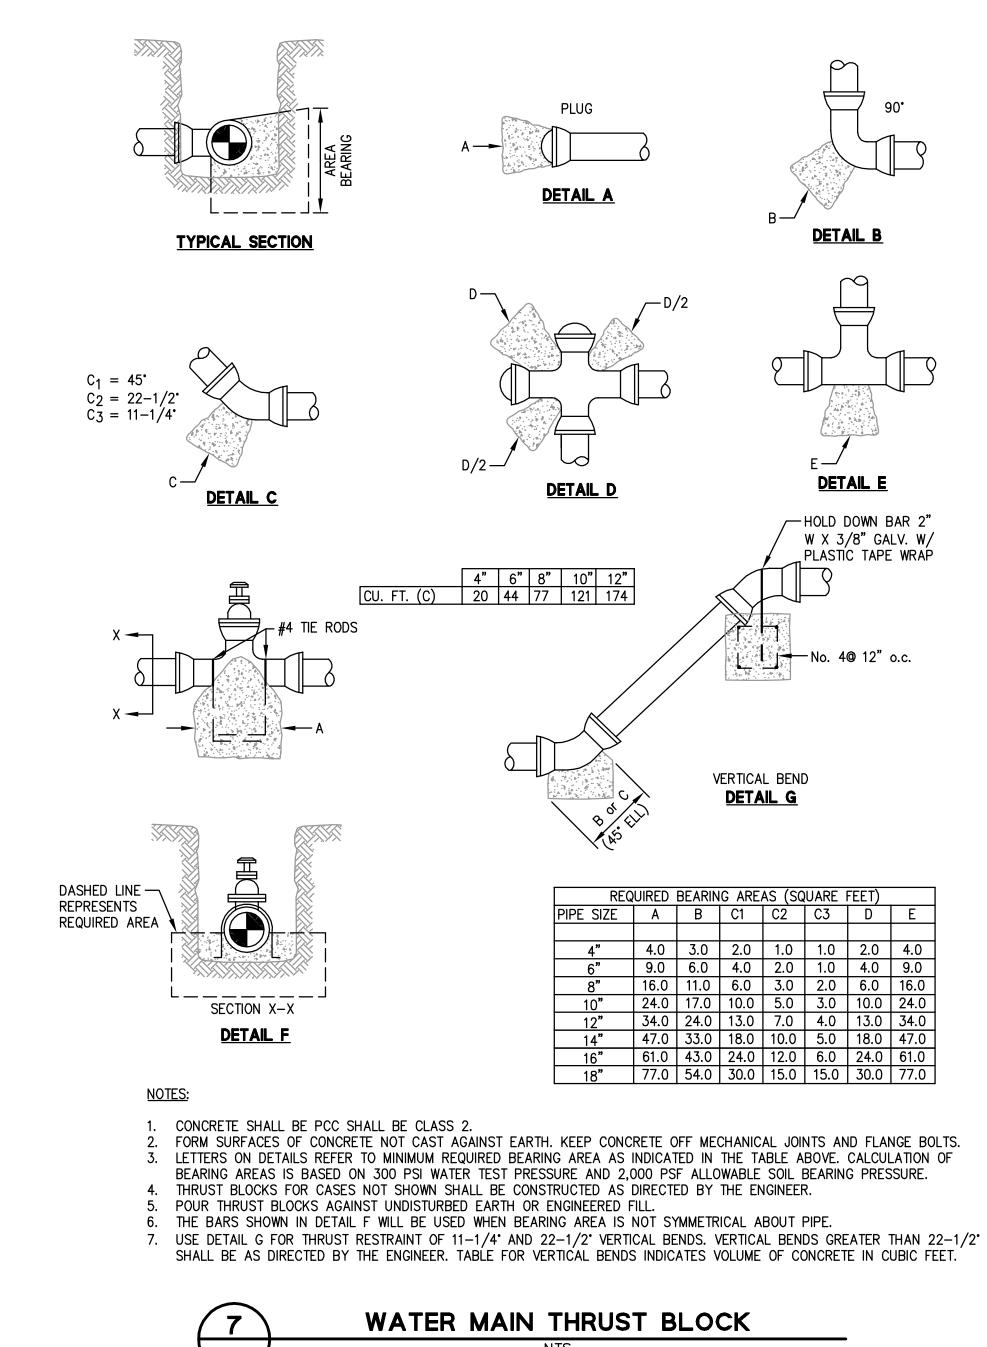

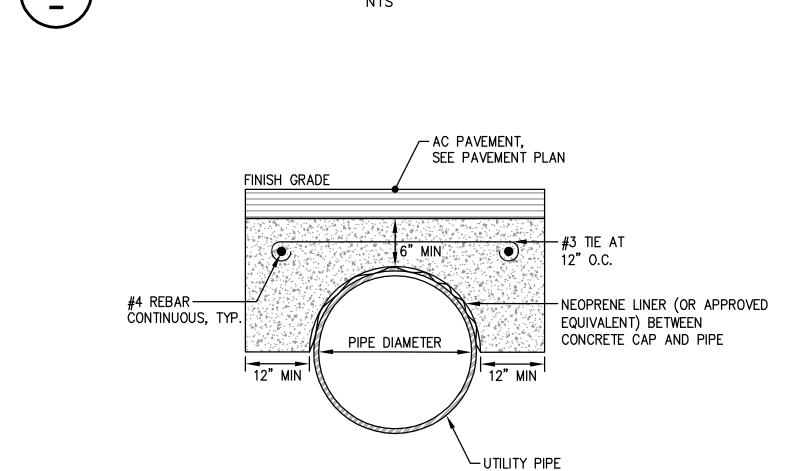



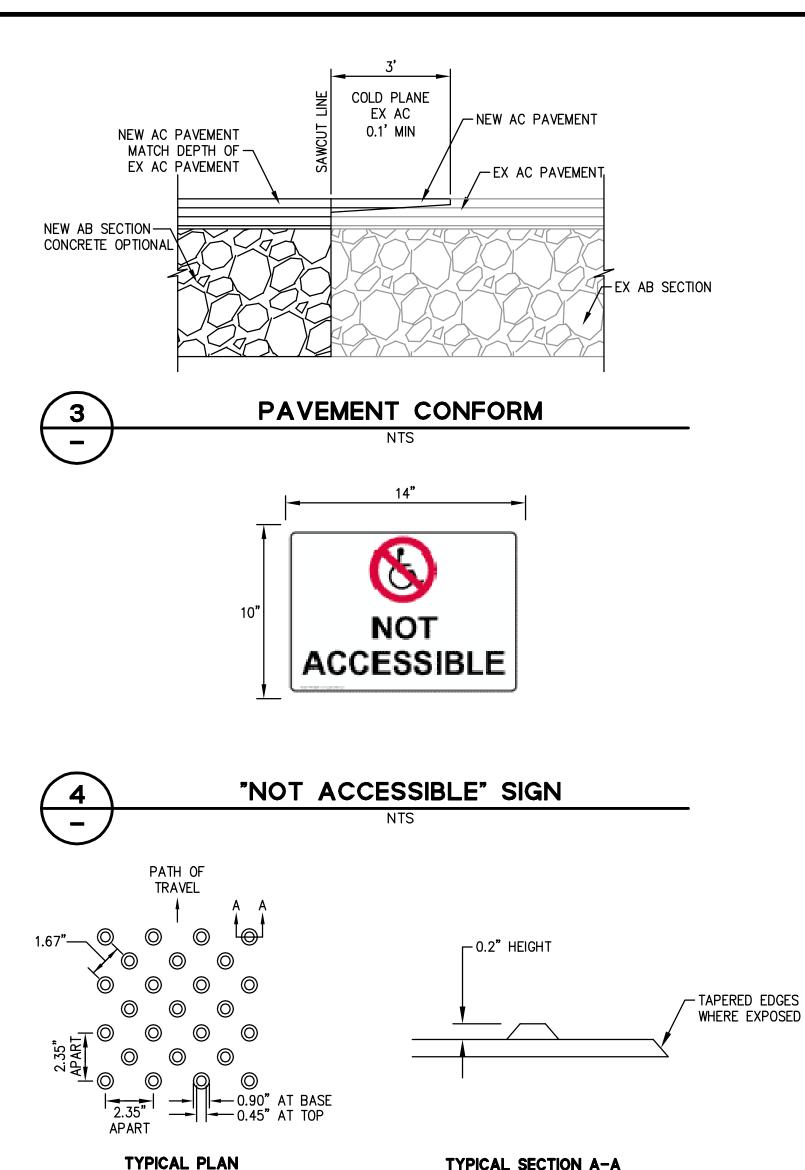

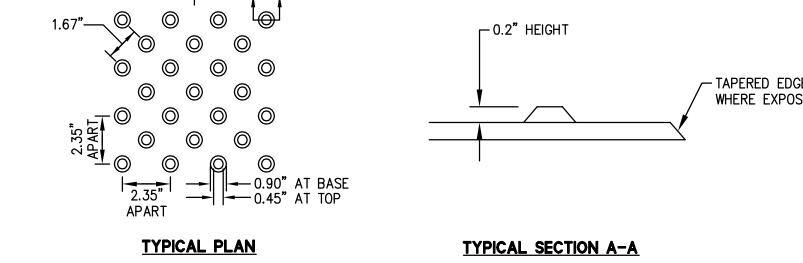


RAISED TRUNCATED DOME PATTERN NOTES:

TRUNCATED DOME ELEVATION


1. CAST IN PLACE DETECTABLE/TACTILE WARNING SURFACE TILES SHALL BE VITRIFIED POLYMER COMPOSITE WITH ALUMINUM OXIDE CAST-IN-PLACE TILES BY ARMOR-TILE, MANUFACTURED BY ENGINEERED PLASTICS INC. (800) 682-2525 OR EQUAL. EXISTING ENGINEERED AND FIELD TESTED PRODUCTS, WHICH HAVE BEEN IN SUCCESSFUL SERVICE FOR A PERIOD OF THREE YEARS ARE SUBJECT TO COMPLIANCE WITH SPECIFIED TILES, AND MAY BE INCORPORATED IN THE WORK IF THEY MEET OR EXCEED THE TEST CRITERIA AND CHARACTERISTICS OF THE ABOVE SPECIFIED TILE. COLOR SHALL BE (YELLOW CONFORMING TO FEDERAL STANDARD 595C, COLOR NO. 33538). SUBMIT PRODUCT DATA AND 2" BY 2" SAMPLES FOR APPROVAL. INSTALL PER MANUFACTURER'S SPECIFICATION.


2. THE EDGE OF THE DETECTABLE WARNING SURFACE NEAREST THE STREET SHALL BE BETWEEN 6" AND 8" FROM THE GUTTER FLOWLINE.

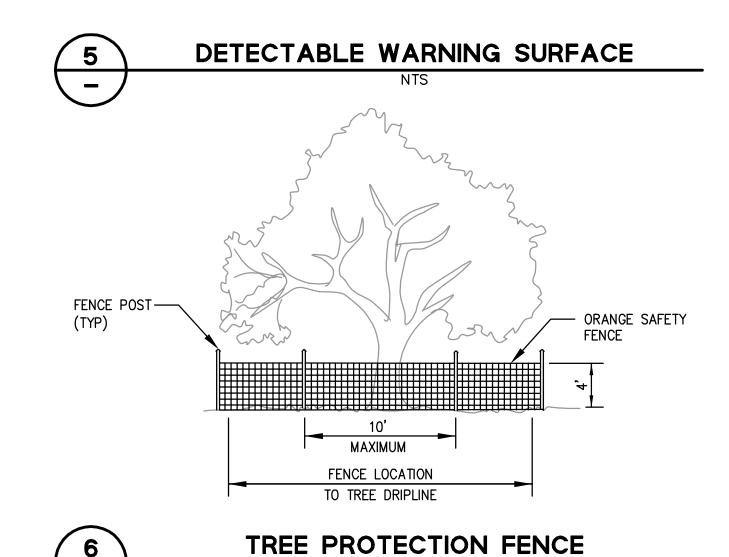







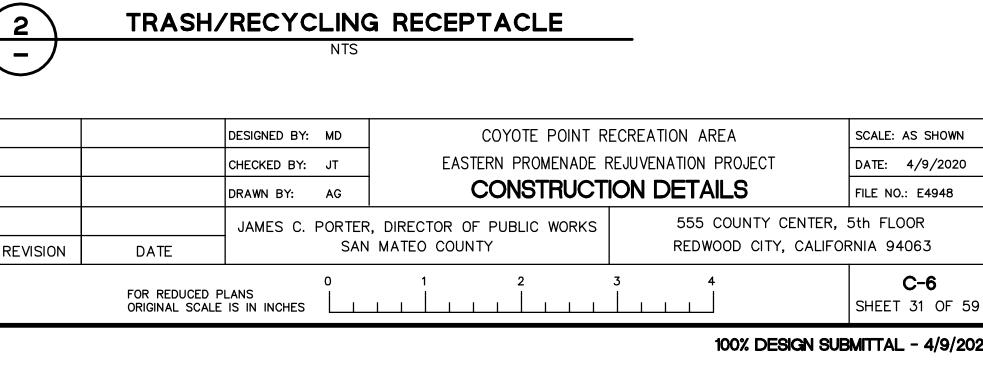

----- 23 7/8° -----

🖀 BearSaver

HA2

SCALE: 1:12 WEIGHT:

100% DESIGN SUBMITTAL - 4/9/2020



# 2"ø GALVANIZED STEEL POST 84" MIN TO TOP OF WALKING WITH WELDED CAP, SIGN SURFACE (MAY BE REDUCED MOUNTING HARDWARE PER TO 60" WHEN LOCATED IN CALTRANS STANDARD DETAILS AND SPECIFICATIONS FINISH GRADE 6" MIN 6" MIN CLASS 3 CONCRETE "NO PARKING LOADING ZONE" SIGN · : 🔲 🕽

NOTES:

1. REBAR RECOMMENDED IN CONCRETE PAD

1390 S. MILLIKEN AVE ONTARIO CA 91761

13"

LANDSCAPE AREA)

APPROVED:

REFLECTORIZED SIGN CONSTRUCTED OF PORCELAIN STEEL, WHITE

BACKGROUND WITH RED TEXT

■ R7-6 - NO PARKING LOADING ZONE SIGN

12/4/2020

JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS

12/4/2020

R. C. E. # 48056 / EXPIRES 12-31-2021

NICHOLAS CALDERON, DIRECTOR OF PARKS

# **ADDITIONAL NOTES:**

3 3/4"±1/8"

APPROX.

1. CONCRETE PAD SHALL BE CLASS 2, AND SHALL BE REINFORCED WITH #4 REBAR AT 12" ON-CENTER SPACING IN EACH DIRECTION OF PAD OR AS RECOMMENDED BY MANUFACTURER.

(909 605-7780)


DO NOT SCALE DRAWING


- 2. REBAR SHALL BE 3" MINIMUM FROM CONCRETE PAD SURFACE AND FROM ANY EDGE OF THE CONCRETE. 3. CONTRACTOR SHALL FURNISH AND INSTALL DECAL LABEL FOR DESIGNATING RECEPTACLES FOR TRASH AND RECYCLING.
- CONTRACTOR SHALL COORDINATE WITH THE COUNTY ON SELECTION OF THE DECAL LABEL FROM MANUFACTURER.
- 4. INSTALL CONCRETE SLAB ON 4" CLASS II AB COMPACTED TO AT LEAST 95%.

-1/2" J BOLTS SUNK IN CONCRETE

5. J-BOLT SHALL BE INSTALLED TO A DEPTH EQUAL TO HALF OF THE THICKNESS OF THE CONCRETE SLAB.



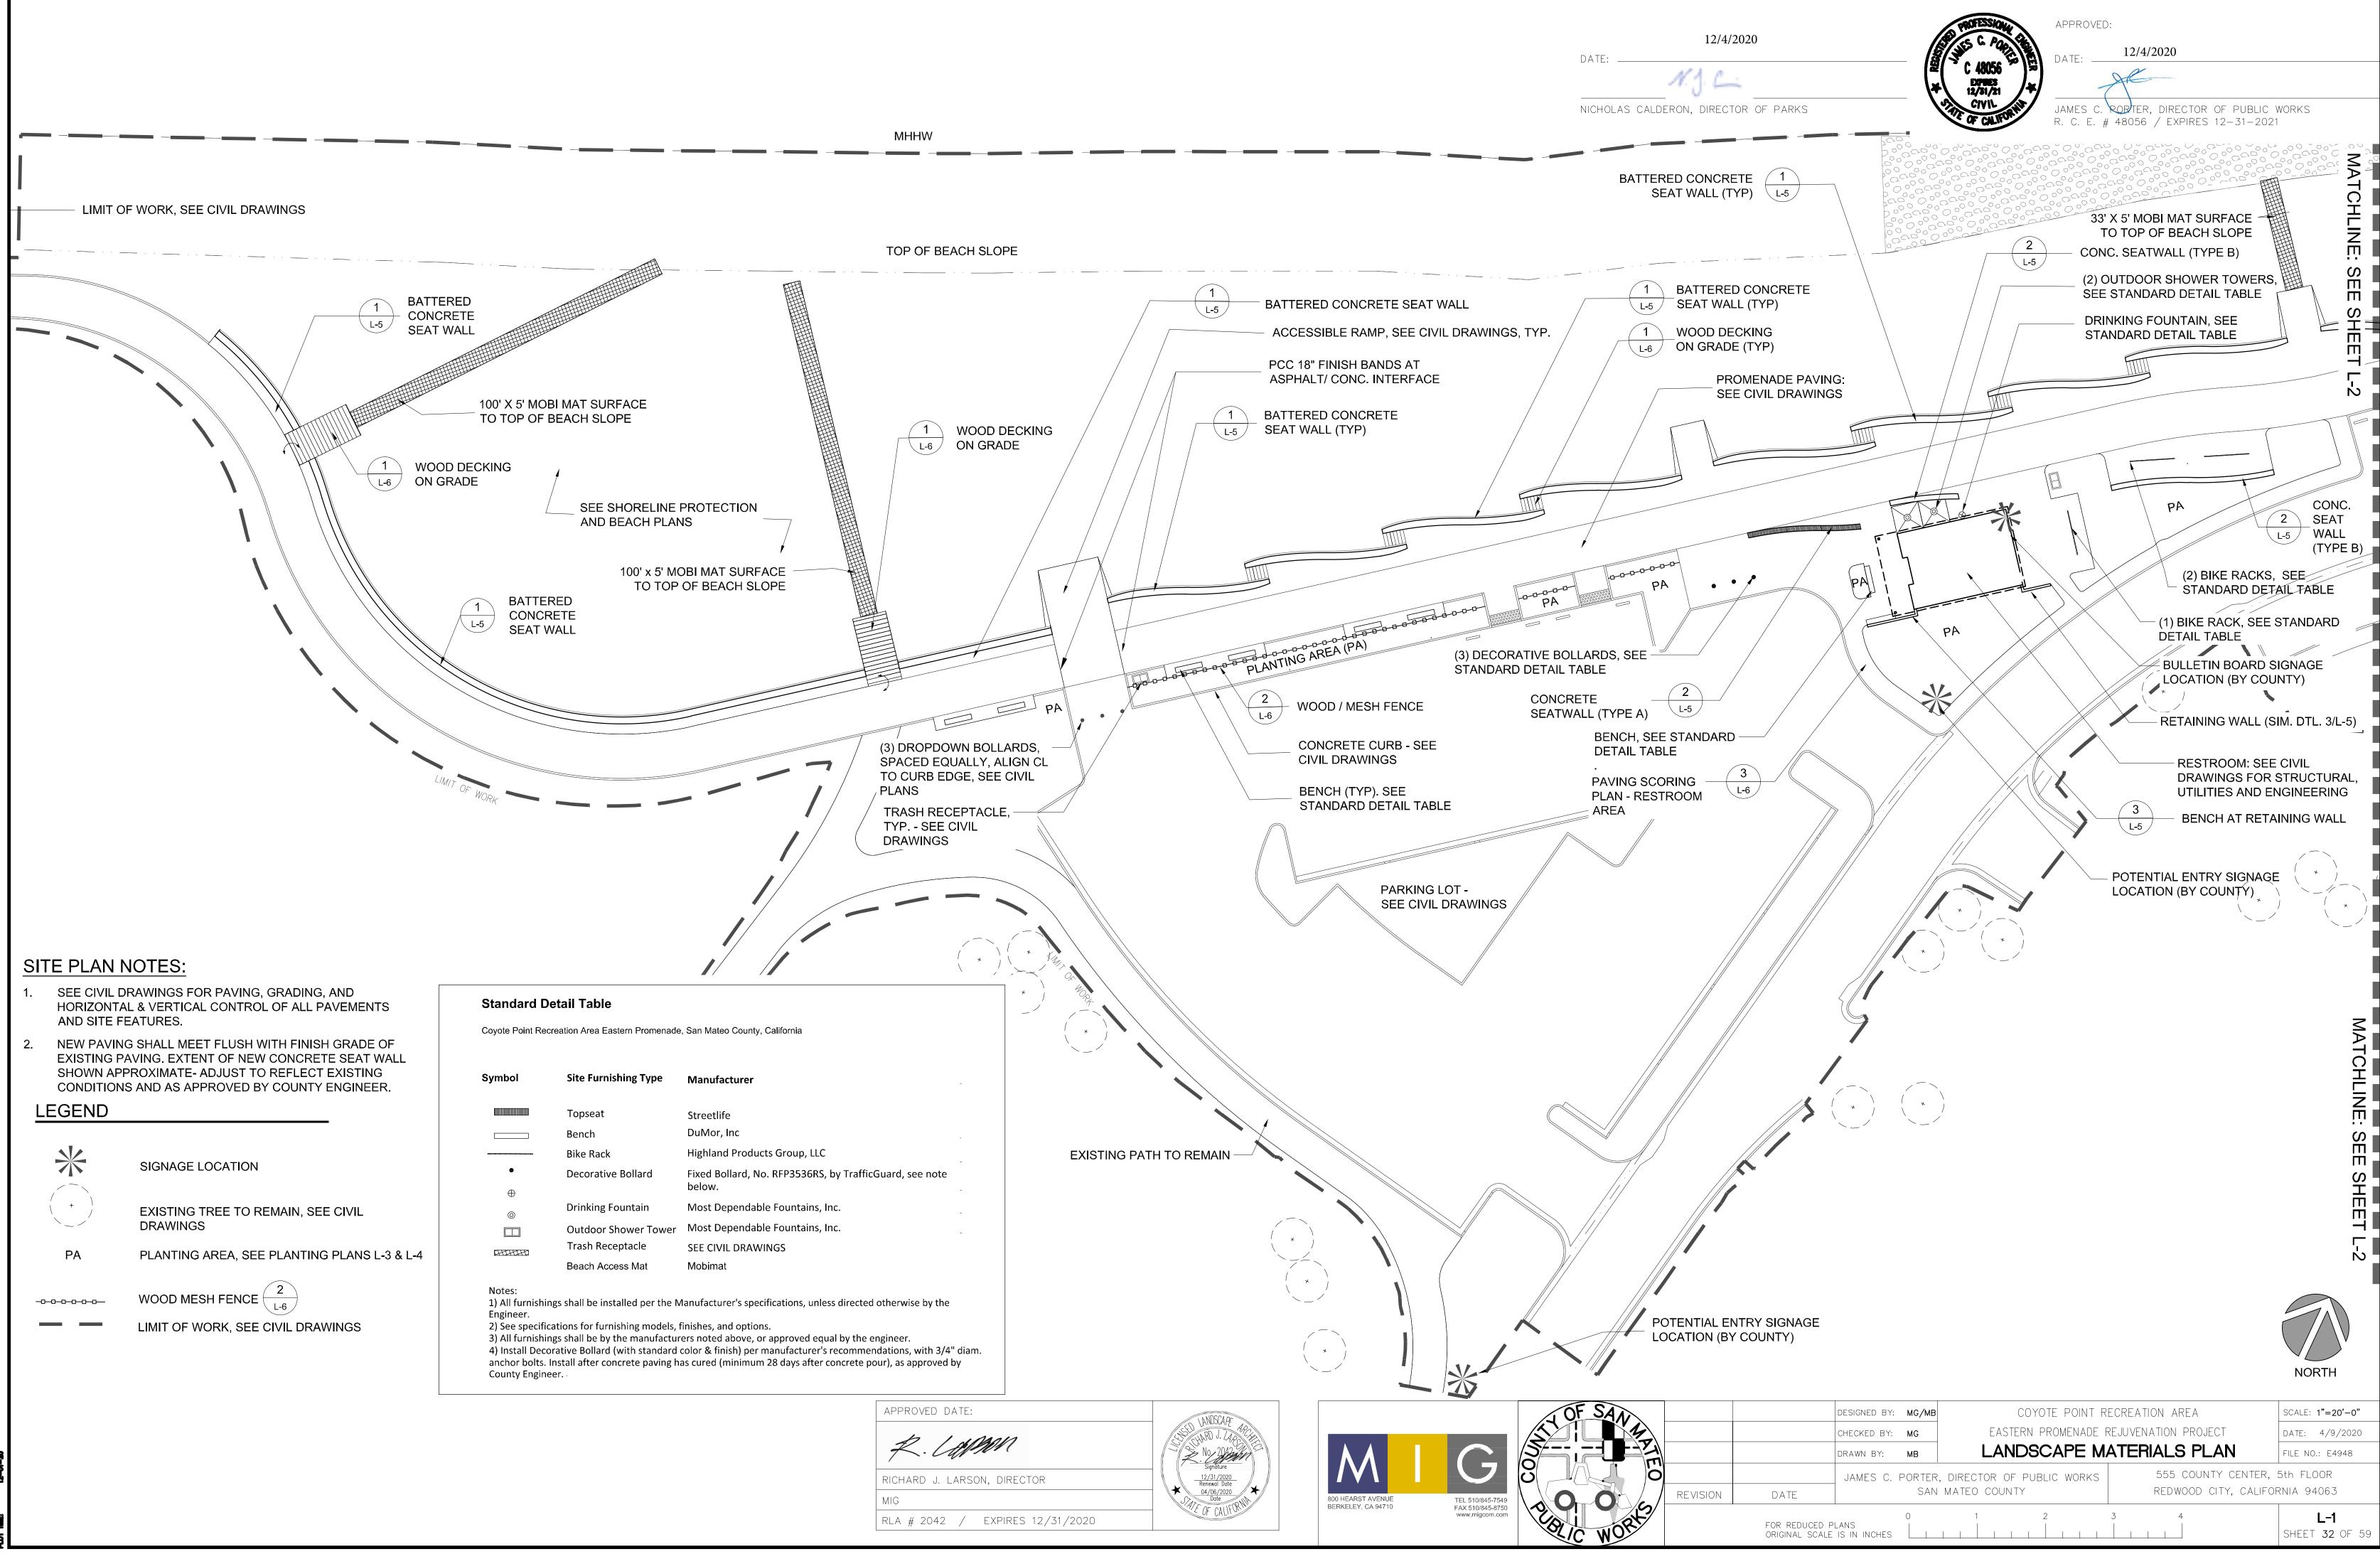

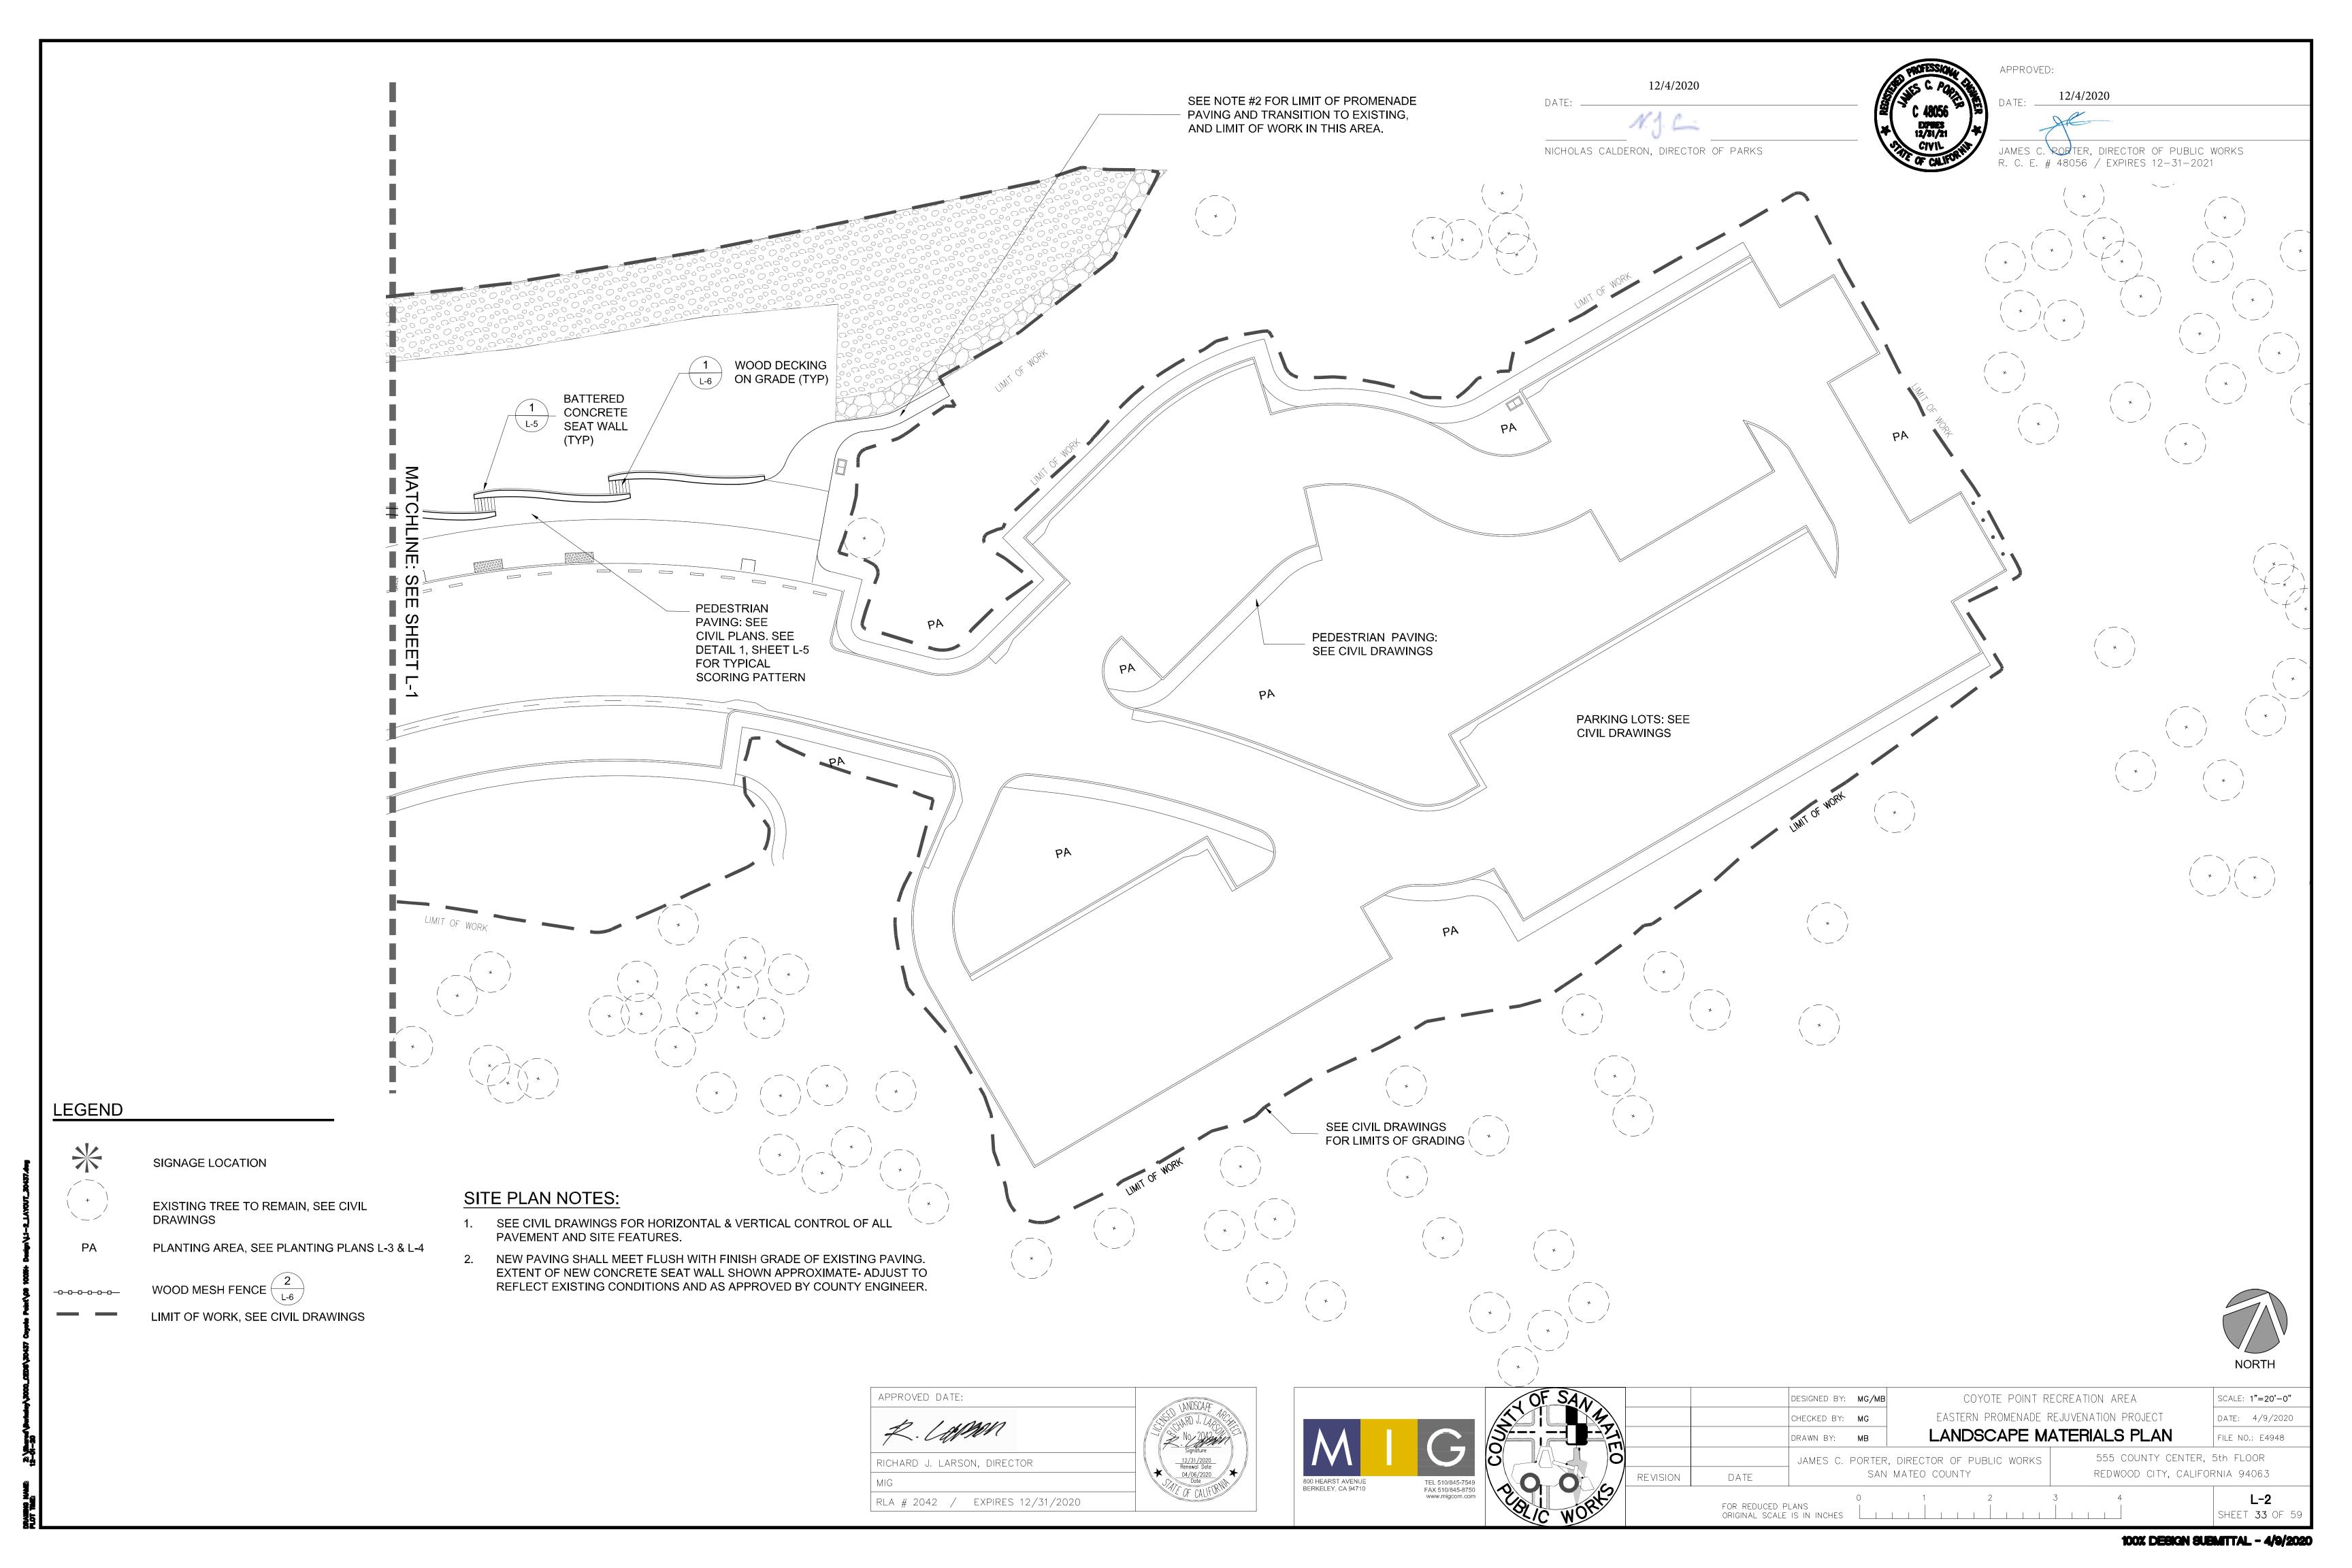

#### PLANTING NOTES

Heteromeles arbutifolia

Hesperocyparis macrocarpa

Monterey Cypress

create a natural appearancce, as directed by the Landscape Architect.

Note: Species within Accent, Interior Bioswale, and Screen Planting Areas shall be installed in clumps of 2-3 plants of eacch species to

15 GAL

- THE PLANTING PLANS INDICATE APPROXIMATE PLANTING AREAS AND LOCATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING THE REQUIRED NUMBER OF PLANTS TO COVER THE AREAS SHOWN ON THESE PLANS.
- 2. THE LOCATION OF ALL TREES ARE DIAGRAMMATIC. FINAL LOCATION TO BE DETERMINED IN THE FIELD BY THE LANDSCAPE ARCHITECT.
- 3. ALL TREES SHALL BE LOCATED A MINIMUM OF 5' CLEAR OF THE EDGE OF ALL PAVING AND WALLS, SIGNAGE, AND PERMANENT SITE FEATURES.
- 4. REFER TO THE PLANT LIST FOR PLANT SIZES. REFER TO THE SPECIFICATIONS FOR SOIL PREPARATION, SOIL AMENDMENTS, FERTILIZER AND ADDITIONAL PLANTING REQUIREMENTS.
- ALL PLANTS MUST BE SOURCED FROM LOCAL NATIVE PLANT NURSERIES WITHIN SAN MATEO COUNTY.
- SEE CIVIL PLANS FOR EXISTING TREE PROTECTION.


#### NATIVE EROSION CONTROL SEED MIX

**BOTANTICAL NAME COMMON NAME POUNDS PURE LIVE SEED / ACRE** Achillea millifolium 1.0 Common yarrow California Brome 10.0 Bromus carinatus Blue Wildrye 8.0 Elymus glaucus Eschscholzia californica California poppy 1.5 8.00 Hordeum californicum California Barley 5.00 Creeping Wildrye Leymus triticoides 4.0 Sky lupine Lupinus nanus Sisyrinchium bellum 3.0 Western blue eyed grass Three Weeks Fescue 6.00 Vulpia microstachys

Note 1) See specifications for seed product and application requirements. 2) Seed Mix available from Pacific Coast Seed, 1-925-373-4417, or approved equal.

#### 12/4/2020

DATE: \_ NICHOLAS CALDERON, DIRECTOR OF PARKS



12/4/2020 R. C. E. # 48056 / EXPIRES 12-31-2021

DATE: \_\_\_\_

NICHOLAS CALDERON, DIRECTOR OF PARKS

#### NATIVE EROSION CONTROL SEED MIX - SEE TABLE. EXTEND SEEDING TO LIMIT OF GRADING NATIVE EROSION CONTROL SEED MIX - SEE TABLE Plant Legend LEGEND Coyote Point Recreation Area Eastern Promenade, San Mateo County, California CEANOTHUS THYRSIFLORUS **Botanical Name Common Name** Spacing Area DESCHAMPSIA CESPITOSA SSP. HOLCIFORMUS SHORELINE Deschampsia cespitosa ssp holciformis Pacific Hairgrass 1 GAL 100% Cover MUHLENBERGIA RIGENS Muhlenbergia rigens Deergrass 1 GAL 100% Cover Creeping Blue Blossom Ceanothus thyrsiflorus var. repens 1 GAL 100% Cover ACCENT PLANTING AREA California Sagebrush 5 GAL Accent - 20% Cover Artemisia californica SCREEN PLANTING AREA Eriogonum latifolium 5 GAL Coastal Buckwheat Accent - 20% Cover Silver Bush Lupine Lupinus albifrons 5 GAL Accent - 20% Cover INTERIOR BIOSWALE PLANTING AREA Sticky Monkey Flower 5 GAL Accent - 20% Cover Mimulus aurantiacus NATIVE EROSION CONTROL Ribes sanguineum Flowering Currant 5 GAL Accent - 20% Cover PERIMETER BIOSWALE PLANTING AREA SEED MIX - SEE TABLE. EXTEND SEEDING TO LIMIT OF GRADING NATIVE EROSION CONTROL **BIOSWALES** SEED MIX - MIX TO BE DETERMINED Dense Sedge 1 GAL Carex densa 1.5' Interior - 20% Cover (E) TREE TO BE PROTECTED Creeping Spikerush 1 GAL Eleocharis macrostachya Interior - 20% Cover Meadow Barley 1 GAL Hordeum brachyantherum Interior - 20% Cover Juncus phaeocephalus 1 GAL Brown Headed Rush Interior - 20% Cover Silver wees Cinquefoil 1 GAL Interior - 10% Cover Potentilla anserina **HESPEROCYPARIS** California Golden-eyed Grass Sisyrinchium californicum 1 GAL Interior - 10% Cover MACROCARPA Juncus patens Blue Rush 1 GAL Perimeter - 50% Cover Muhlenbergia rigens Deergrass 1 GAL Perimeter - 50% Cover NORTH LIMIT OF WORK / GRADING - SEE CIVIL PLANS APPROVED DATE: DESIGNED BY: MB COYOTE POINT RECREATION AREA | SCALE: 1" = 20'-0"California Coffeeberry Frangula californica 5 GAL Screen - 50% Cover EASTERN PROMENADE REJUVENATION PROJECT CHECKED BY: MG DATE: 4/9/2020 PLANTING PLAN 5 GAL DRAWN BY: MB Screen - 50% Cover FILE NO.: E4948

12/31/2020 Renewal Date 04/06/2020 Date

RICHARD J. LARSON, DIRECTOR

RLA # 2042 / EXPIRES 12/31/2020

L-3

SHEET 34 OF 59

555 COUNTY CENTER, 5th FLOOR

REDWOOD CITY, CALIFORNIA 94063

JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS

SAN MATEO COUNTY

DATE

FOR REDUCED PLANS ORIGINAL SCALE IS IN INCHES

REVISION

TEL 510/845-7549 FAX 510/845-8750 www.migcom.com

## APPROVED: 12/4/2020 PLANTING NOTES 12/4/2020 NATIVE EROSION CONTROL SEED MIX - SEE TABLE. EXTEND 1. THE PLANTING PLANS INDICATE APPROXIMATE PLANTING AREAS AND LOCATIONS. THE CONTRACTOR SHALL BE SEEDING TO LIMIT OF GRADING RESPONSIBLE FOR PROVIDING THE REQUIRED NUMBER OF PLANTS TO COVER THE AREAS SHOWN ON THESE PLANS. NICHOLAS CALDERON, DIRECTOR OF PARKS R. C. E. # 48056 / EXPIRES 12-31-2021 2. THE LOCATION OF ALL TREES ARE DIAGRAMMATIC. FINAL LOCATION TO BE DETERMINED IN THE FIELD BY THE LANDSCAPE ARCHITECT. 3. ALL TREES SHALL BE LOCATED A MINIMUM OF 5' CLEAR OF THE EDGE OF ALL PAVING AND WALLS, SIGNAGE, AND PERMANENT SITE FEATURES. NICHOLAS CALDERON, DIRECTOR OF PARKS 4. REFER TO THE PLANT LIST FOR PLANT SIZES. REFER TO THE SPECIFICATIONS FOR SOIL PREPARATION, SOIL AMENDMENTS, FERTILIZER AND ADDITIONAL PLANTING REQUIREMENTS. 5. ALL PLANTS MUST BE SOURCED FROM LOCAL NATIVE PLANT NURSERIES WITHIN SAN MATEO COUNTY. SEE CIVIL DRAWINGS FOR EXISTING TREE PROTECTION. SHEET MULCH ONLY: SEE DETAIL 5, SHEET L-SHEET MULCH ONLY: SEE DETAIL 5, SHEET L-7 NATIVE EROSION CONTROL SEED MIX - SEE TABLE. EXTEND SHEET MULCH SEEDING TO LIMIT OF GRADING ONLY: SEE DETAIL 5, SHEET L-7 Plant Legend LEGEND Coyote Point Recreation Area Eastern Promenade, San Mateo County, California CEANOTHUS THYRSIFLORUS Rotanical Name Common Name Spacing Area DESCHAMPSIA CESPITOSA SSP. HOLCIFORMUS MUHLENBERGIA RIGENS ACCENT PLANTING AREA SCREEN PLANTING AREA INTERIOR BIOSWALE PLANTING AREA PERIMETER BIOSWALE PLANTING AREA NATIVE EROSION CONTROL SEED MIX

Botanical Name	Common Name	Size	Spacing	Area	
SHORELINE					
Deschampsia cespitosa ssp holciformis SHORELINE	Pacific Hairgrass	1 GAL	2.5'	100% Cover	
Muhlenbergia rigens	Deergrass	1 GAL	3.0'	100% Cover	
Ceanothus thyrsiflorus var. repens	Creeping Blue Blossom	1 GAL	6.5'	100% Cover	
Artemisia californica	California Sagebrush	5 GAL	3.5'	Accent - 20% Cover	
Eriogonum latifolium	Coastal Buckwheat	5 GAL	3.5'	Accent - 20% Cover	
Lupinus albifrons	Silver Bush Lupine	5 GAL	3.5'	Accent - 20% Cover	
Mimulus aurantiacus	Sticky Monkey Flower	5 GAL	3.5'	Accent - 20% Cover	
Ribes sanguineum	Flowering Currant	5 GAL	3.5'	Accent - 20% Cover	
BIOSWALES					
Carex densa	Dense Sedge	1 GAL	1.5'	Interior - 20% Cover	
Eleocharis macrostachya	Creeping Spikerush	1 GAL	1.5'	Interior - 20% Cover	
Hordeum brachyantherum	Meadow Barley	1 GAL	1.5'	Interior - 20% Cover	
Juncus phaeocephalus	Brown Headed Rush	1 GAL	1.5'	Interior - 20% Cover	
Potentilla anserina	Silver wees Cinquefoil	1 GAL	1.5'	Interior - 10% Cover	
Sisyrinchium californicum	California Golden-eyed Grass	1 GAL	1.5'	Interior - 10% Cover	
Juncus patens	Blue Rush	1 GAL	3.0'	Perimeter - 50% Cover	
Muhlenbergia rigens	Deergrass	1 GAL	3.0'	Perimeter - 50% Cover	
BLUFFS					
Frangula californica	California Coffeeberry	5 GAL	7.0'	Screen - 50% Cover	
Heteromeles arbutifolia	Toyon	5 GAL	7.0'	Screen - 50% Cover	
Hesperocyparis macrocarpa	Monterey Cypress	15 GAL	30.0'		

Note: Species within Accent, Interior Bioswale, and Screen Planting Areas shall be installed in clumps of 2-3 plants of eacch species to

create a natural appearancce, as directed by the Landscape Architect.

APPROVED DATE: 12/31/2020
Renewal Date
04/06/2020
Date
OF CALIFORNIA RICHARD J. LARSON, DIRECTOR RLA # 2042 / EXPIRES 12/31/2020



**BOTANTICAL NAME** 

Eschscholzia californica

Hordeum californicum

Achillea millifolium

Bromus carinatus

Elymus glaucus

Leymus triticoides

Sisyrinchium bellum

Vulpia microstachys

Lupinus nanus



**COMMON NAME** 

Common yarrow

California Brome

California poppy

California Barley

Creeping Wildrye

Western blue eyed grass

Three Weeks Fescue

Blue Wildrye

Sky lupine

Note 1) See specifications for seed product and application requirements.

0		
_ /	REVISION	DA
2/		FOR

	EEE COLIN
DRAWN BY: MB	PLANTING PLAN
CHECKED BY: MG	EASTERN PROMENADE REJUVENATION PROJ
DESIGNED BY: MB	COYOTE POINT RECREATION AREA

SCALE: 1" = 20'-0" PROJECT DATE: 4/9/2020 FILE NO.: E4948

NATIVE EROSION CONTROL

(E) TREE TO BE PROTECTED

HESPEROCYPARIS

*MACROCARPA* 

SEED MIX - MIX TO BE DETERMINED

LIMIT OF WORK / GRADING - SEE CIVIL PLANS

555 COUNTY CENTER, 5th FLOOR JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS SAN MATEO COUNTY REDWOOD CITY, CALIFORNIA 94063 L-4 FOR REDUCED PLANS ORIGINAL SCALE IS IN INCHES SHEET **35** OF 59

**POUNDS PURE LIVE SEED / ACRE** 

1.0

10.0

8.0


1.5


8.00 5.00


4.0

3.0

6.00

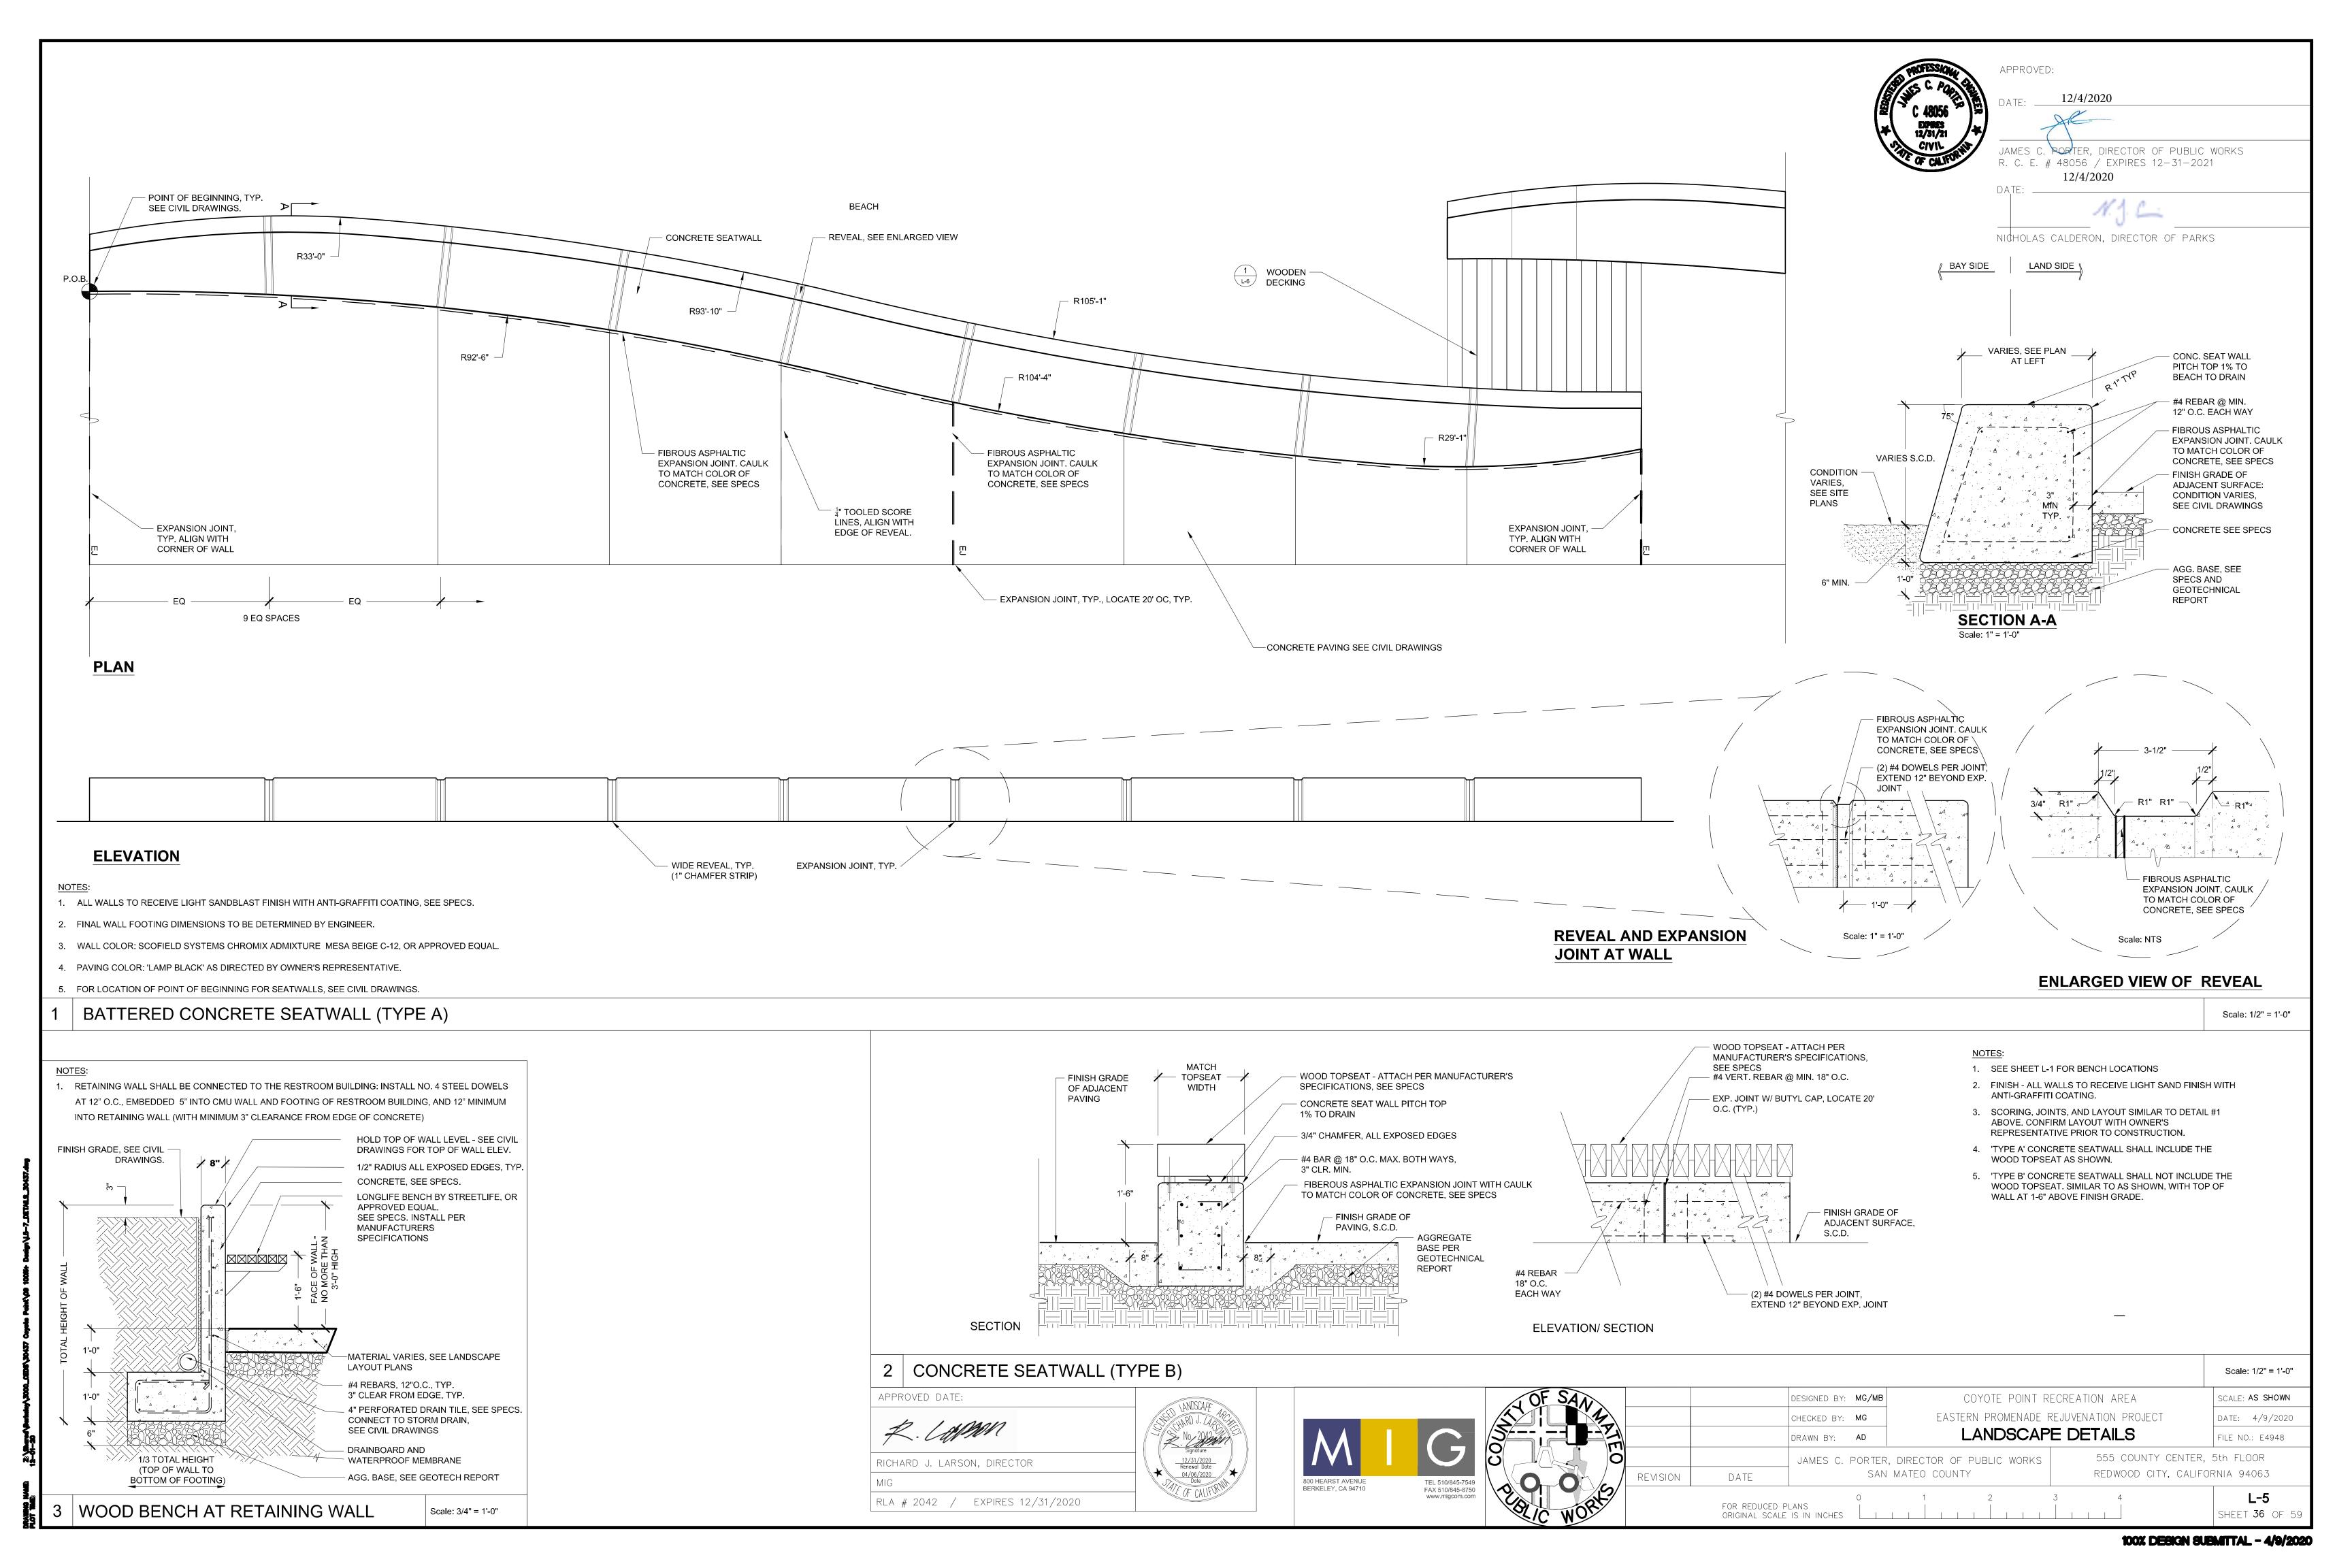

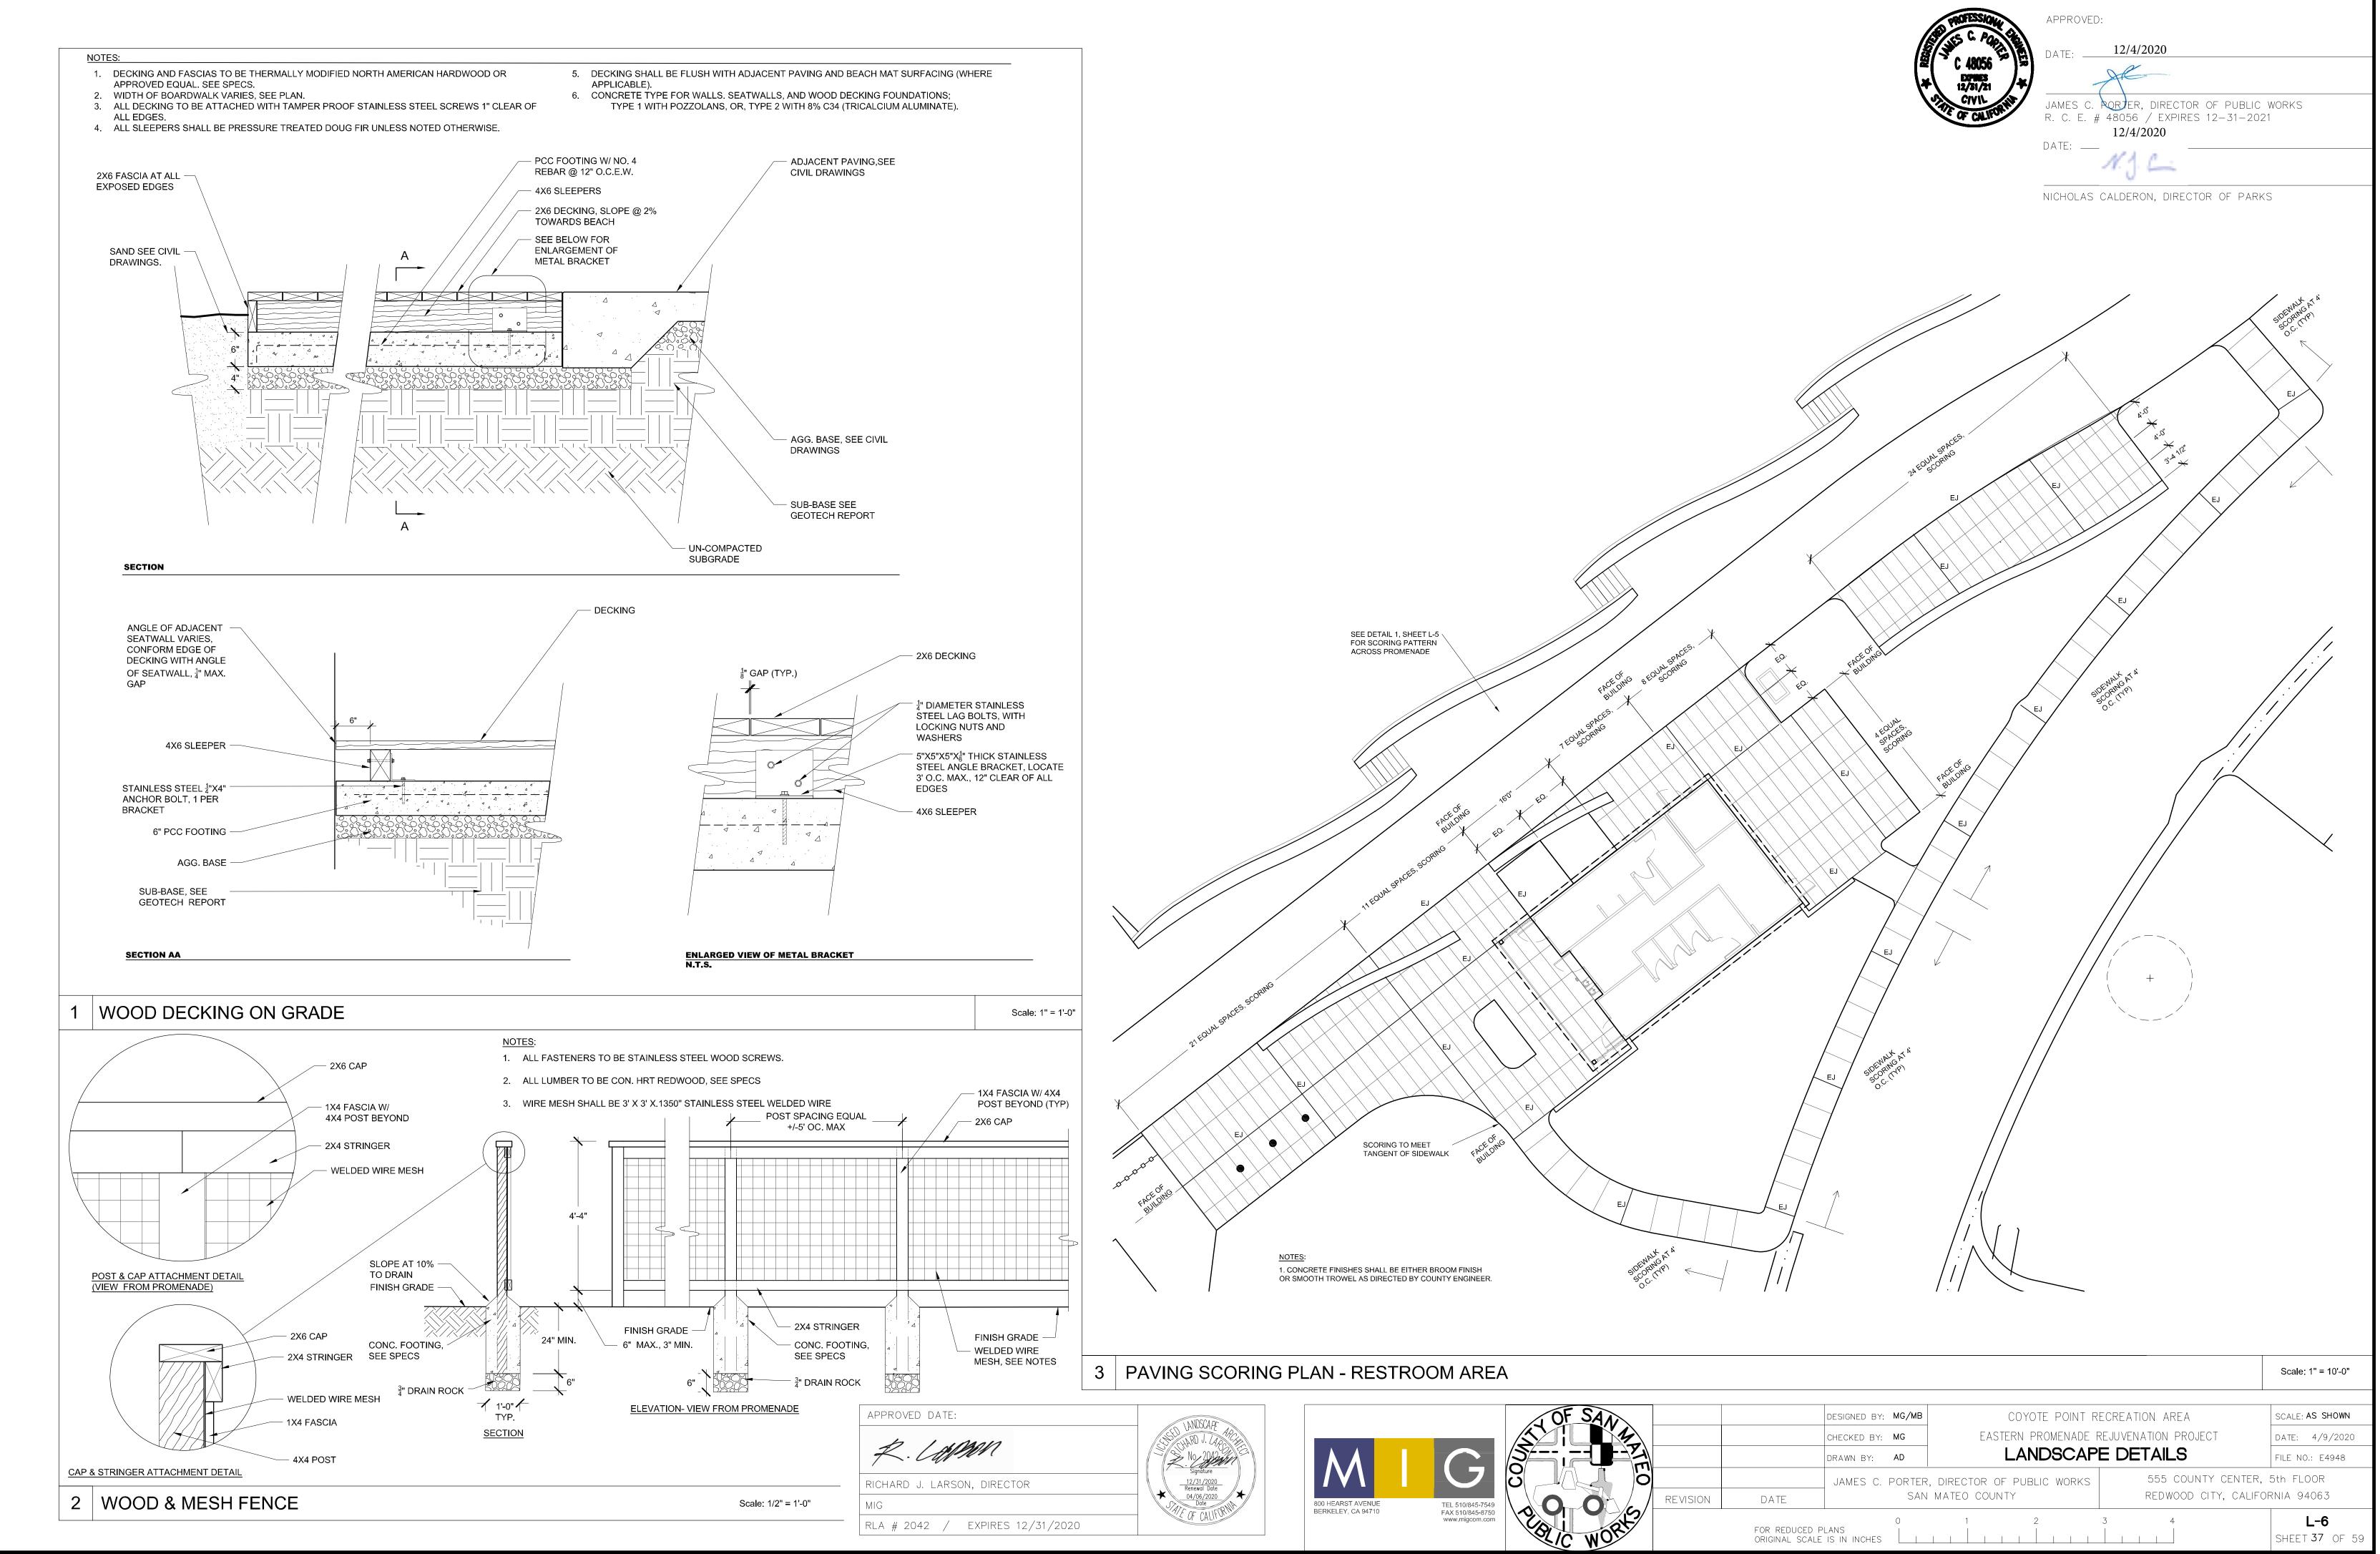

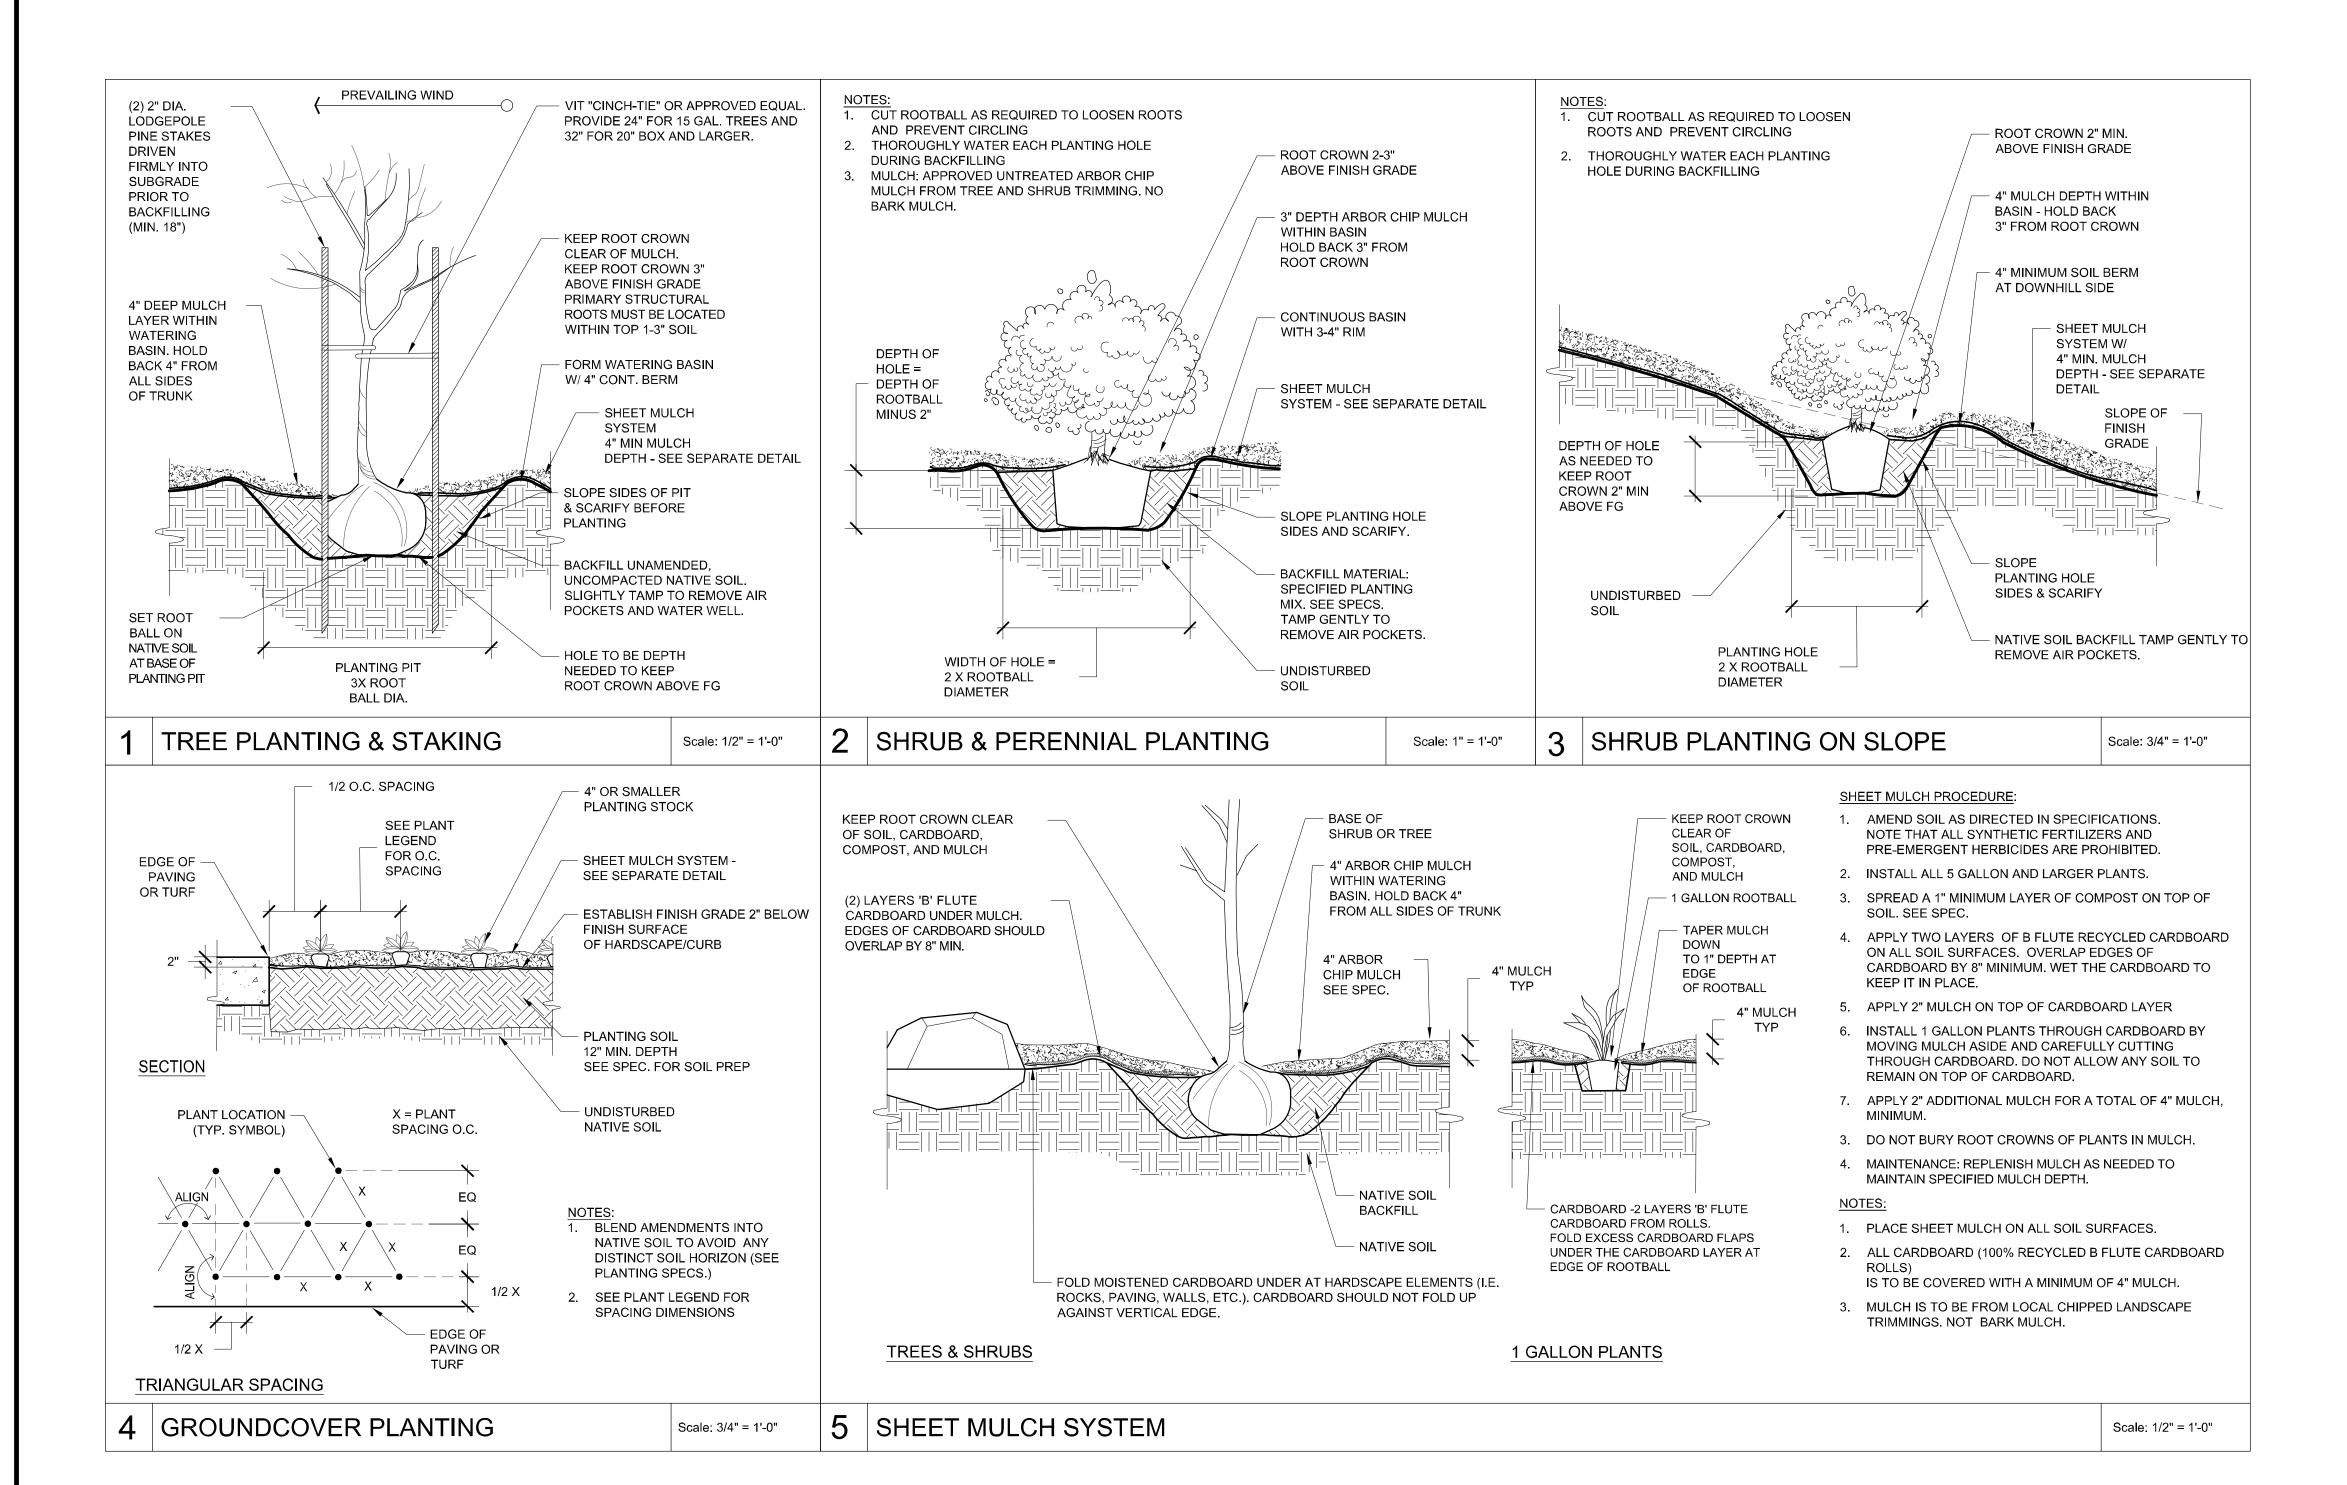



APPROVED:

DATE: <u>12/4/20</u>20


12/4/2020


JAMES C. RORTER, DIRECTOR OF PUBLIC WORKS

R. C. E. # 48056 / EXPIRES 12-31-2021

NICHOLAS CALDERON, DIRECTOR OF PARKS



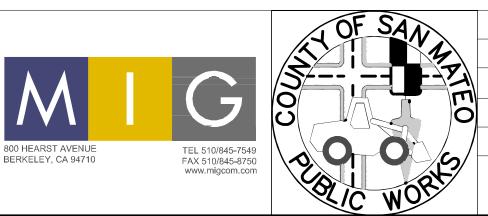

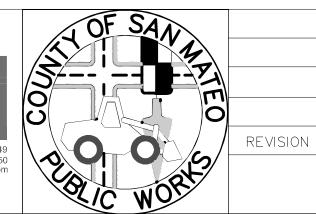

AD_	
DRAWN BY:	LANDSCAF
CHECKED BY:	EASTERN PROMENAD
DESIGNED BY:	COYOTE POINT

DATE

FOR REDUCED PLANS ORIGINAL SCALE IS IN INCHES

SAN MATEO COUNTY

IT RECREATION AREA DE REJUVENATION PROJECT

DATE: 4/9/2020 FILE NO.: E4948 APE DETAILS 555 COUNTY CENTER, 5th FLOOR JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS REDWOOD CITY, CALIFORNIA 94063

> L-7 HEET OF 59 100% DESIGN SUBMITTAL - 4/9/2020

SCALE:
AS SHOWN

	NETAFIM	EMITTERS	POINT SOURCE EMITTERS	30	0.50 GPH	NA			3-4/L-12	
OVERHEAD IR	RIGATION LEG	SEND								
SVMPOL		Г	DESCRIPTION	NOZZLE	OPERATING PSI	RADIUS	MAX	KIMUM FLO	W	DETAIL(S)
STIMBOL	SYMBOL DESCRIPTION		NOZZLE	OPERATING F31	RADIOS	90°	180°	360°	DETAIL(5)	
•					30	4'	0.13	0.45	0.80	
0				6A	30	6'	0.37	0.60	1.26	
$\bigcirc$		LILINITED DI		8A	30	8'	0.44	0.88	1.76	2/1 42
		HUNTER PRO ADJUSTABLE NOZZLE			30	10'		1.00	2.00	2/L-12
0					30	12'		1.26	2.52	
•					30	15'		1.86	3.72	

#### GENERAL IRRIGATION LEGEND SLEEVING: MAINLINE PIPE SLEEVE QUANTITY LATERAL PIPE SLEEVE QUANTITY WIRE SLEEVE QUANTITY (#) W (#) S EMPTY SLEEVE QUANTITY VALVE CALLOUT CONTROLLER NUMBER GALLONS PER MINUTE ☐ VALVE SIZE SUB - SUBSURFACE DRIP DRP - POINT SOURCE DRIP **RWS - TREE ROOT WATERING SYSTEM** SPR - OVERHEAD SPRAY PIPE SIZING CALLOUT


— LIMIT-OF-WORK

#### **GENERAL NOTES**

- 1. REFER TO THE IRRIGATION DETAIL SHEETS AND THE IRRIGATION TECHNICAL SPECIFICATIONS AS PART OF THESE CONSTRUCTION DOCUMENTS AND FOR ADDITIONAL INFORMATION.
- 2. ALL MAINLINE, LATERAL PIPE, VALVES, AND OTHER IRRIGATION SYSTEM APPURTENANCES SHOWN IN PAVED AREA IS FOR GRAPHICAL CLARITY ONLY. CONTRACTOR TO PLACE MAINLINE, LATERAL PIPE, VALVES AND ALL IRRIGATION APPURTENANCES WITHIN ADJACENT PLANTING AREAS.
- 3. CONTRACTOR SHALL ROUTE ALL IRRIGATION MAINLINE, LATERAL PIPE AND SLEEVES AROUND ALL SERVICE LINES, UTILITIES, STORM DRAINAGE FACILITIES, ETC. IN ORDER TO AVOID ANY CONFLICTS IN THE FIELD. INSTALL IRRIGATION PIPE BELOW STORM DRAINAGE PIPES WHERE REQUIRED TO MAINTAIN THE MINIMAL DEPTH REQUIREMENTS.



- THE IRRIGATION SYSTEM DESIGN IS BASED ON A MINIMUM EXISTING AVERAGE STATIC PRESSURE OF 70 PSI AT THE POINT OF CONNECTION AND A MAXIMUM DEMAND OF 42 GALLONS PER MINUTE (GPM). THE CONTRACTOR SHALL PROVIDE A STATIC PRESSURE TEST AT THE POC FOR APPROVAL BY AGENCY'S REPRESENTATIVE PRIOR TO ORDERING MATERIALS AND PRIOR TO CONSTRUCTION. CONTRACTOR SHALL REPORT ANY DIFFERENCE BETWEEN THE WATER PRESSURE INDICATED ON THE DRAWINGS AND THE ACTUAL PRESSURE READING AT THE IRRIGATION POINT OF CONNECTIONS TO THE AGENCY'S REPRESENTATIVE. IN THE EVENT PRESSURE DIFFERENCES ARE NOT REPORTED PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR ANY REVISIONS NECESSARY.
- THESE DRAWINGS ARE DIAGRAMMATIC AND INDICATIVE OF THE WORK TO BE INSTALLED. DUE TO THE SCALE OF THE DRAWINGS, IT IS NOT POSSIBLE TO SHOW ALL OFFSETS, FITTINGS, AND MISC. EQUIPMENT WHICH MAY BE REQUIRED FOR A COMPLETE SYSTEM. THE CONTRACTOR IS REQUIRED TO INVESTIGATE THE STRUCTURAL AND FINISHED CONDITIONS AFFECTING ALL OF THE CONTRACT WORK INCLUDING OBSTRUCTIONS, GRADE DIFFERENCES OR AREA DIMENSIONAL DIFFERENCES WHICH MAY NOT HAVE BEEN CONSIDERED IN THE PREPARATION OF THESE PLANS. IN THE EVENT OF FIELD DIFFERENCES. THE CONTRACTOR IS REQUIRED TO PLAN THE INSTALLATION WORK ACCORDINGLY BY NOTIFICATION AND APPROVAL OF THE AGENCY'S REPRESENTATIVE. ALL DIMENSIONS, QUANTITIES AND MATERIALS SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION. IN THE EVENT NOTIFICATION IS NOT PERFORMED. THE CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR ANY REVISIONS NECESSARY.
- THE CONTRACTOR IS REQUIRED TO NOTIFY AND COORDINATE LANDSCAPE IRRIGATION CONTRACT WORK WITH ALL APPLICABLE CONTRACTORS AND TRADES FOR THE LOCATION AND INSTALLATION OF PIPE, CONDUIT, AND SLEEVES THROUGH OR UNDER WALLS, ROADWAYS, PAVING, STRUCTURES, ETC., BEFORE CONSTRUCTION. IN THE EVENT THESE NOTIFICATIONS ARE NOT PERFORMED, THE CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR ALL REQUIRED REVISIONS.
- IRRIGATION COMPONENTS SHOWN WITHIN PAVED AREAS ARE FOR GRAPHIC CLARITY ONLY. PLACE ALL PIPING, VALVES, QUICK COUPLING VALVES, AND OTHER IRRIGATION COMPONENTS WITHIN ADJACENT PLANTING AREAS EXCEPT WHERE PIPES CROSS PAVING OR AS NOTED. AVOID ANY CONFLICTS BETWEEN THE IRRIGATION SYSTEM AND TREES, PLANTINGS, SITE FEATURES AND UTILITIES INCLUDING STORM DRAINAGE.
- INSTALLATION OF THE IRRIGATION SYSTEM UNDER THIS CONTRACT SHALL CONFORM TO ALL LOCAL, COUNTY, AND STATE PROVISIONS, INCLUDING THOSE STATED IN THE LATEST EDITION OF THE CALIFORNIA PLUMBING CODE. AND THE NATIONAL ELECTRIC CODE. IN THE EVENT OF DIFFERENCES BETWEEN THE CODE COMPLIANCE REQUIREMENTS OF THIS CONTRACT. THE BETTER QUALITY, HIGHER STANDARD, LARGER SIZE, AND MORE STRINGENT REQUIREMENT SHALL PREVAIL,
- PRIOR TO ANY TRENCHING THE CONTRACTOR SHALL ASCERTAIN THE LOCATION OF ALL NEW AND EXISTING UNDERGROUND UTILITY LINES. CALL 811 A MINIMUM OF FORTY-EIGHT (48) HOURS PRIOR TO THE START OF CONSTRUCTION.
- THE INTENT OF THIS IRRIGATION SYSTEM IS TO PROVIDE THE MINIMUM AMOUNT OF WATER TO MAINTAIN GOOD PLANT HEALTH. APPEARANCE AND REASONABLE GROWTH. THE AMOUNT OF SUPPLEMENTAL WATER A PLANT REQUIRES IS DEPENDENT ON SOIL TYPE, PLANT MATERIAL, ROOTING DEPTH, CLIMATE, SEASONAL CHANGES, SLOPES, MOUNDS, SUN, SHADE AND WIND. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ADJUST THE IRRIGATION SCHEDULE AND ET VARIABLES AS NEEDED. IN ADDITION, THE CONTRACTOR SHALL PROVIDE SUPPLEMENTAL WATER TO ACCOMMODATE SPECIAL WATERING NEEDS OF PLANT MATERIAL THROUGH THE MAINTENANCE PERIOD. ACTUAL STATION RUN TIMES MAY VARY IN ACCORDANCE WITH VARYING SITE CONDITIONS.
- CONTRACTOR SHALL ADJUST THE PLACEMENT OF THE DRIPLINE LAYOUT AS PER ACTUAL FIELD CONDITIONS TO ACHIEVE FULL COVERAGE OF ALL PLANTED AREAS. THE CONTRACTOR WILL BE RESPONSIBLE OF INSTALLING ADDITIONAL DRIPLINE. AS NEEDED, TO PROVIDE ADEQUATE COVERAGE, AT NO ADDITIONAL COST TO THE CLIENT. REFER TO IRRIGATION EQUIPMENT LEGEND FOR MAXIMUM ALLOWED VERTICAL DRIPLINE SPACING.
- IRRIGATION SYSTEM SHALL BE OPERATIONAL & COVERAGE APPROVED BY THE AGENCY'S REPRESENTATIVE PRIOR TO INSTALLATION OF PLANTING MATERIAL.
- 10. THE CONTRACTOR SHALL FLUSH ALL EMISSION EQUIPMENT FOR OPTIMUM PERFORMANCE TO PROVIDE OPTIMAL EVEN DISTRIBUTION OF WATER, AND TO PROVIDE PROPER COVERAGE

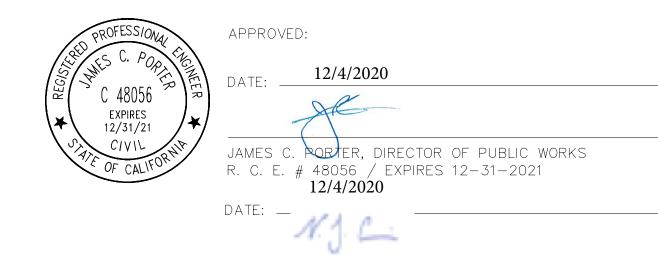

- 11. SUBSURFACE EMITTER FLOW RATE, EMITTER SPACING AND LATERAL SPACING IS BASED ON TYPICAL SOILS ENCOUNTERED IN THE AREA THE CONTRACTOR SHALLS MAKE ANY MODIFICATION TO EMITTER FLOW RATE. EMITTER SPACING. AND LATERAL SPACING AS REQUIRED TO COMPLY WITH MANUFACTURER'S RECOMMENDATIONS FOR AN EVEN WETTED PATTERN, BASED ON ACTUAL SOIL ANALYSIS. REFER TO DRIPLINE MANUFACTURER RECOMMENDATIONS FOR ADDITIONAL INFORMATION. FINAL EMITTER SPACING AND FLOW RATE TO BE APPROVED BY THE CLIENT REPRESENTATIVE.
- 12. DRAINAGE OF IRRIGATION WATER THROUGH DRIP EMITTERS WILL NOT BE ALLOWED. DURING THE COURSE OF CONSTRUCTION, THE CONTRACTOR SHALL INSTALL ADDITIONAL IN-LINE CHECK VALVES AS REQUIRED IN ANY AREA WHERE EMISSION DEVICES SHOW SIGNS OF DRAINAGE AFTER IRRIGATION SYSTEM HAS OPERATED FROM AN ON TO OFF POSITION. INSTALLATION OF ADDITIONAL IN-LINE CHECK VALVES SHALL BE INCLUDED IN THE BID PRICE WITHOUT ADDITIONAL COST TO THE CLIENT.
- 13. CONTRACTOR SHALL ADJUST THE DRIPLINE LAYOUT, WHEN PLANTER SLOPE IS GREATER THAN 5 PERCENT, TO PROVIDE LATERAL ROW SPACING THAT IS 25 PERCENT GREATER WITHIN THE BOTTOM ONE-THRID OF THE SLOPE.
- 14. LOCATIONS AND THE QUANTITIES OF FLUSH VALVES AND AIR/VACUUM RELIEF VALVES (AVRV) SHOWN ON PLANS ARE APPROXIMATE. CONTRACTOR IS RESPONSIBLE FOR VERIFYING HIGHEST POINTS OF EACH HYDROZONE AND LOCATING AVRV'S AS REQUIRED AND FOR INSTALLING ADDITIONAL FLUSH VALVES, AS NEEDED, ACCORDING TO MANUFACTURER'S GALLONS PER HOUR REQUIREMENTS PER HYDROZONE AT NO ADDITIONAL COST TO THE CLIENT.
- 15. ALL VALVES PROVIDING IRRIGATION TO SLOPES AREAS SHALL BE SCHEDULED IN MULTIPLE, SHORT CYCLES TO HELP ELIMINATE IRRIGATION WATER RUNOFF.
- 16. ALL IRRIGATION EQUIPMENT SHALL BE AS LISTED OR EQUAL AS APPROVED BY THE AGENCY'S REPRESENTATIVE.
- 17. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY AND COORDINATE AND PROVIDE THE FINAL CONNECTION OF THE CONTROLLER TO ITS DEDICATED POWER SOURCE. ALL ELECTRICAL WORK SHALL BE PERFORMED BY A LICENSED ELECTRICAL CONTRACTOR AND SHALL CONFORM TO THE LATEST EDITION OF THE N.E.C. AND ALL STATE AND LOCAL CODES AND REGULATIONS.
- 18. SEE IRRIGATION DETAILS, TECHNICAL SPECIFICATIONS AND PLANTING PLANS AS PART OF THESE CONSTRUCTION DOCUMENTS.
- 19. SEE CIVIL FOR EXISTING TREE PROTECTION.

PIPE SIZIN	PIPE SIZING CHART										
(FOR REFER	(FOR REFERENCE ONLY)										
SCHEDULE 40 IPS U.S	S. PVC PLASTIC PIPE										
SIZE	GALLONS PER MINIMUM (GPM)										
0.75"	1-3										
1"	3-6										
1.25"	6-12										
1.5"	12-18										
2"	18-30										


	LEEVING CHART ERENCE ONLY)
PVC SLEEVE SIZE (PVC SCH. 40 PVC)	IRRIGATION PIPE/ WIRING CONDUIT MAXIMUM SIZE
1.25"	N/A
1.5"	0.5"
2"	0.75"
2.5"	1"
3"	1.25"
4"	1.25" - 2"
6"	2.5" - 3"
8"	4"
12"	6"

MAX	MAXIMUM NUMBER OF WIRES TO BE INSTALLED  SLEEVING OR CONDUIT  (FOR REFERENCE ONLY)												
	CONDUIT / SLEEVE SIZE												
WIRE SIZE	1.25"	1.5"	2"	2.5"	3"	4"	6"						
		MAXI	MUM AMO	UNT OF W	IRES ALLC	WED							
14	1 - 18	25	40	56	88	120	120+						
12	1 - 15	20	33	50	75	102	102+						
10	1 -13	16	27	40	63	85	85+						









DESIGNED BY: JJL CHECKED BY: MG

ORIGINAL SCALE IS IN INCHES

DATE


REVISION


COYOTE POINT RECREATION AREA EASTERN PROMENADE REJUVENATION PROJECT IRRIGATION LEGEND AND NOTES


SCALE: 1" = 20'-0"DATE: 4/9/2020 FILE NO.: E4948

555 COUNTY CENTER, 5th FLOOR JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS REDWOOD CITY, CALIFORNIA 94063 SAN MATEO COUNTY

SHEET **39** OF 59

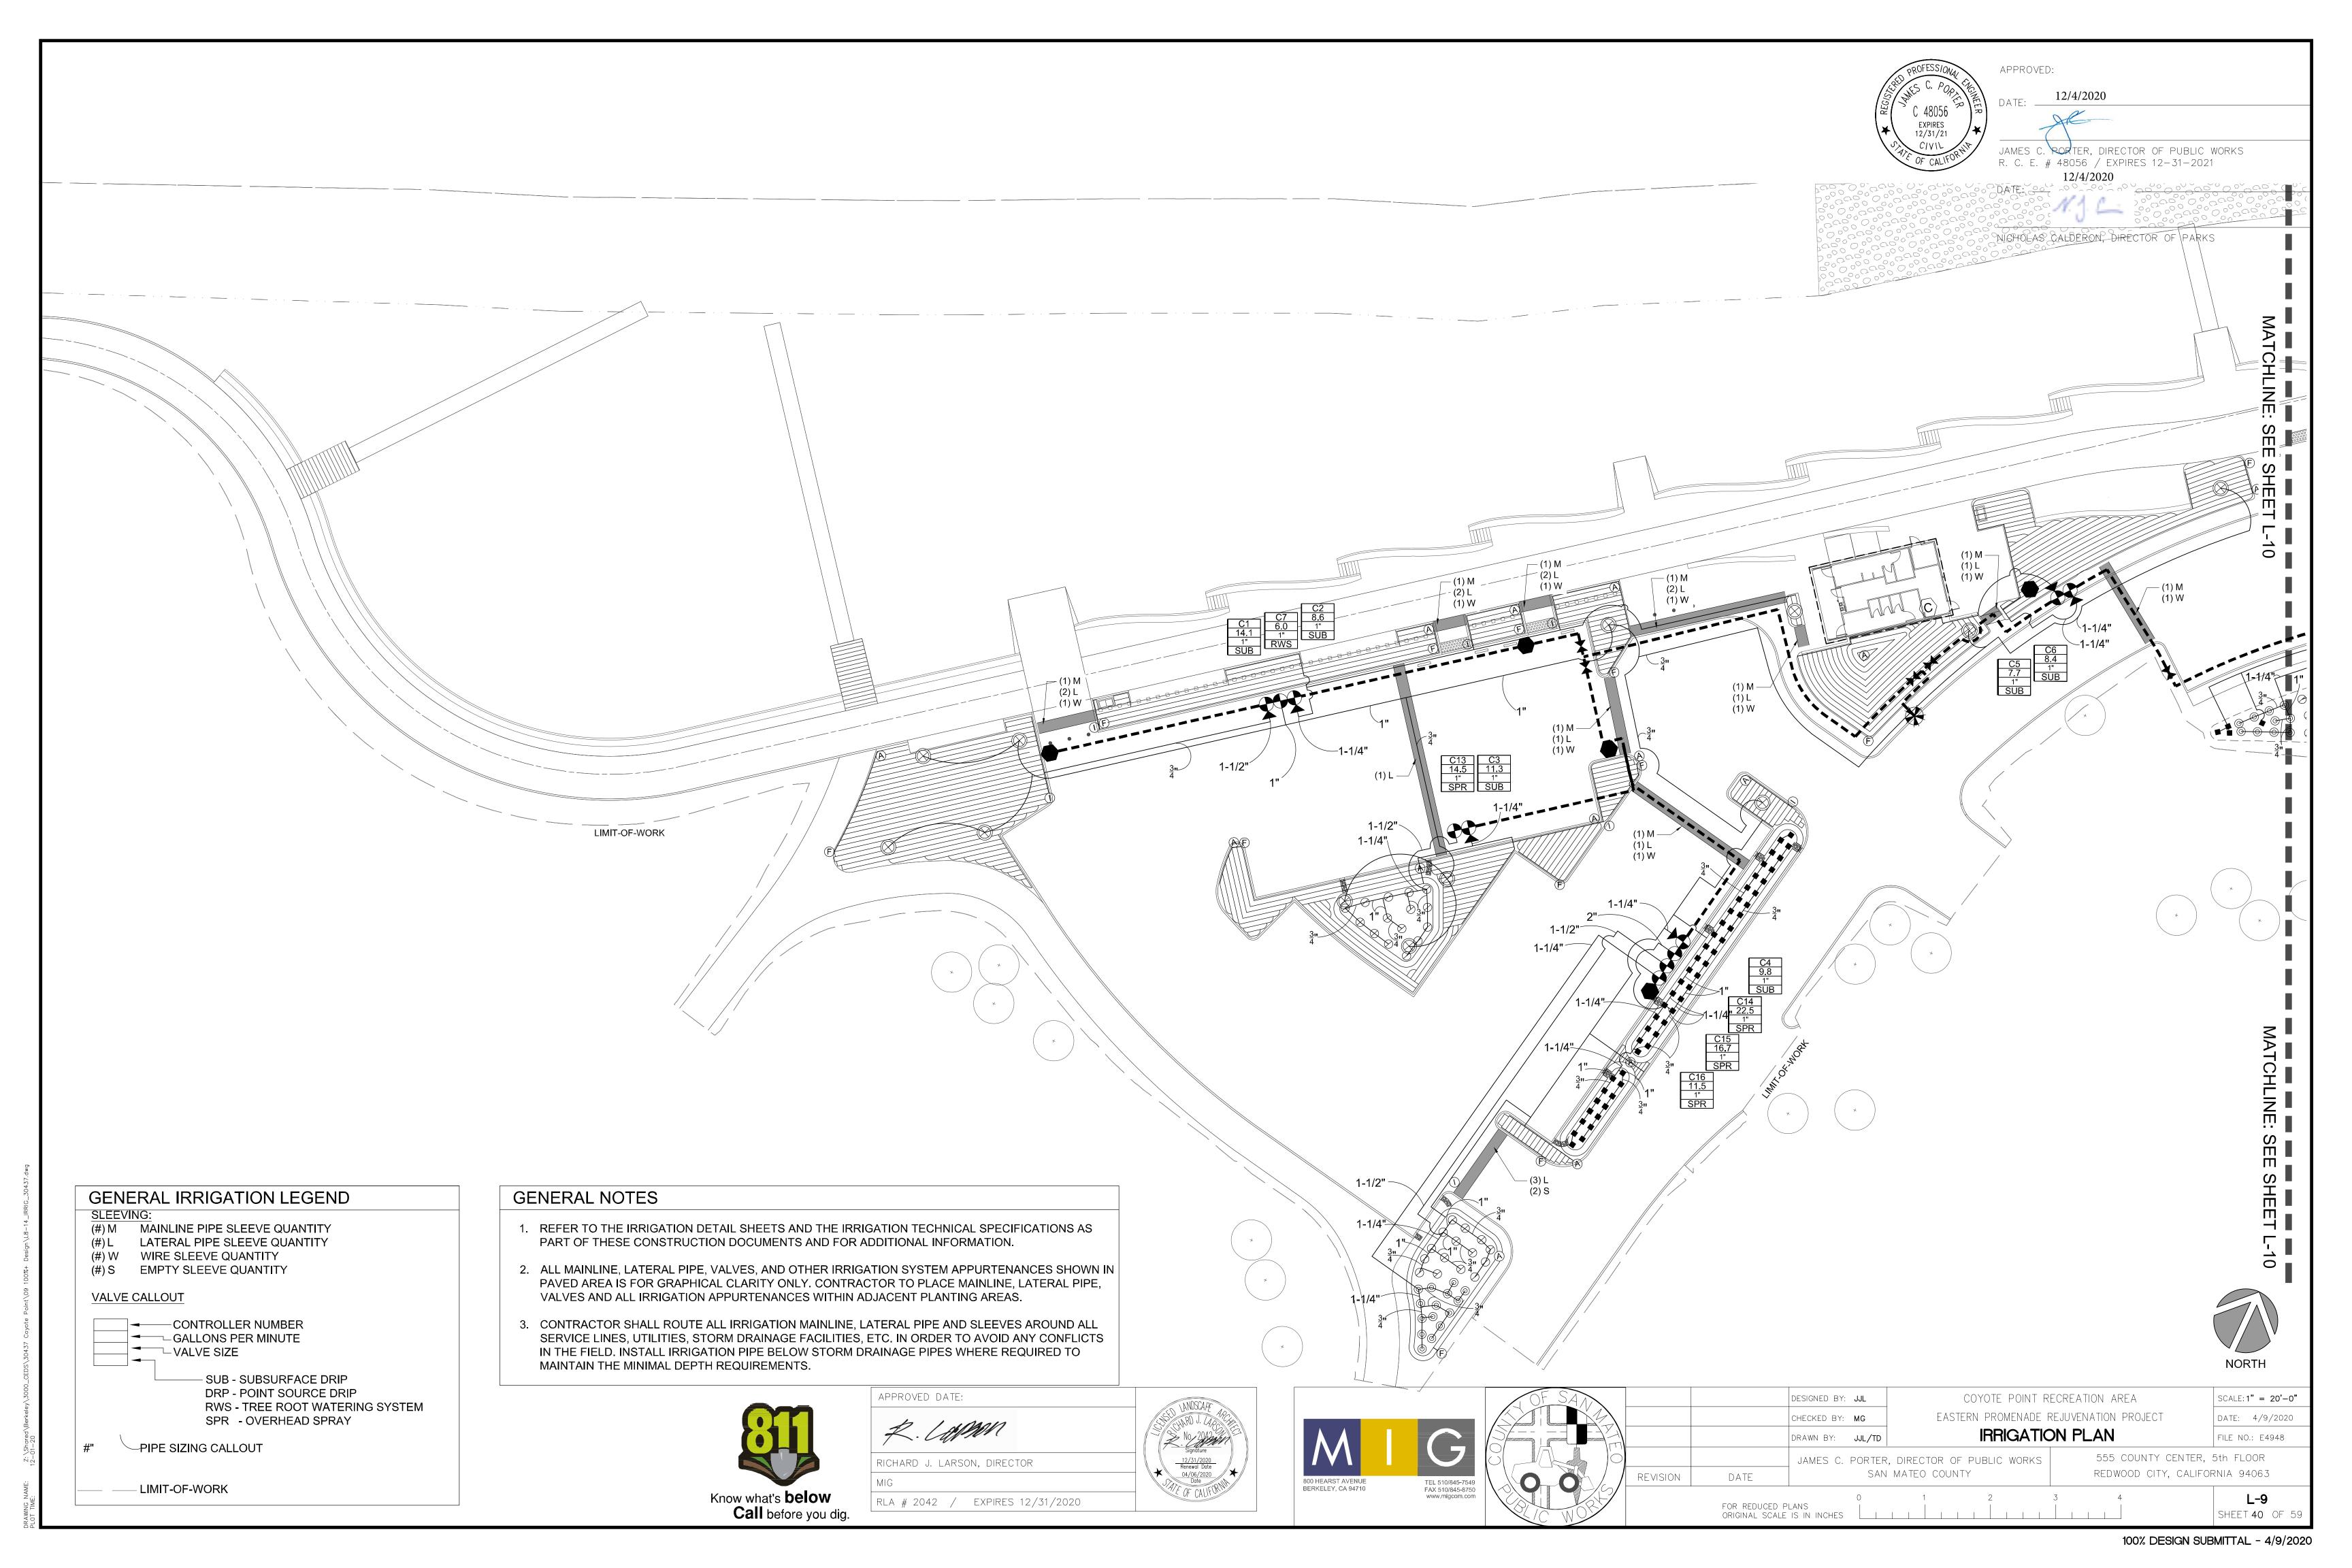

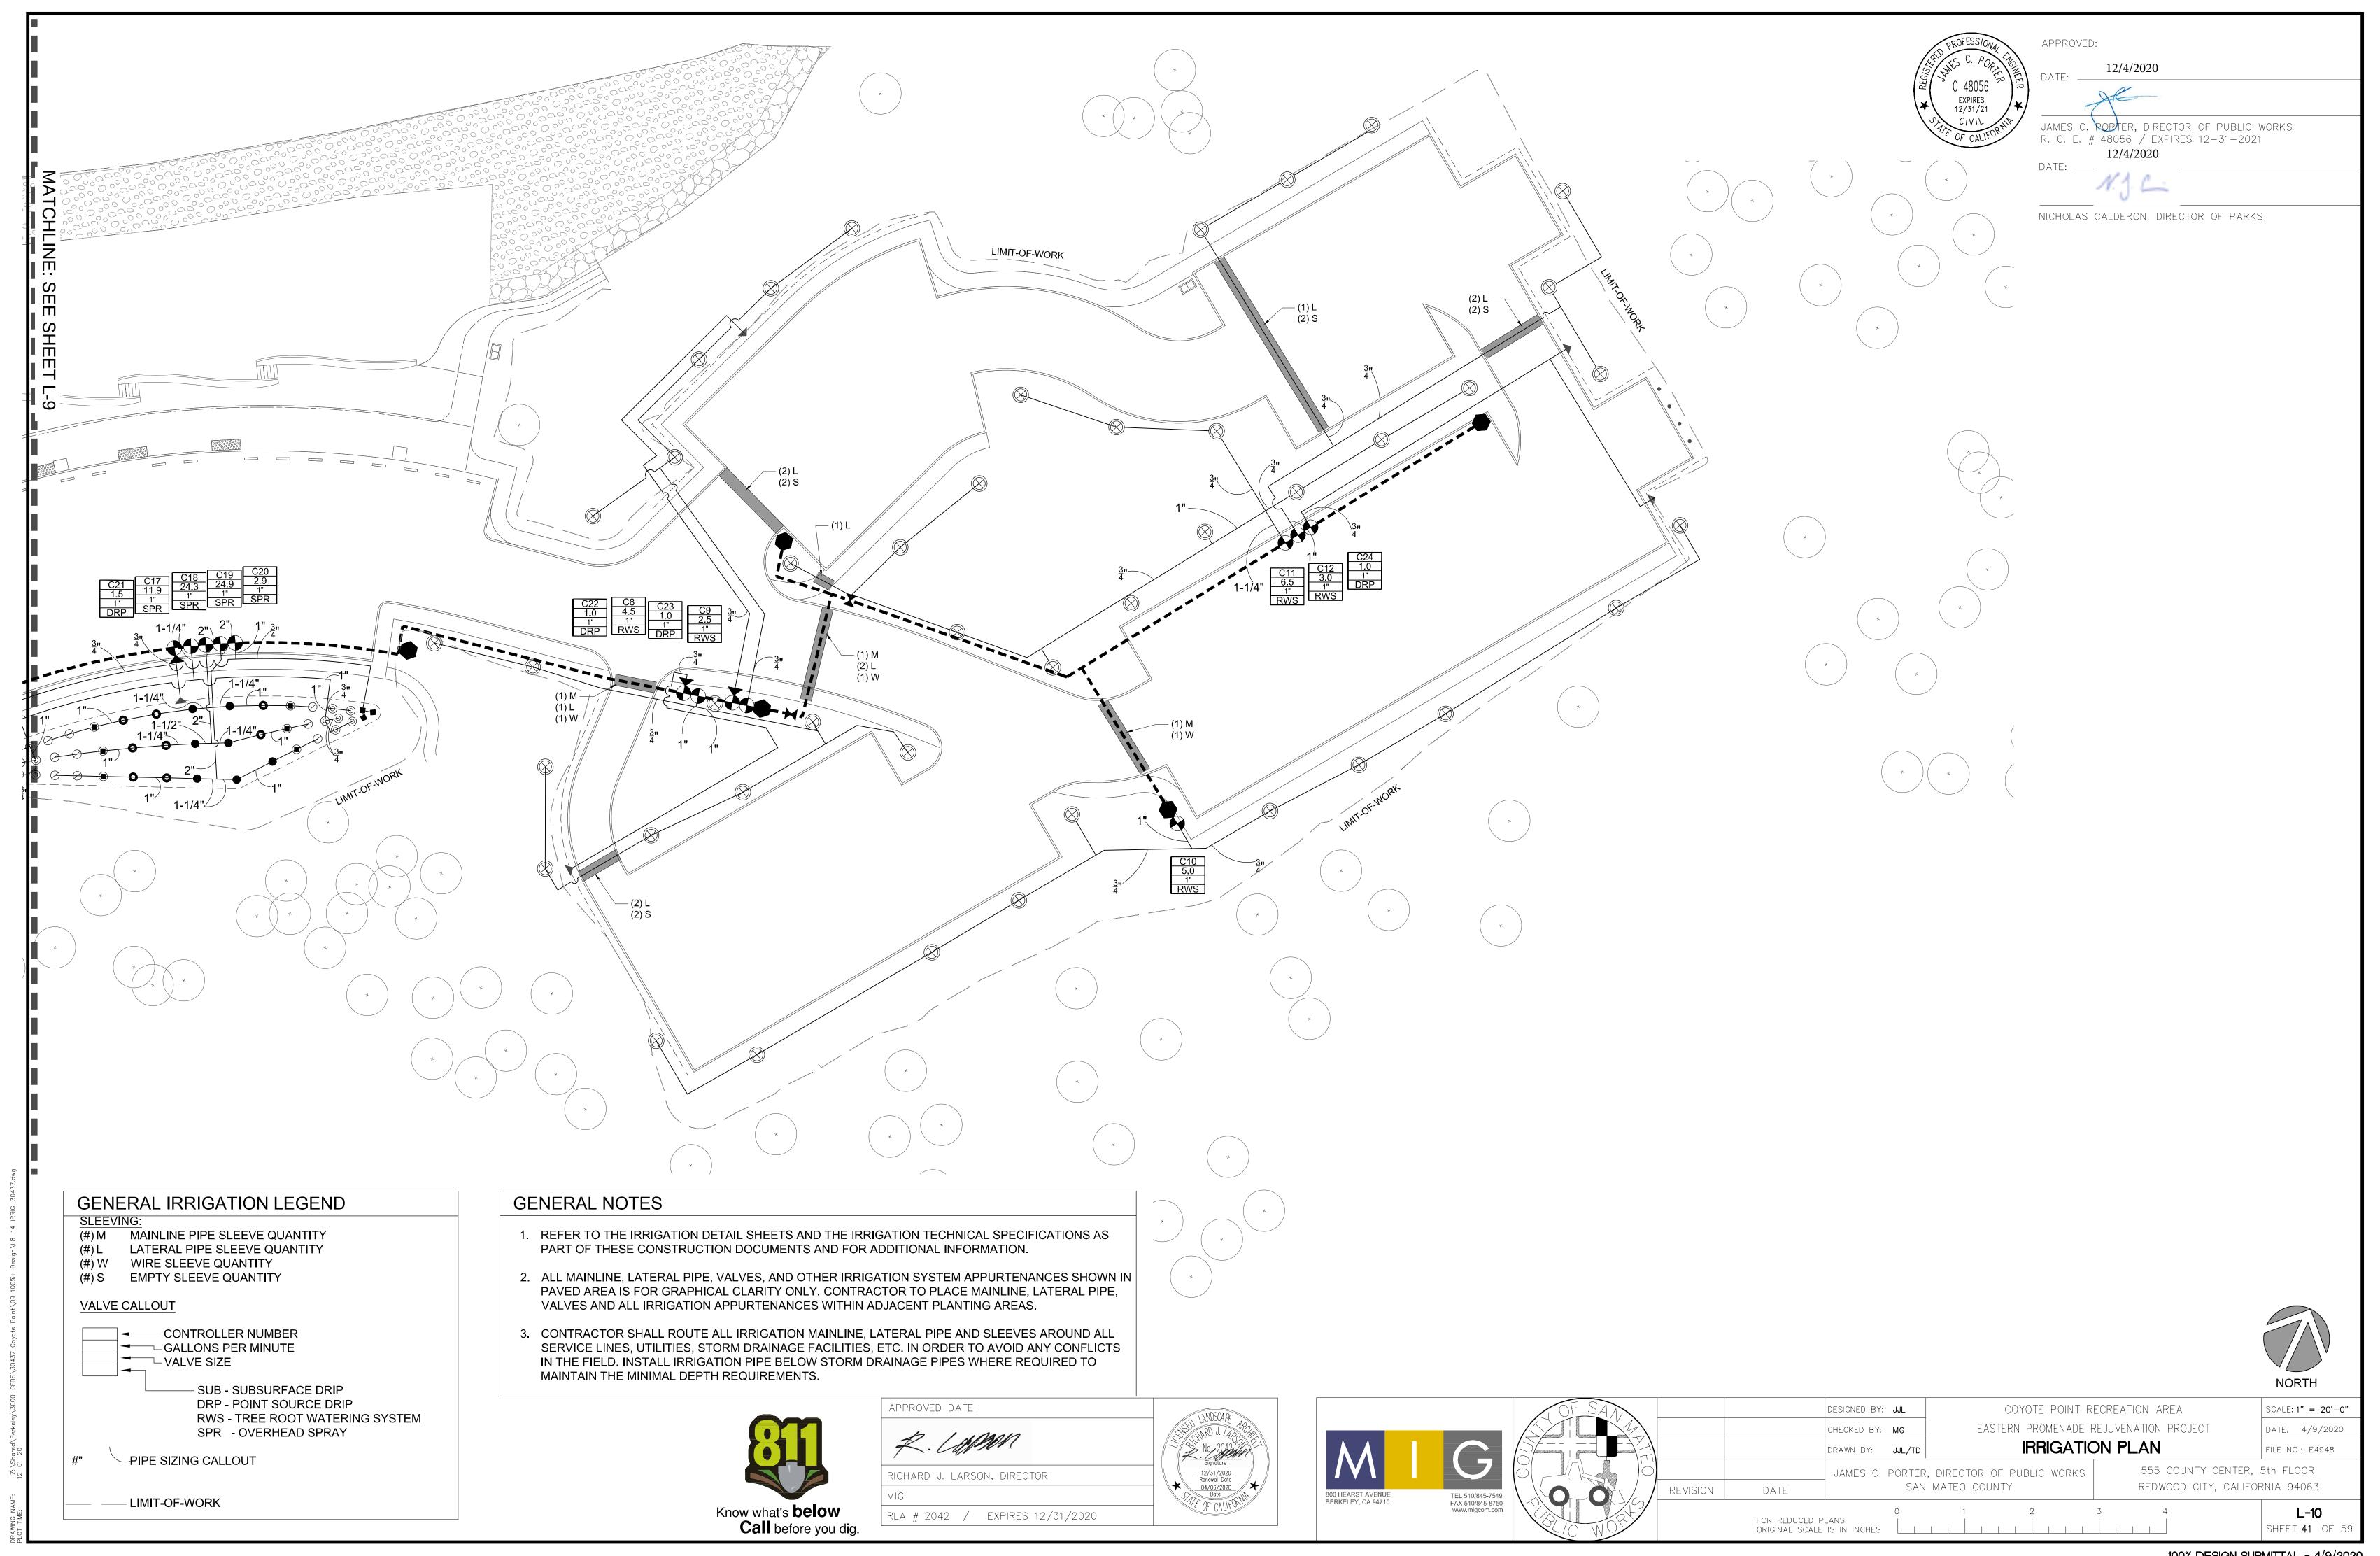

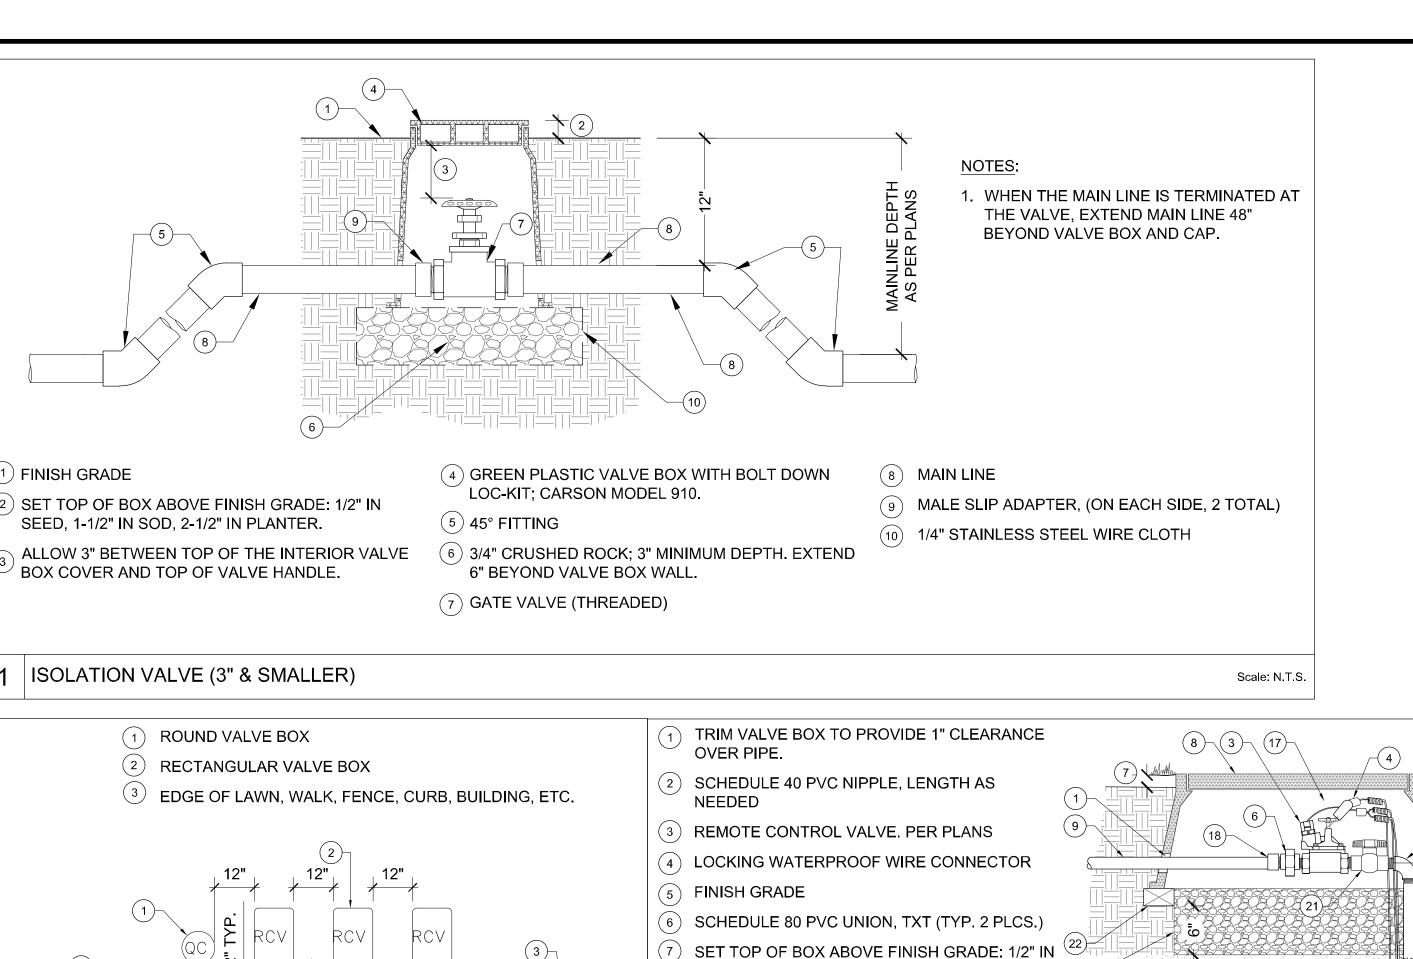

(12) SCHEDULE 80 PVC T.O.E. NIPPLE AT MAINLINE (13) PRESSURE MAINLINE. 18" MINIMUM COVER. (14) 3/4" CRUSHED ROCK; 6" DEPTH MINIMUM. (15) SCHEDULE 80 PVC TEE (SXSXTH) (16) 12" FROM HARDSCAPE (17) VALVE ID TAG (18) PVC SCHEDULE 40 MALE ADAPTER SEED, 1-1/2" IN SOD, 2-1/2" IN PLANTER OR (19) TAPE WIRE TO SIDE OF MAINLINE AT 10' O.C. (8) PLASTIC VALVE BOX WITH BOLT-DOWN LOC IRRIGATION LEGEND; PROVIDE 18" LENGTH


- ONE VALVE PER BOX. INSTALL MINIMUM OF 12" FROM STRUCTURES OR HARDSCAPE.
- INSTALL IN SHRUB BEDS WHERE POSSIBLE.

CONNECTION.

- PLACE VALVE BOX AT RIGHT ANGLES TO STRUCTURES OR USE MIN. 3 WRAPS OF TEFLON TAPE AT EACH THREADED
- CENTER UNDER EACH CORNER OF VALVE BOX. ALL SLIP FITTINGS TO BE PRIMED AND GLUED.

TEE; LENGTH AS NEEDED

SEE SPECIFICATIONS.

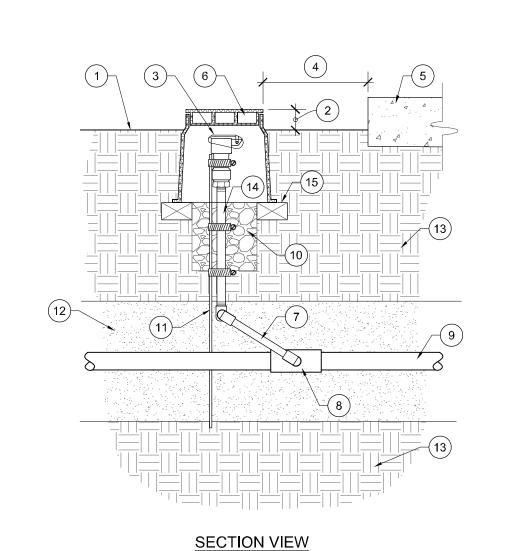

(1) FINISH GRADE

- (2) SET TOP OF BOX ABOVE FINISH GRADE: 1/2" IN SEED, 1-1/2" IN SOD, 2-1/2" IN PLANTER
- QUICK COUPLING VALVE WITH LOCKING RUBBER COVER; INSTALL SO QUICK COUPLER KEY CLEARS VALVE BOX. PROVIDE A MIN. OR 3" CLEARANCE FROM QCV TO BOTTOM OF LID.
- SET VALVE BOX 12" FROM EDGE OF PLANTING AREA
- CURB, HEADER OR PAVING WHERE APPLICABLE
- 10" DIAMETER PLASTIC VALVE BOX WITH BOLT DOWN LOC KIT. HEAT BRANDED 'QCV' ON TOP
- MANUFACTURED TRIPLE SWING JOINT, KBI MODEL TSA-1000-TT OR APPROVED EQUAL
- 8 PVC SCHEDULE 80 TEE (SL X SL X SL)

- (9) PRESSURE MAINLINE; SIZE AND TYPE PER
- (10) 3/4" CRUSHED ROCK, 6" MINIMUM DEPTH.
- #8 (1" DIA.) X 30" REBAR; SECURE TO QUICK COUPLER VALVE WITH STAINLESS STEEL HOSE CLAMPS AND STAINLESS SCREWS (TYP. 3 PLCS.)
- SAND BACKFILL; 6" ABOVE AND BELOW MAIN LINE
- (13) NATIVE SUBGRADE

APPROVED:

DATE: \_\_\_\_

**EXPIRES** 12/31/21 12/4/2020

R. C. E. # 48056 / EXPIRES 12-31-2021

NICHOLAS CALDERON, DIRECTOR OF PARKS

12/4/2020

PORTER, DIRECTOR OF PUBLIC WORKS

- PVC SCHEDULE 80 NIPPLE; LENGTH AS NEEDED
- (15) THREE (3) COMMON BRICKS. CENTER EACH UNDER EDGE OF VALVE BOX EQUIDISTANT FROM EACH OTHER.

ALL NON "O" RING THREADED CONNECTIONS SHALL RECEIVE MIN. 3 WRAPS OF TEFLON TAPE.

Scale: N.T.S

Scale: N.T.S

SCALE: AS SHOWN

DATE: 4/9/2020

FILE NO.: E4948


L-11

SHEET 42 OF 59

4 VALVE BOX LAYOUT SECTION VIEW

(1) FINISH GRADE

- SAND BACKFILL WITH 6" COVER ABOVE PIPE AND 6" BELOW PIPE
- IRRIGATION CONTROL WIRES IN GRAY SCHEDULE 40 PVC CONDUIT. MINIMUM SIZE 2" OR
- WIDTH AS NEEDED TO PROVIDE A MINIMUM 4" HORIZONTAL CLEARANCE BETWEEN PIPES
- MAINLINE SLEEVING- SIZE AND TYPE PER PLAN
- 8 LATERAL SLEEVING SIZE AND TYPE PER PLAN
- (11) PAVEMENT SUBGRADE- REFER TO CIVIL PLANS

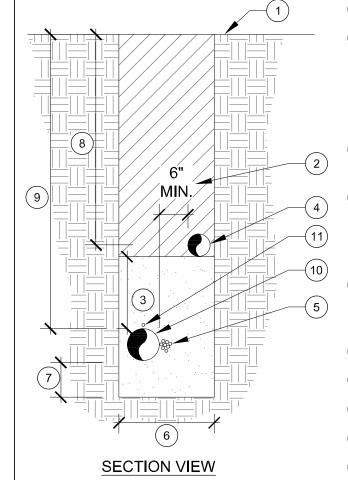

DIG SIDES OF TRENCH SQUARE AND

CLEAN OF ALL SHARP MATERIAL.

1 FINISH GRADE 2) TOPSOIL BACKFILL, NO PARTICLES GREATER THAN 1". COMPACT PER SPECIFICATIONS.

SAND BACKFILL; 6" ABOVE AND BELOW MAIN

FOUR (4) COMMON BRICKS FOR SUPPORT.

SCH. 40 BALL VALVE; LINE SIZE.

(3) 6" OF SAND FILL COVER, ABOVE MAINLINE

 $( exttt{4})\,$  NON-PRESSURE LATERAL LINE, SEE

IRRIGATION PLAN. ELECTRIC WIRES BUNDLED AND TAPED TO SIDE OF MAINLINE AT 10' O.C. (INSTALL WIRES IN CONDUIT

FROM CONTROLLER TO MAINLINE). 9" OR AS NEEDED TO PROVIDE FOR A MINIMUM 6" CLEARANCE BETWEEN

(7) 6" FROM BOTTOM OF TRENCH

- (8) LATERAL -12" MIN. COVER (9) MAINLINE -18" MIN. COVER
- 10) PVC MAINLINE PER IRRIGATION PLAN (11) COPPER TRACE WIRE. SEE SPECS.

(1) STEP 1:STRIP, CLEAN AND DRY WIRES APPROXIMATELY 5/8" FROM **END AND INSERT WIRES** THROUGH HOLES IN BASE OF

2 QUICK COUPLER VALVE

- **ELECTRICAL CONNECTOR**
- STEP 2: APPLY ELECTRICAL CONNECTOR AND TWIST CLOCKWISE

(4) GEL-FILLED INSULATOR

- STEP 4: POSITION WIRE
  - CHANNELS AND SNAP INSULATOR TUBE COVER CLOSED.

STEP 3: INSERT SPLICE INTO


PUSH PAST THE LOCKING

CONNECTOR IN PLACE.

GEL-FILLED INSULATOR TUBE.

FINGERS TO HOLD ELECTRICAL

ORIGINAL SCALE IS IN INCHES

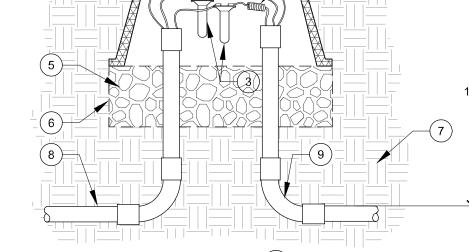

FINISH GRADE

SET TOP OF BOX ABOVE FINISH GRADE 2-1/2" IN PLANTER

LOCKING, WATERPROOF WIRE

CONNECTOR, SEE SPECS.

VALVE BOX WITH LOCKING COVER, SEE SPECS.

3/4" CRUSHED ROCK; 6" MINIMUM

PROVIDE MINIMUM 18" COILED EXTRA.

(7) UNDISTURBED SUBGRADE

(8) PVC SCHEDULE 40 CONDUIT

9 PVC SCHEDULE 40 CONDUIT

SWEEP ELBOWS WITH COUPLERS

COMMON AND CONTROL WIRES.

(11) 1/4" POLYPYLENE PULL ROPE

BOTH ENDS

1/4" STAINLESS STEEL WIRE CLOTH

6 DRY SPLICE CONNECTION 7 TRENCHING 5 | IRRIGATION CONTROL WIRE SPLICE BOX | COYOTE POINT RECREATION AREA DESIGNED BY: JJL EASTERN PROMENADE REJUVENATION PROJECT CHECKED BY: MG IRRIGATION DETAILS | 12/31/2020 | Renewal Date | 04/06/2020 | Date | D JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS SAN MATEO COUNTY REVISION DATE TEL 510/845-7549 FAX 510/845-8750 www.migcom.com FOR REDUCED PLANS

CENTER VALVE BOX OVER REMOTE CONTROL VALVE TO FACILITATE

SET REMOTE CONTROL VALVE AND VALVE BOX ASSEMBLY IN GROUND

4. AVOID HEAVILY COMPACTING SOIL AROUND VALVE BOXES TO PREVENT

INSTALL VALVE BOX EXTENSION BY VALVE BOX MANUFACTURER AS

SET BOXES PARALLEL TO EACH OTHER AND PERPENDICULAR TO EDGE OF

- PEDESTRIAN PAVING

Scale: N.T.S. 3 REMOTE CONTROL DRIP ZONE

DECOMPOSED GRANITE.

PRIOR TO FIRST FITTING.

(10) SCHEDULE 40 PVC ELBOW (TH X TH)

(9) PVC NON-PRESSURE LATERAL LINE PER

(11) CONTROL AND COMMON WIRES. SIZE AS

NEEDED, PROVIDE MINIMUM 30" COILED

- AS NEEDED
- TRENCH BACKFILL REFER TO CIVIL PLANS
- 9 IRRIGATION MAINLINE
- (10) LATERAL LINE

NOTES:

SERVICING VALVE.

COVER/SHRUB AREA WHERE POSSIBLE.

LAWN, WALK, FENCE, CURB, BUILDING, ETC.

COLLAPSE AND DEFORMATION OF VALVE BOX SIDES.

REQUIRED TO COMPLETELY ENCLOSE VALVE ASSEMBLY.

1. SIDES OF TRENCH SHALL BE DUG SQUARE AND CLEAN OF ALL SHARP MATERIAL

TRENCHING UNDER PAVEMENT

APPROVED DATE:

RICHARD J. LARSON, DIRECTOR

RLA # 2042 / EXPIRES 12/31/2020

555 COUNTY CENTER, 5th FLOOR

REDWOOD CITY, CALIFORNIA 94063

100% DESIGN SUBMITTAL - 4/9/2020




NICHOLAS CALDERON, DIRECTOR OF PARKS

2 POP-UP SPRAY BODY

1 TREE ROOT WATERING SYSTEM Scale: NTS

Scale: N.T.S.

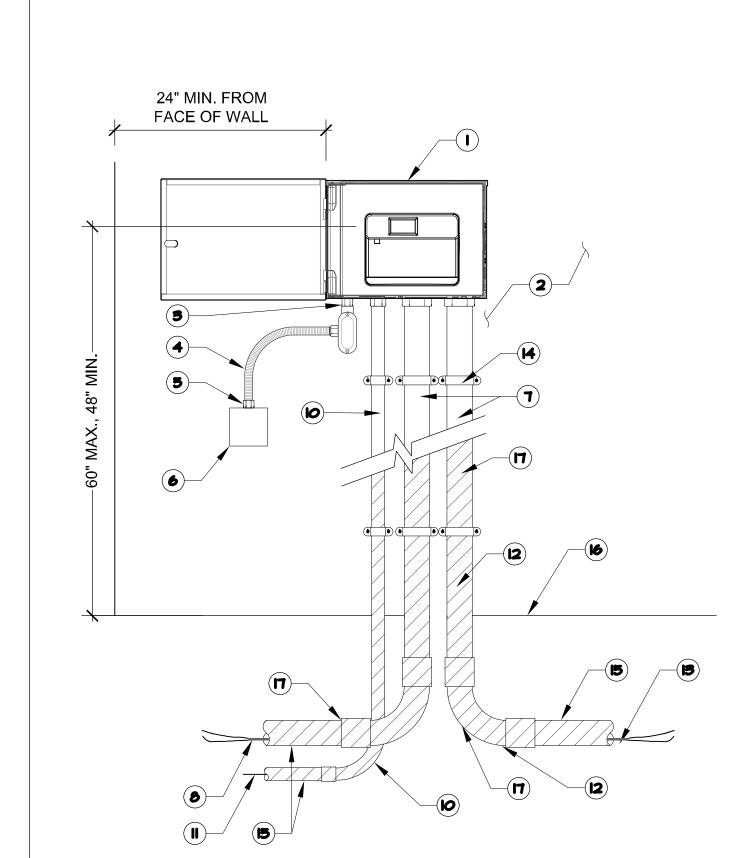

AUTOMATIC IRRIGATION CONTROLLER WITHIN WALL MOUNTED METAL CABINET.

- (2) INTERIOR WALL.
- (3) 3/4" RIGID LIQUID TIGHT INSULATED STRAIGHT CONNECTOR, TYP. 3/4" RIGID CONDUIT BODY WITH GASKET AND COVER, TYP.
- (4) 3/4" FLEXIBLE POWER SUPPLY CONDUIT WITH 2 #10 THW, 1 #8G GRD. INTO J-BOX INSIDE CONTROLLER. CONNECT PER LOCAL CODE AND ORDINANCES.
- (5) 3/4" LIQUID-TIGHT INSULATED CONNECTOR, TYP.
- (6) 4" SQ. J-BOX WITH 1/2" RAISED WATERPROOF COVER TO HOUSE CONNECTION TO 120 VAC POWER SUPPLY.
- RIGID CONTROL WIRE CONDUIT TO MAINLINE. 2" SIZE.
- DIRECT BURIAL REMOTE CONTROL WIRES TO REMOTE CONTROL VALVES.
- (4) SUPPLEMENTAL GROUNDING 1" RIGID CONDUIT.
- SUPPLEMENTAL RIGID GROUNDING CONDUIT SWEEP BELLED ON BOTH ENDS, 8" MINIMUM RADIUS.
- (II) SUPPLEMENTAL GROUND WIRE. GROUND PER ASIC GUIDELINES.
- RIGID CONTROL WIRE CONDUIT WITH APPROPRIATE SWEEP FITTINGS TO MAINLINE, 2" SIZE, BY OTHERS.
- DIRECT BURIAL REMOTE CONTROL WIRES TO REMOTE CONTROL VALVES, HYDROMETER AND SPARE WIRE LOCATIONS.
- (A) GALV. CLIPS @ 12" O.C. INSTALL CONDUIT FLUSH TO WALL IN STRAIGHT VERTICAL ALIGNMENT, TYP.
- SCHEDULE 40 PVC CONDUIT. SIZE AS REQUIRED.
- FINISH FLOOR
- (17) EMPTY CONDUITS FROM THE EXTERIOR TO THE INTERIOR OF THE BUILDING WILL BE PROVIDED BY OTHERS. STUB OUTS WILL BE PROVIDED WITHIN 10' OF CONTROLLER. CONTRACTOR SHALL EXTEND AND CONNECT CONDUITS AND PULL WIRES FROM THE EXTERIOR TO THE CONTROLLER. COORDINATE WITH OTHER TRADES AS REQUIRED.



(1) REMOTE CONTROL DRIP ZONE. (2) 1" POLYETHYLENE TUBING, LOOPED TO PVC LATERAL LINE. SPACED 12' APART MAXIMUM.

1" BARBED INSERT FITTING (IXIXFIPT) MANUFACTURED BY

(12) 3" MINIMUM CLEARANCE BETWEEN BOTTOM OF VALVE

- (3) 1/4" DISTRIBUTION TUBING WITH EMITTER.
- (4) EMITTER ATTACHED DIRECTLY TO 1" POLYETHYLENE TUBING WHERE POSSIBLE REQUIRED.
- 5 NOT USED.

(1) 1" POLYETHYLENE TUBING

SPEARS OR APPROVED EQUAL

(7) PVC SCH 80 CLOSE NIPPLE, 6" LENGTH

(10) 3/4" CRUSHED ROCK, 6" MIN. DEPTH

1/4" GALVANIZED WIRE CLOTH

COVER TO TOP OF TEE FITTING

TUBING STAKE, TYP.

(3) 6" ROUND VALVE BOX

TOP OF MULCH

(8) PVC LATERAL PIPE


(9) PVC SCH 40 TEE OR ELL

(6) FINISH GRADE

- (6) MANUAL FLUSH VALVE: 1" PVC SCH. 40 THREADED ADAPTER WITH THREADED CAP. INSTALL AT THE END OF POLY. LINE
- 7 NOT USED.
- (8) PVC LATERAL SUPPLY LINE. SIZE PER PLANS.
- (9) DRIP LINE CONNECTION TO PVC LATERAL IN ACCESS BOX. REFER TO DETAIL 7, SHEET DI-1.
- (10) SHRUB OR TREE, TYP.

#### NOTES:

- 1. ALL ELECTRICAL WORK SHALL CONFORM TO LOCAL CODES AND ORDINANCES.
- 2. REFER TO MANUFACTURER FOR MOUNTING INSTRUCTIONS.
- 3. EXACT PLACEMENT OF UNIT SHALL BE DETERMINED BY ARCHITECT.
- 4. SEAL ALL CONDUIT ENDS WITH DUCT SEAL.
- 5. REFER TO CONTROLLER MANUFACTURED STANDARD DETAILS FOR ADDITIONAL INFORMATION.

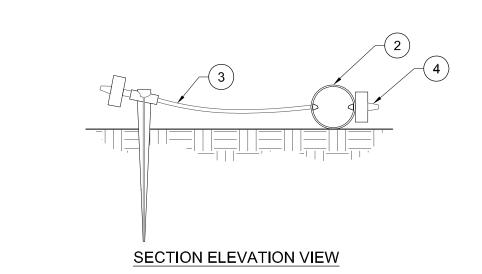

PLAN VIEW

MAINLINE

5 WALL MOUNTED AUTOMATIC IRRIGATION CONTROLLER

Scale: N.T.S. 4 ON-SURFACE DRIP SYSTEM LAYOUT

BERKELEY, CA 94710

NOTES:

PLANS.

SPACING.

1. REFER TO LEGEND FOR

MANUFACTURER, MODEL, AND

NUMBER REQUIRED PER PLANT.

THEY DO NOT TOUCH GROUND.

4. SECURE 1" POLY TUBE TO GROUND

WITH METAL STAPLES AT 36" O.C.

3. PVC LATERAL TO BE PLACED PER

2. INSTALL EMITTERS TO ENSURE

DESIGNED BY: JJL

COYOTE POINT RECREATION AREA


SCALE: AS SHOWN DATE: 4/9/2020 FILE NO.: E4948


Scale: N.T.S.

Scale: N.T.S.

APPROVED DATE: 12/31/2020 Renewal Date RICHARD J. LARSON, DIRECTOR 04/06/2020 Date RLA # 2042 / EXPIRES 12/31/2020

TEL 510/845-7549 FAX 510/845-8750 www.migcom.com

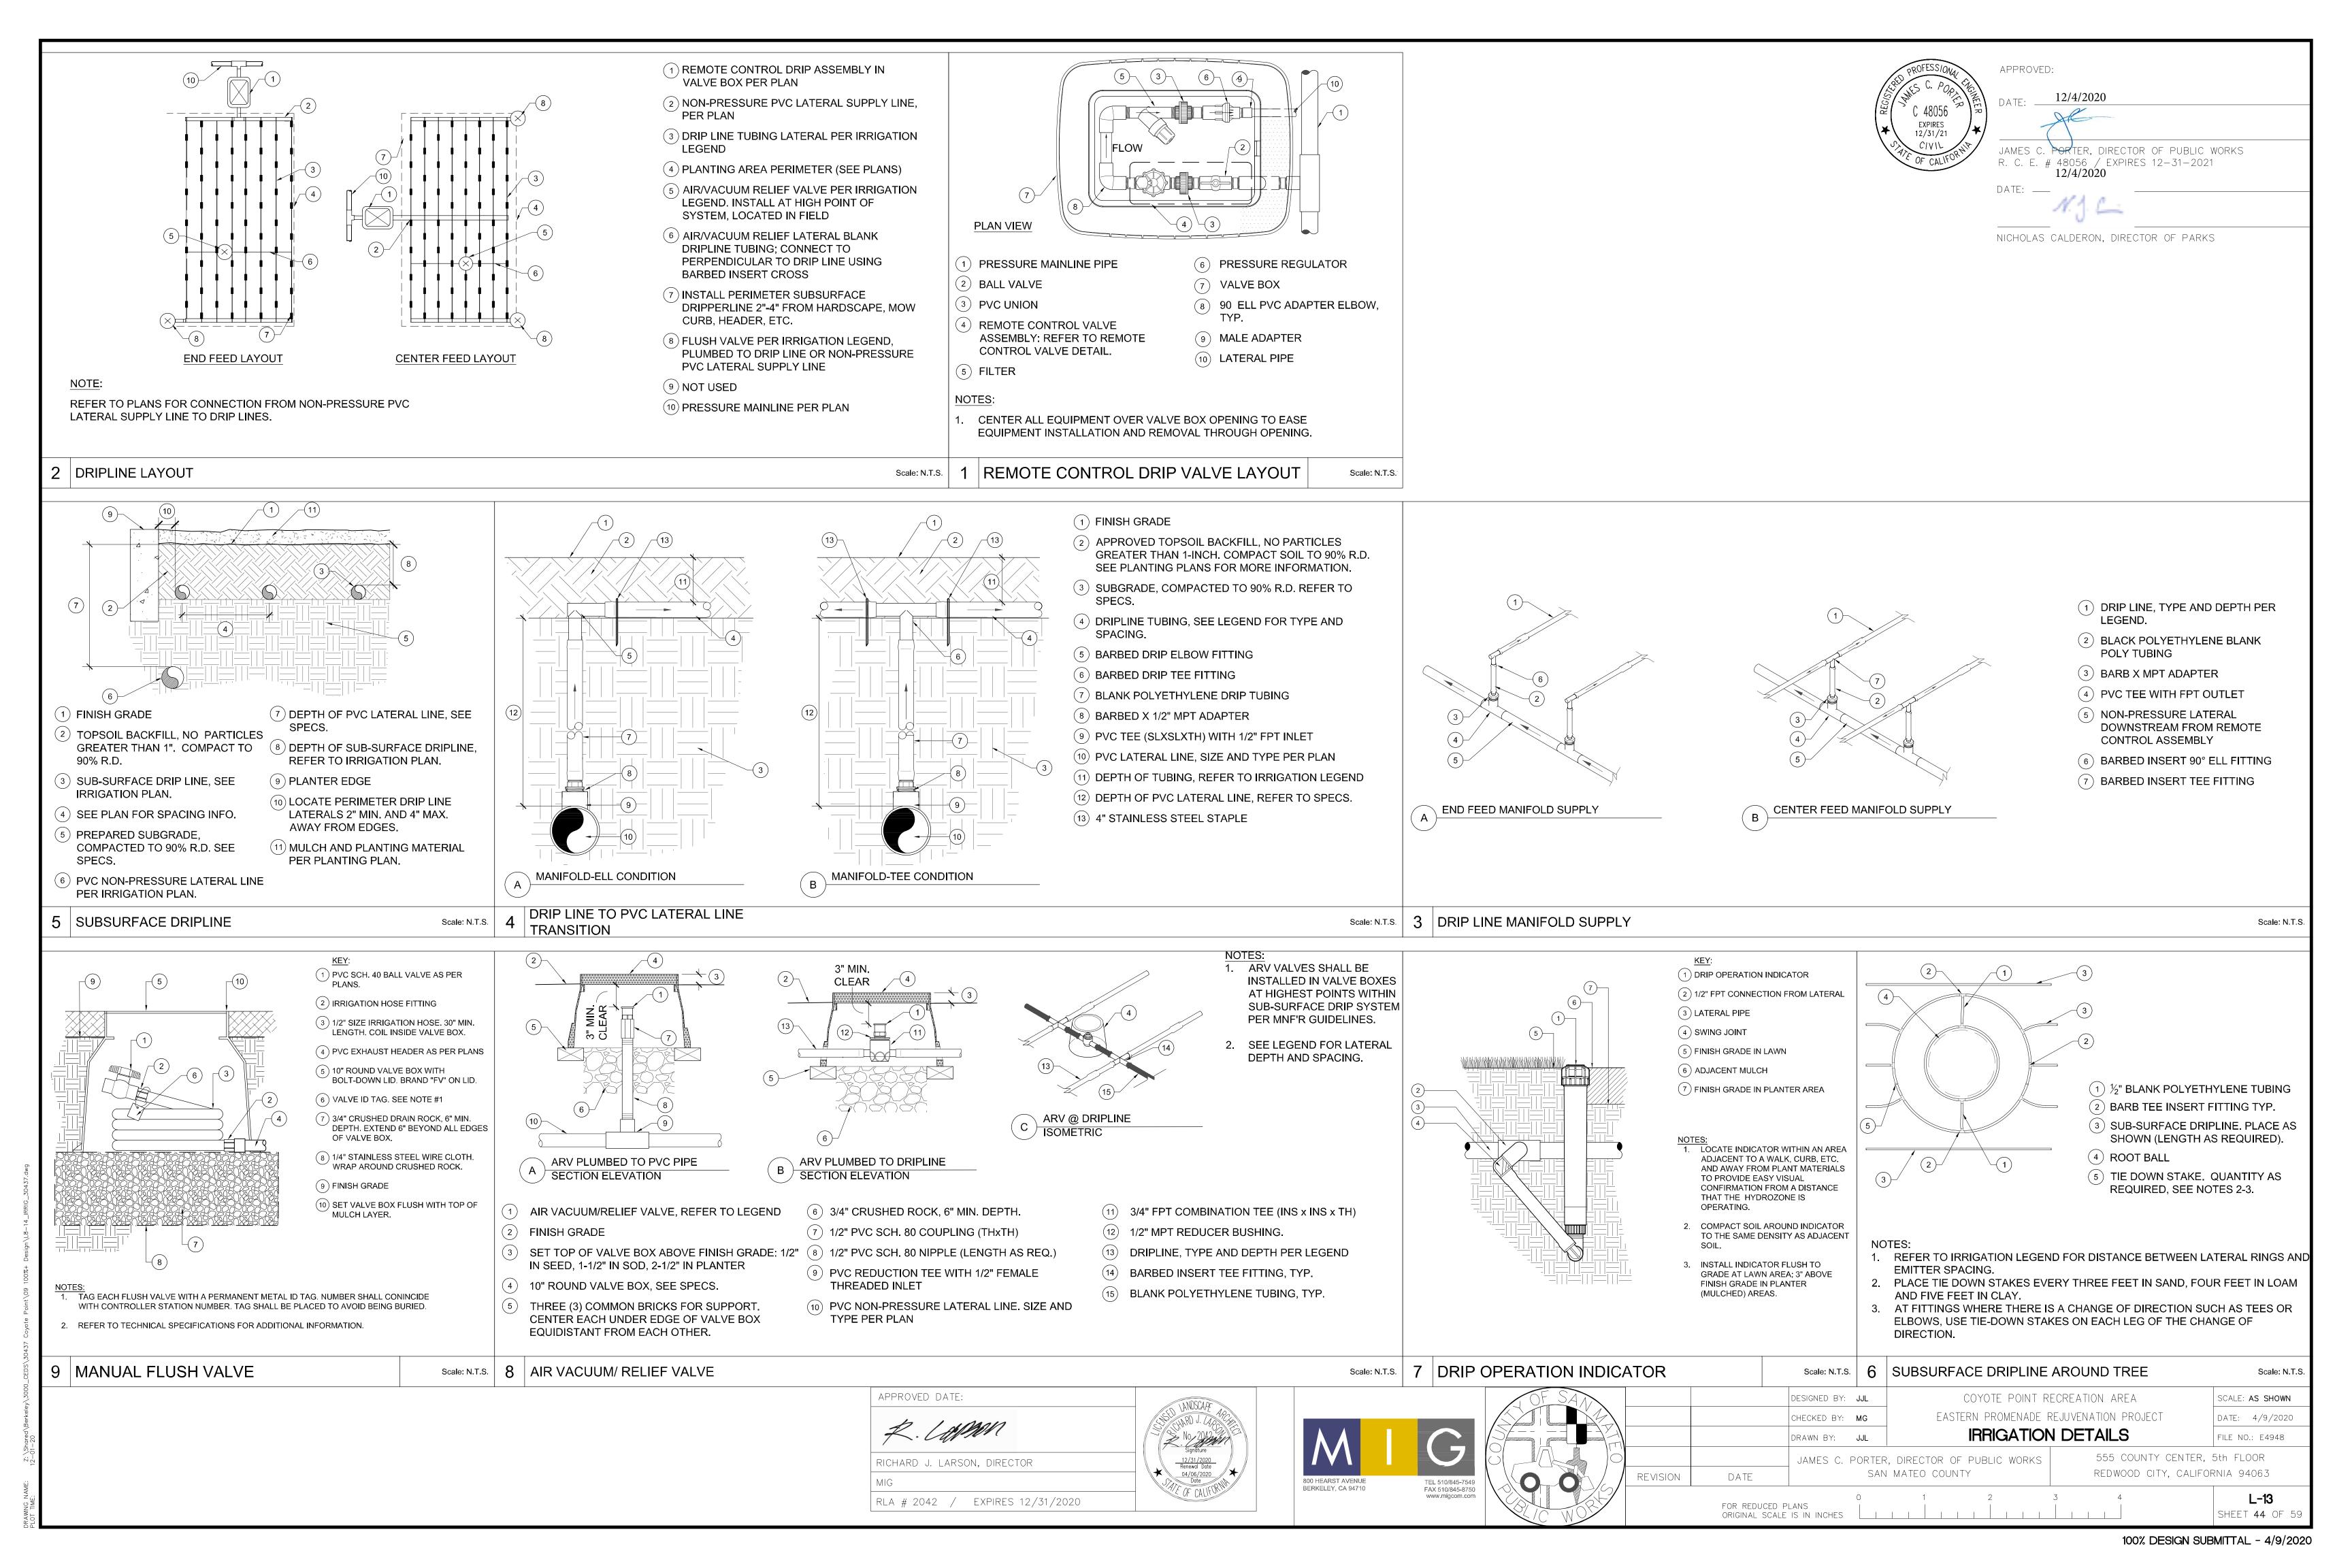

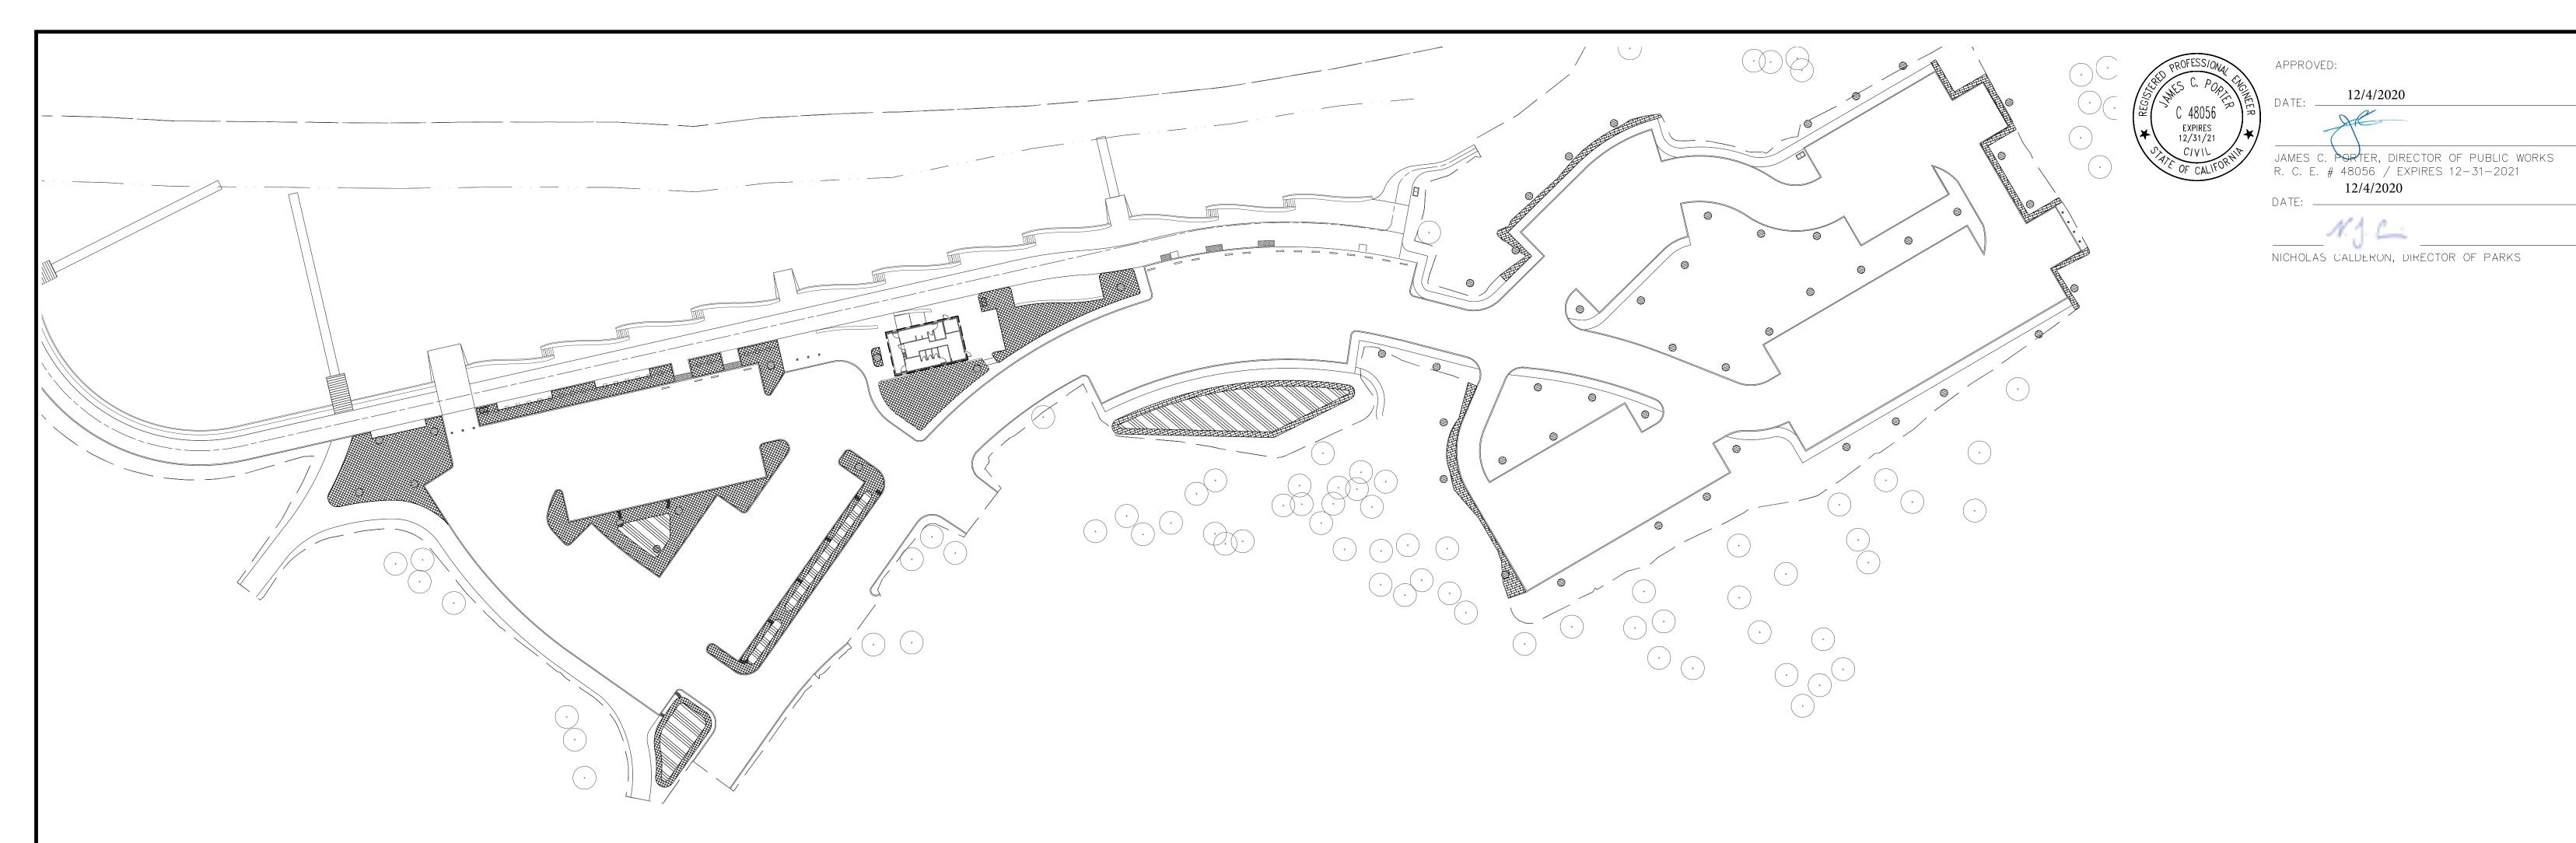

			Estimated Tota	l Water Use (ETWU	)		
Reference Evapo	otranspiration (Eto)	42.80					
Hydrozone #	Plant Factor (PF)	Irrigation Method	Irrigation Efficiency (IE)	ETAF (PF/IE)	Lanscape Area (sf2)	ETAF x Area	ETWU
egular Landscap	e Areas						1
C1	0.2	Drip	0.81	0.25	2,026	500	13,276
C2	0.2	Drip	0.81	0.25	1,342	331	8,792
C3	0.2	Drip	0.81	0.25	1,769	437	11,592
C4	0.2	Drip	0.81	0.25	1,443	356	9,457
C5	0.2	Drip	0.81	0.25	1,128	278	7,390
C6	0.2	Drip	0.81	0.25	1,289	318	8,444
C7	0.5	Bubbler	0.75	0.67	288	192	5,095
C8	0.5	Bubbler	0.75	0.67	216	144	3,821
C9	0.5	Bubbler	0.75	0.67	120	80	2,123
C10	0.5	Bubbler	0.75	0.67	240	160	4,246
C11	0.5	Bubbler	0.75	0.67	312	208	5,519
C12	0.5	Bubbler	0.75	0.67	144	96	2,547
C13	0.7	Spray	0.75	0.93	399	372	9,878
C14	0.7	Spray	0.75	0.93	467	436	11,572
C15	0.7	Spray	0.75	0.93	366	341	9,054
C16	0.7	Spray	0.75	0.93	207	193	5,135
C17	0.7	Spray	0.75	0.93	254	237	6,291
C18	0.7	Spray	0.75	0.93	680	634	16,834
C19	0.7	Spray	0.75	0.93	931	869	23,062
C20	0.7	Spray	0.75	0.93	35	33	867
C21	0.2	Drip	0.81	0.25	804	198	5,267
C22	0.2	Drip	0.81	0.25	518	128	3,393
C23	0.2	Drip	0.81	0.25	446	110	2,920
C24	0.2	Drip	0.81	0.25	594	147	3,891
				Totals	16,017	6,801	180,464
esults				Totals	10,017	0,001	100,404
Caulta	ETWU = (Eto) >	(0.62) x [(ETAF x Lan	dscape Area)]			Gallone	180,464
	- (=:5) /	( ) ( ) ( )					24,124.53
							241.25
						Acre-feet	
						7010-1001	0.00

WU	
	Et0 of City
	Lio or oity
276	
792	
592	
457	
390	Results
144	MAWA = (ETO) x (0.62) x
095	
821	
123	
246	
519	
547	
378	
572	
054	
135	
291	
834	
062	
67	
267	
393	

Maximum Applied Water Allo	wance Calculations	s (MAWA)
	No. 1	Water Meter
	L-9	Plan Sheet
	Redwood City	Name of City
Et0 of City	42.80	ETO (inches/year)
	4,659	Overhead Irrigation Landscape Area (ft2)
	11,358	Drip Irrigation Landscape Area (ft2)
	0	SLA (ft2)
Total Landscape Area	16,017	
Results		
MAWA = (ETO) $\times$ (0.62) $\times$ [(0.45 $\times$ LA) + ((1.0 - 0.45) $\times$ SLA))]	191,264	Gallons
	25,568.25	Cubic Feet
	255.68	HCF
	0.59	Acre-feet
	0.19	Millions of Gallons

		* Hydrozone Method Gallons Per Minute		(Sq. ft.)	% of Total Landscape		
	LW		D	60	8,997		56.17%
	MW			28	1,320	8.24%	
		HW	S	129	3,339		20.85%
		LW	D	5	2,361		14.74%
				TOTALS	16,017		100%
	HW	= HIGH WATE	R USE PLANTS			MS	MICRO-SPRAY
*	MW	= MODERATE	WATER USE PLA	NTS	**	** S	SPRAY
	LW	= LOW WATE	R USE PLANTS		R	ROTOR	
						В	BUBBLER
						D	DRIP
						0	OTHER
		SUMMAR	Y HYDROZONE TA	ABLE		0	OTHER
HYDROZONE DESCR	RIPTION		<b>Y HYDROZONE T</b> L SQ. FT.	<b>ABLE</b> % OF LAN	NDSCAPE	0	OTHER
		ТОТА		T		0	OTHER
1. HIGH WATER USE 2. MODERATE WATE	PLANTS	TOTA	L SQ. FT.	% OF LAN	%	0	OTHER
1. HIGH WATER USE 2. MODERATE WATE PLANTS	PLANTS R USE	TOTA 3 1	L SQ. FT.	% OF LAN	%	0	OTHER
HYDROZONE DESCR 1. HIGH WATER USE 2. MODERATE WATE PLANTS 3. LOW WATER USE TOTAL	PLANTS R USE	TOTA 3 1	L SQ. FT. 3,339 ,320	% OF LAN 21 84	% %	0	OTHER
1. HIGH WATER USE 2. MODERATE WATE PLANTS 3. LOW WATER USE	PLANTS R USE	TOTA 3 1 1 10	L SQ. FT. 3,339 ,320 1,358	% OF LAN 21 80 71	% %	0	OTHER
1. HIGH WATER USE 2. MODERATE WATE PLANTS 3. LOW WATER USE <b>TOTAL</b>	PLANTS R USE PLANTS	TOTA 3 1 1 1 1 IRRIGATIO	L SQ. FT. 5,339 ,320 1,358 5,017	% OF LAN 21 80 71	% % % 0%	0	OTHER
1. HIGH WATER USE 2. MODERATE WATE PLANTS 3. LOW WATER USE TOTAL  IRRIGATION EQUIPM	PLANTS R USE PLANTS ENT	TOTA  3  1  1:  IRRIGATIO  TOTA	L SQ. FT. 3,339 ,320 1,358 6,017 N EFFICIENCY FA	% OF LAN 21 8' 71 100	% % % 0% NDSCAPE	0	OTHER
1. HIGH WATER USE 2. MODERATE WATE PLANTS 3. LOW WATER USE	PLANTS R USE PLANTS ENT	TOTA  3  1  1  1  IRRIGATIO  TOTA	L SQ. FT. 3,339 ,320 1,358 3,017 <b>N EFFICIENCY FA</b> L SQ. FT.	% OF LAN 21 89 71 100 ACTOR % OF LAN	% % % % D% NDSCAPE %	0	OTHER
1. HIGH WATER USE 2. MODERATE WATE PLANTS 3. LOW WATER USE TOTAL  IRRIGATION EQUIPM DRIP/POINT SOURCE	PLANTS R USE PLANTS ENT	TOTA  3  1  1  10  IRRIGATIO  TOTA  1  4	L SQ. FT. 3,339 ,320 1,358 6,017 N EFFICIENCY FA L SQ. FT. 1,358	% OF LAN 21 86 71 100 ACTOR % OF LAN 71	% % % D% NDSCAPE % %	0	OTHER

	ETAF Calculations
	All Landscape Areas
Total ETAF x Area	6,801
Total Area	16017
Sitewide ETAF	0.42

Millons of Gallons 0.18


MAWA 191,264








OF SAM				DESIGNED BY:	: JJL		COYOTE	POINT RE	ECREATION	I AREA		SCALE:1" = 40'-	0"
				CHECKED BY:	MG		ASTERN PRO	MENADE R	EJUVENAT	ON PROJECT		DATE: 4/9/202	<u>'</u> 0
	1			DRAWN BY:	JJL	MWELO	COMP	LIANCE	E DOC	UMENTATI	ON	FILE NO.: E4948	
				JAMES C.	PORTER	R, DIRECTOR	OF PUBLIC	WORKS	5	55 COUNTY CEN	ITER, 5	5th FLOOR	
	/ RE'	/ISION	DATE		SAN	MATEO CO	UNTY		RI	EDWOOD CITY, C	ALIFOR	RNIA 94063	
O NOR			FOR REDUCED P ORIGINAL SCALE		0	1	2		3	4		<b>L-14</b> SHEET <b>45</b> OF	59


SHEET **45** OF 59

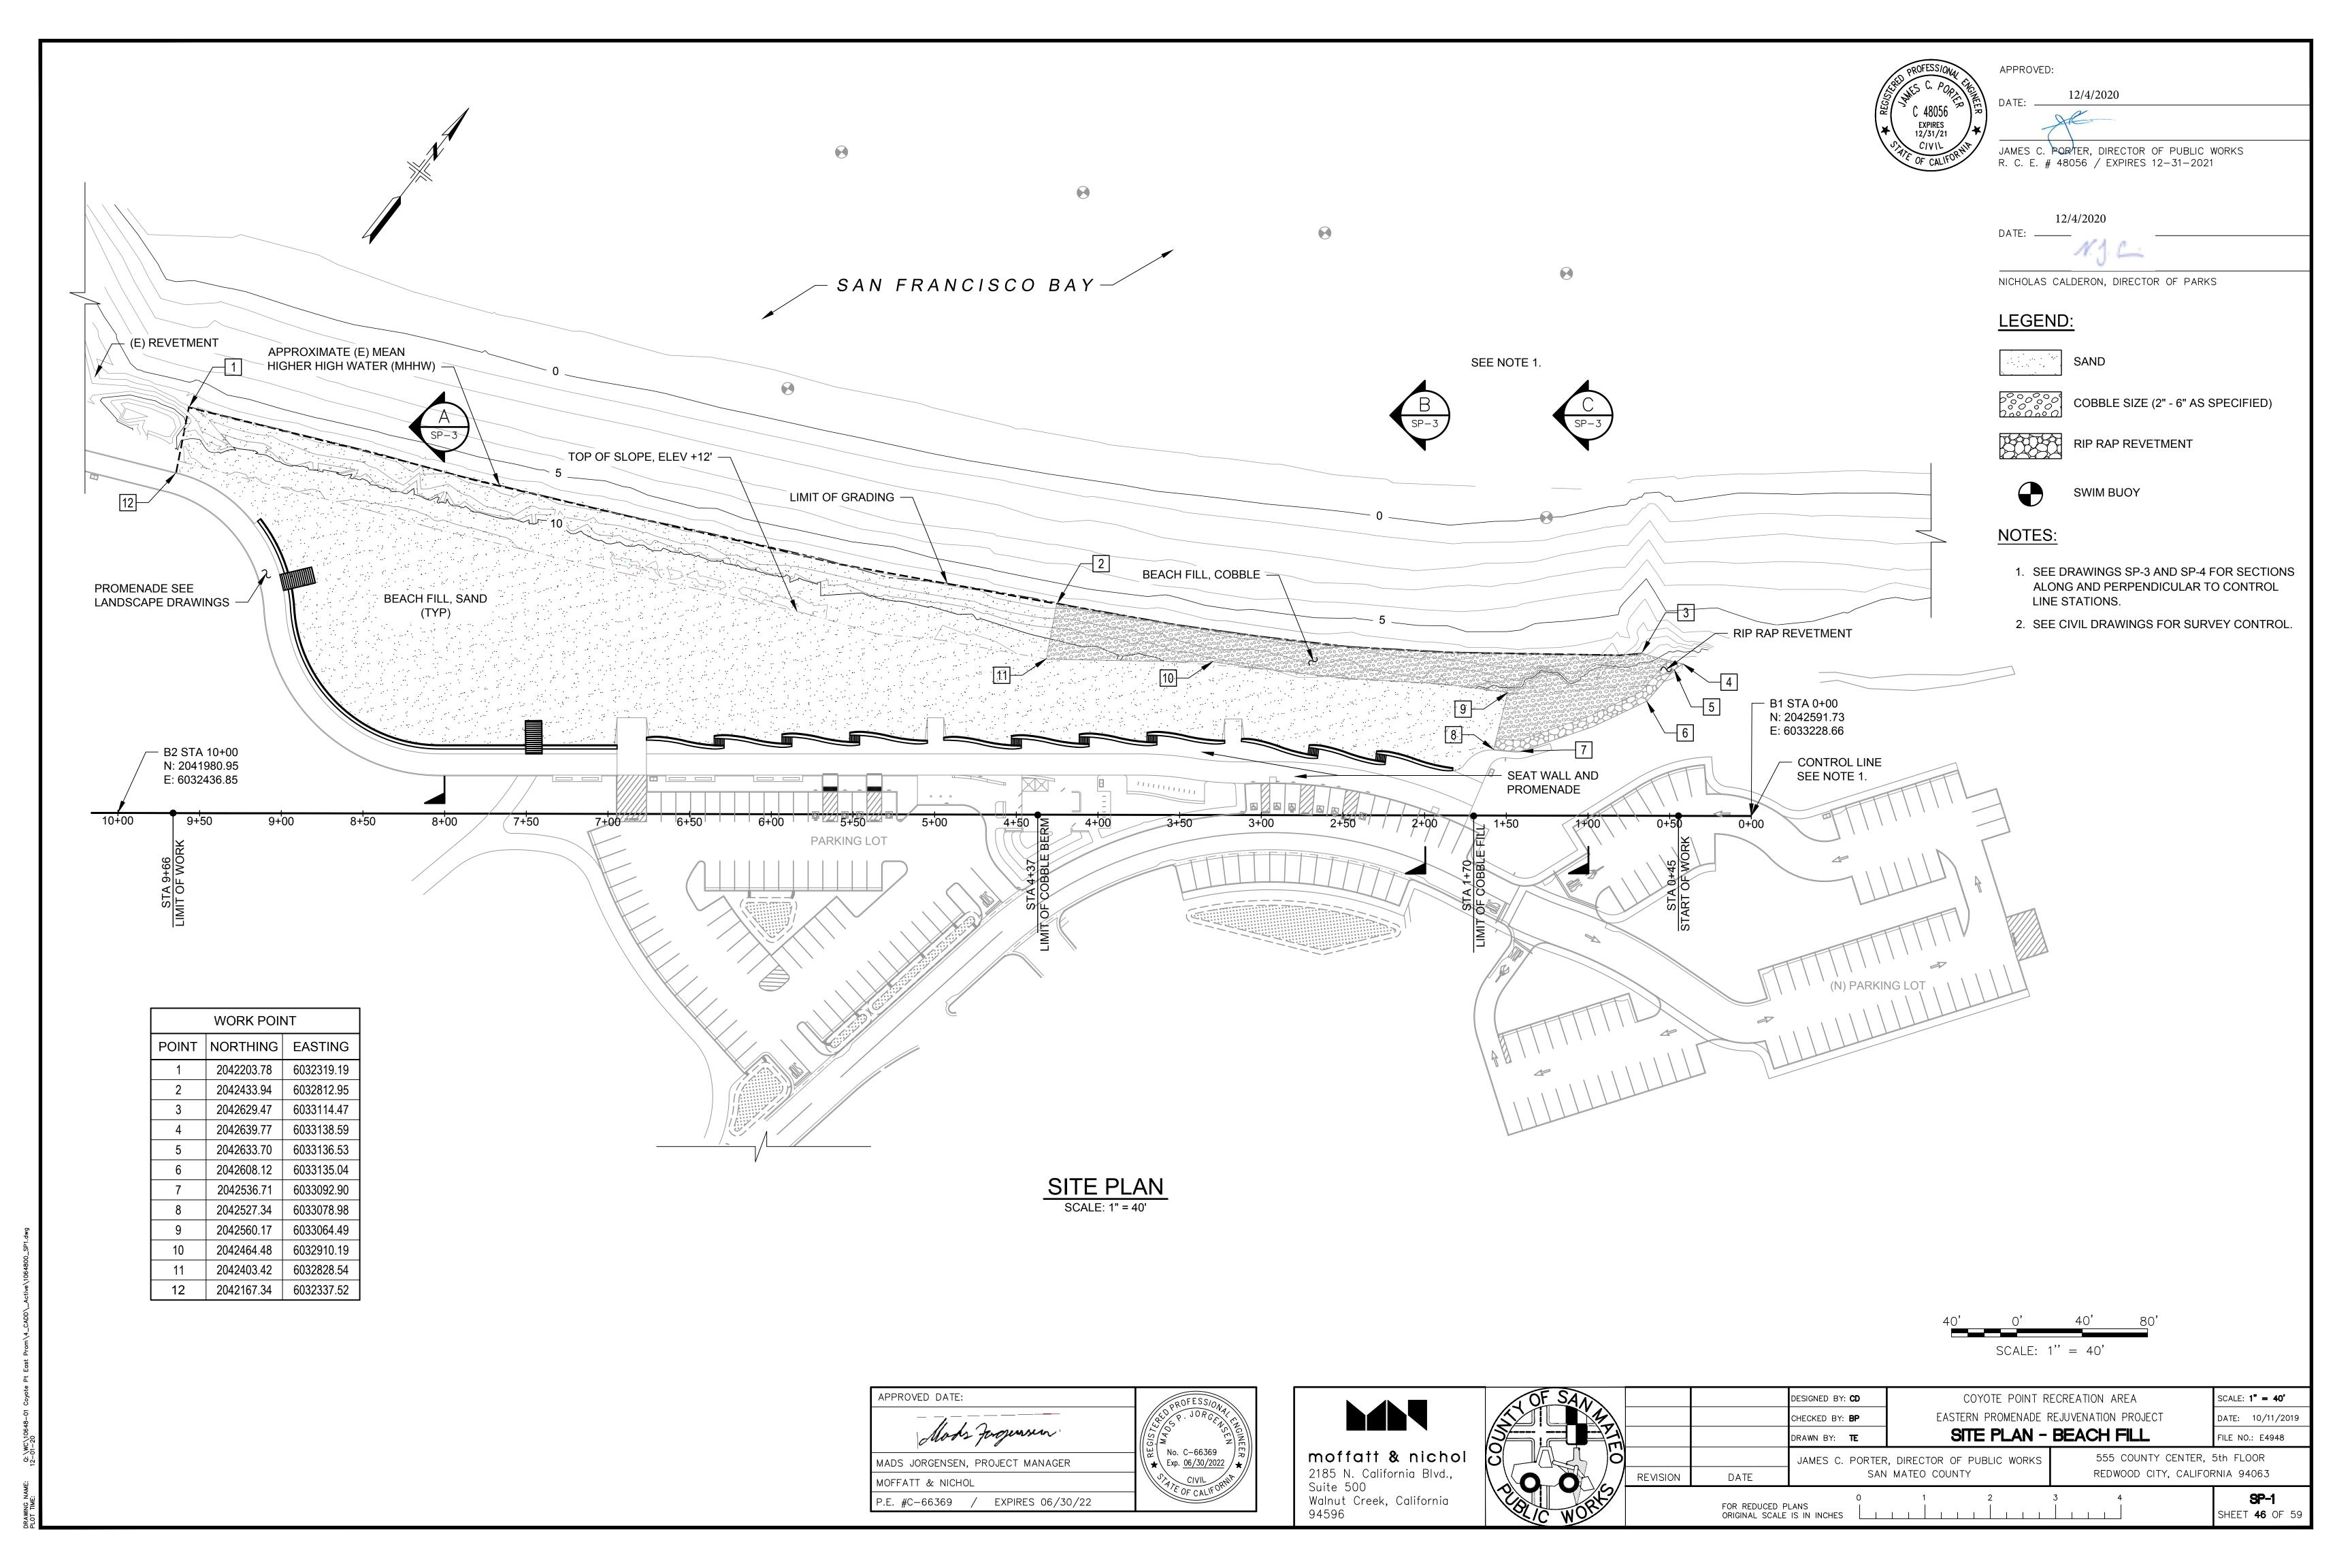

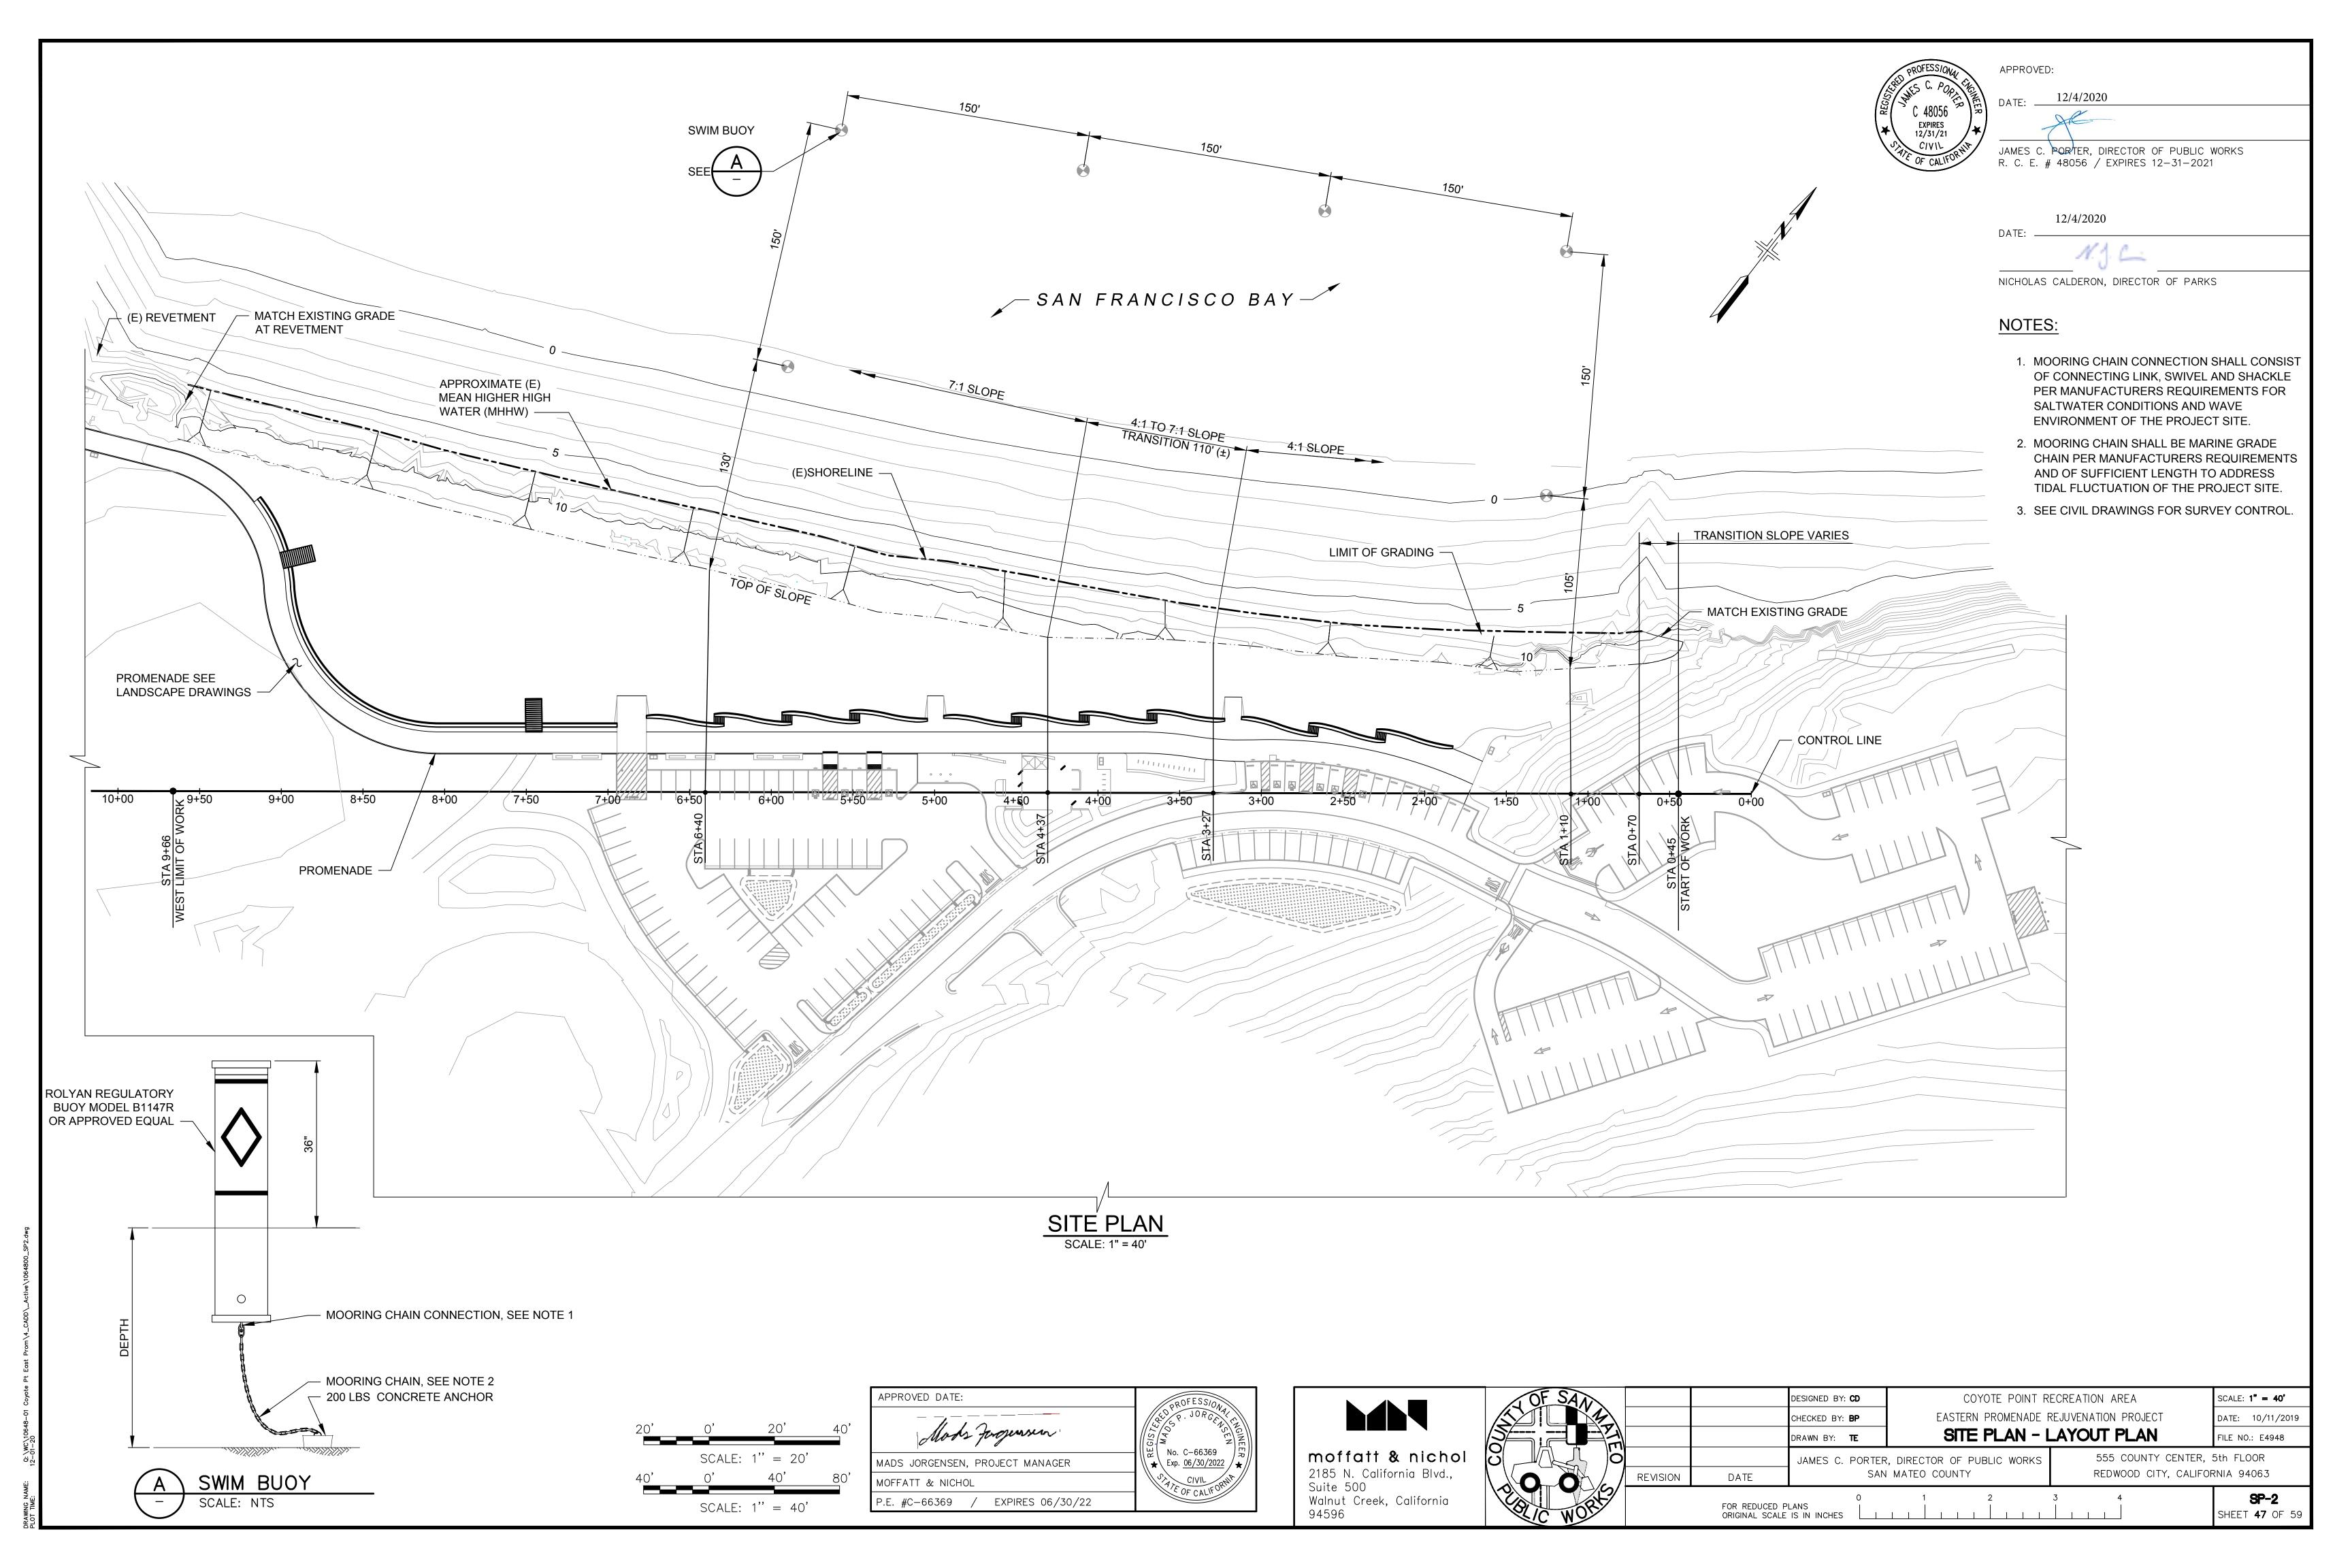

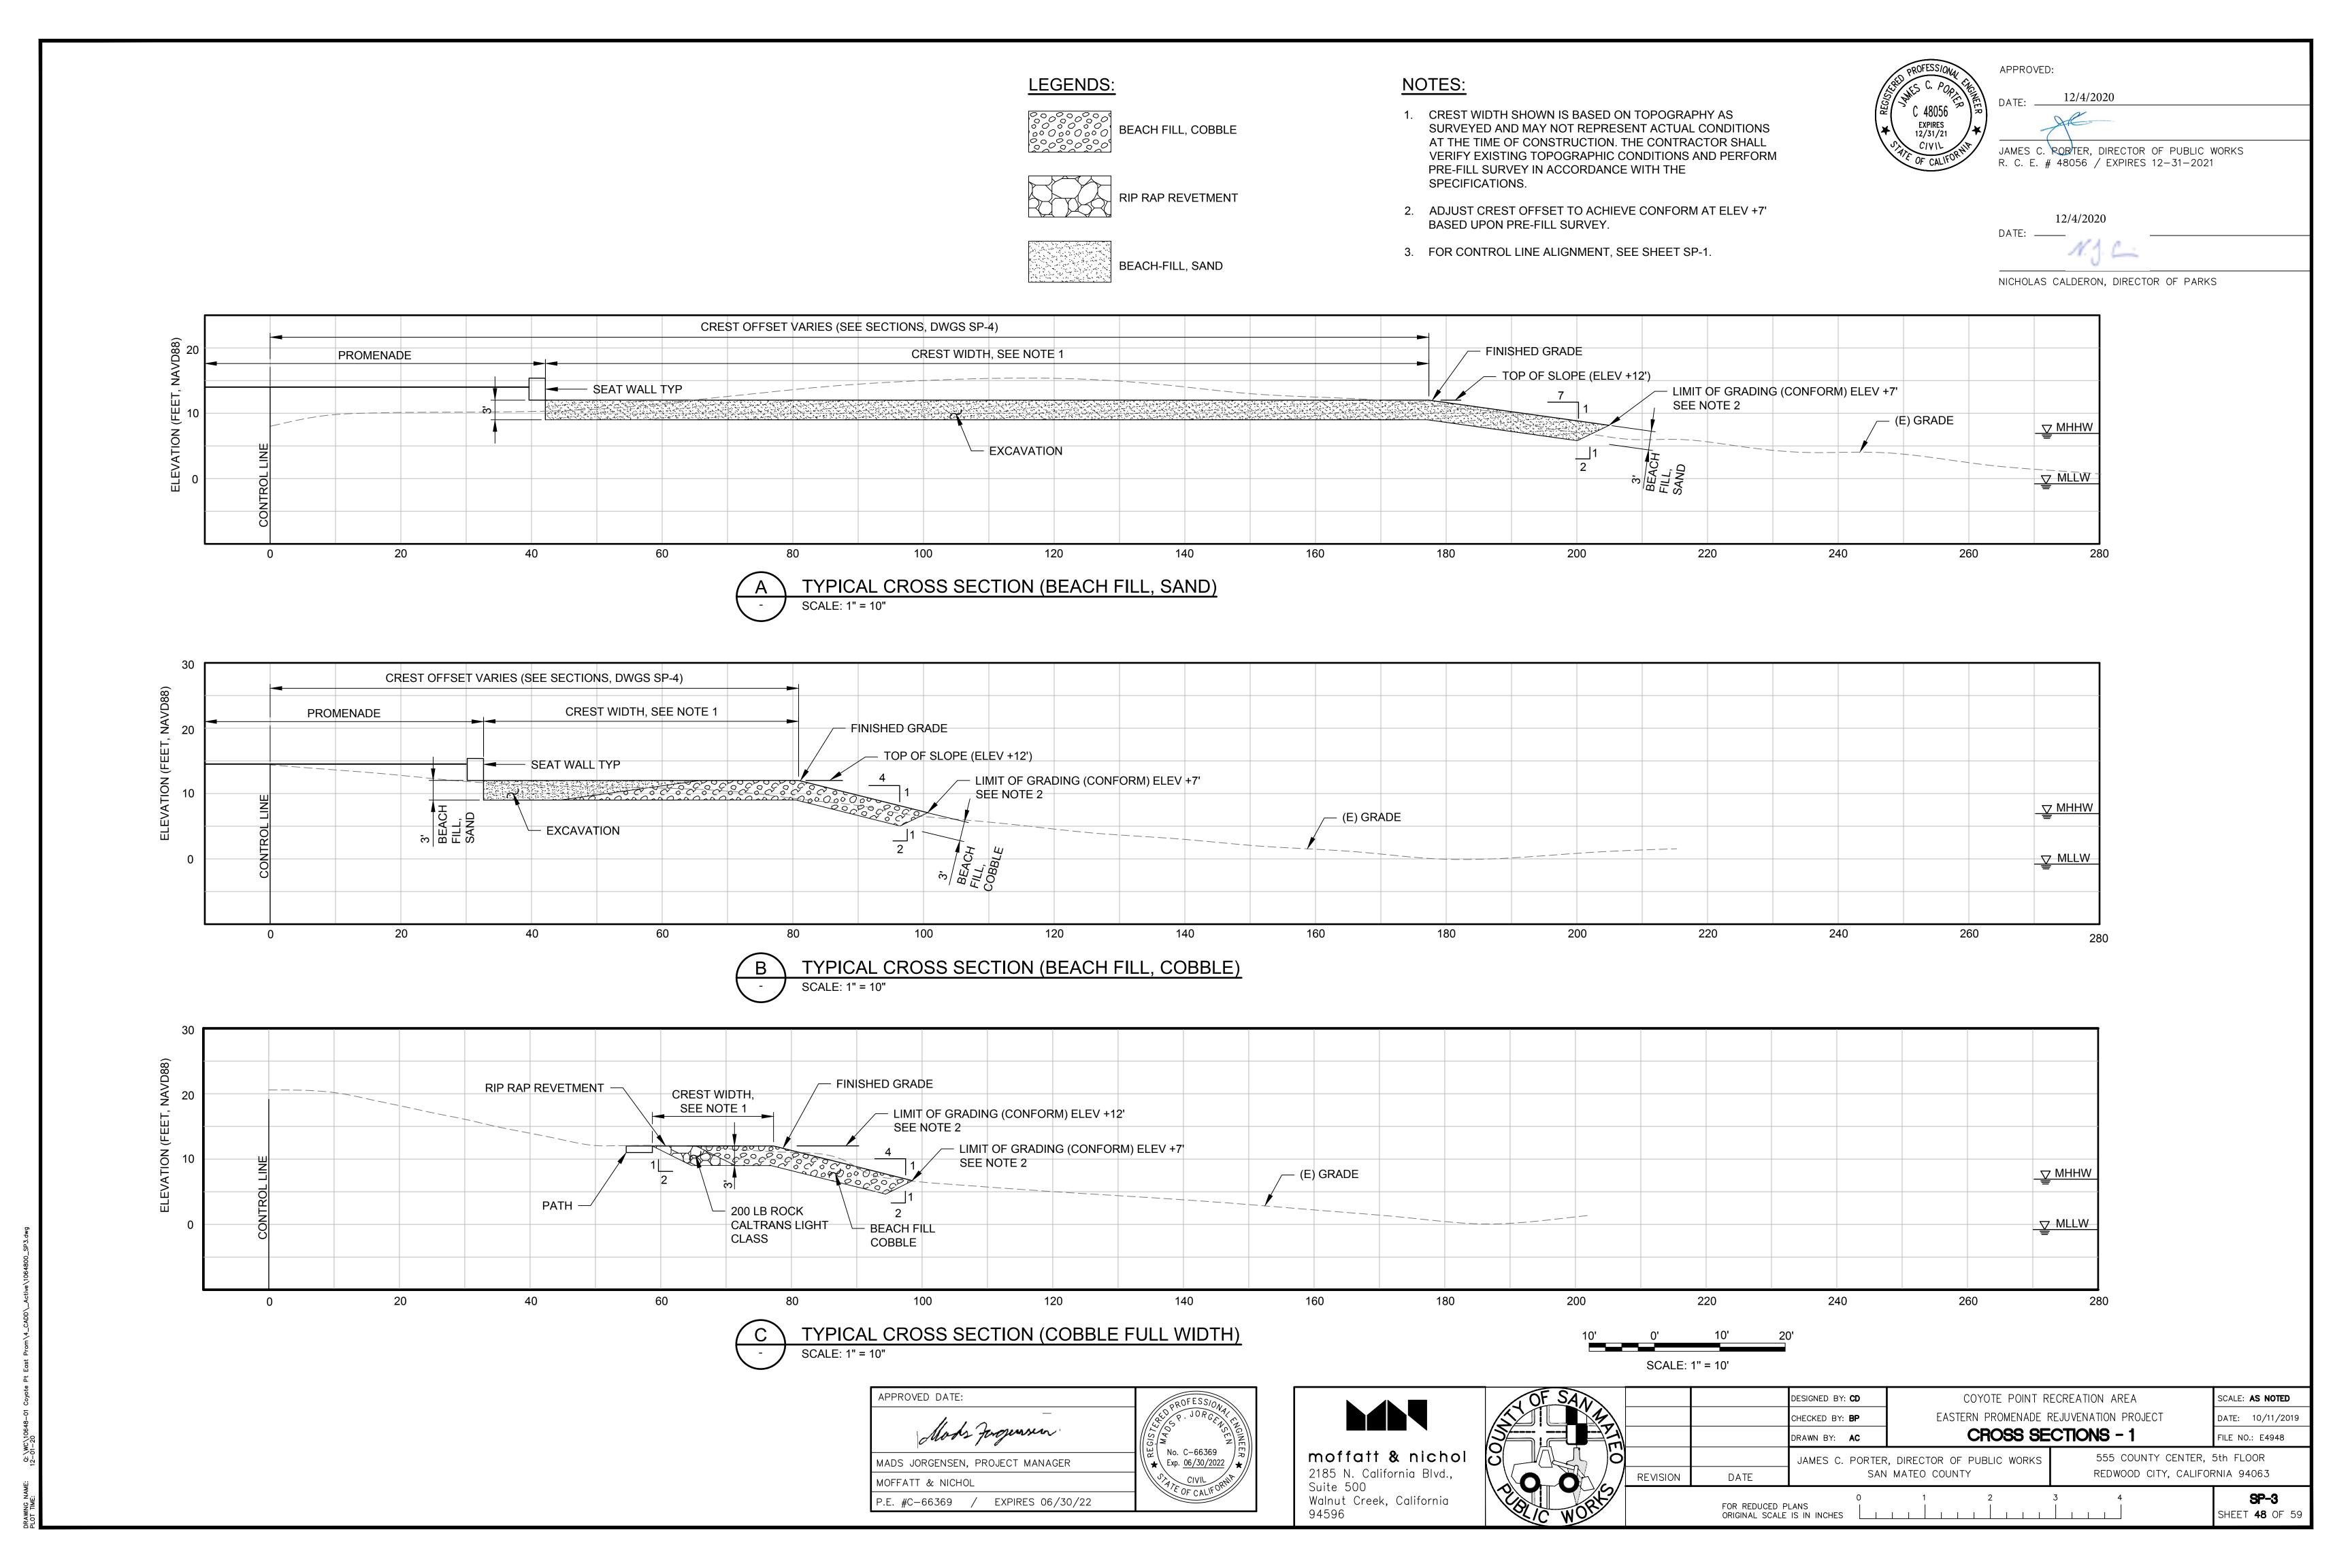

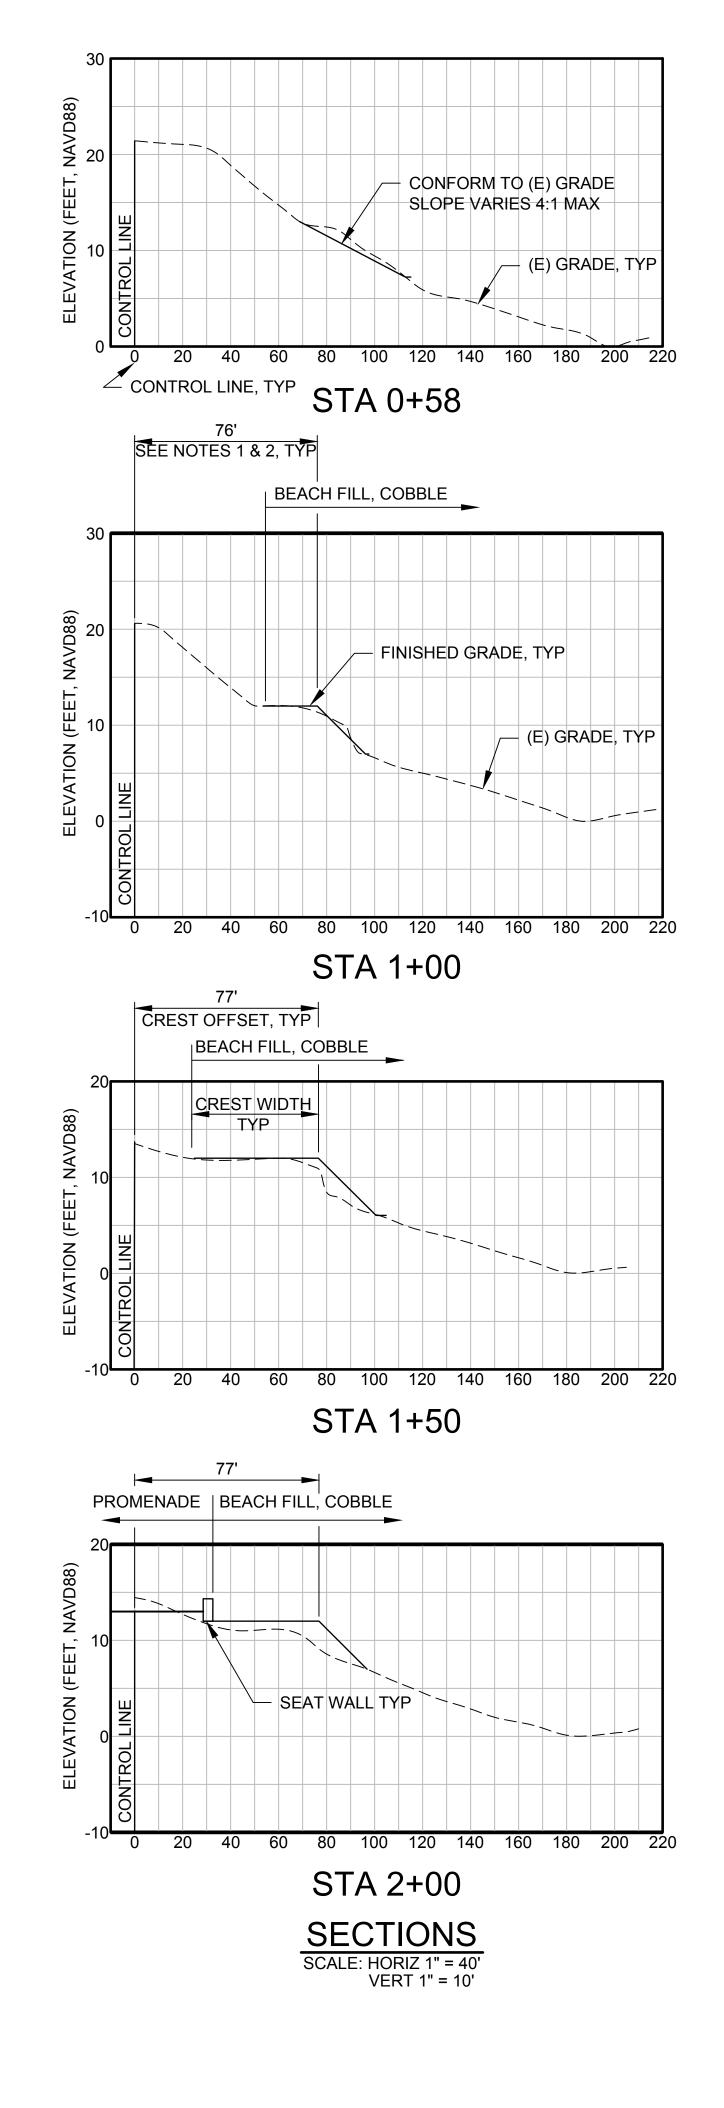

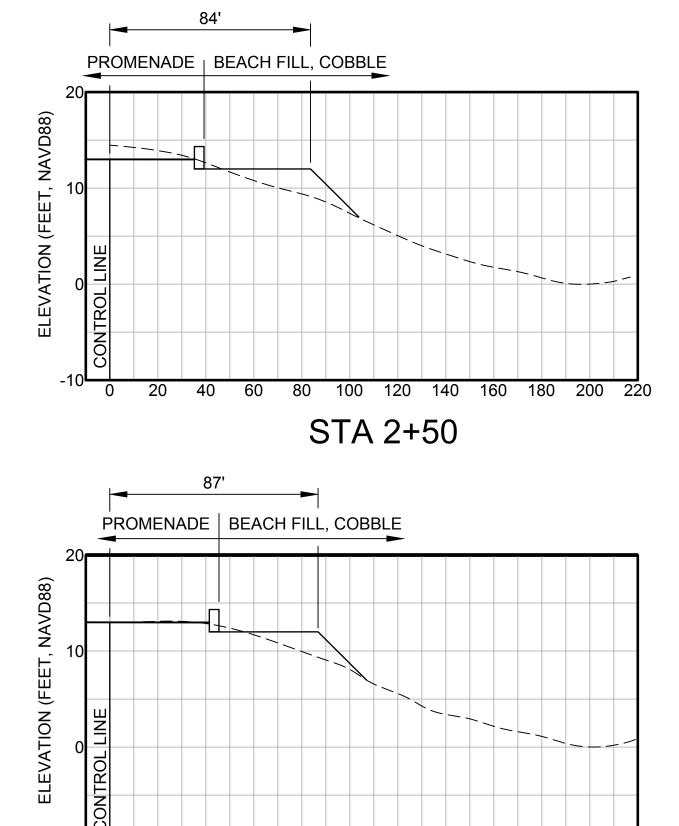

STA 3+00

No. C−66369 ★ Exp. <u>06/30/2022</u> ★


Mods Jargenson

P.E. #C-66369 / EXPIRES 06/30/22

MADS JORGENSEN, PROJECT MANAGER

APPROVED DATE:

MOFFATT & NICHOL

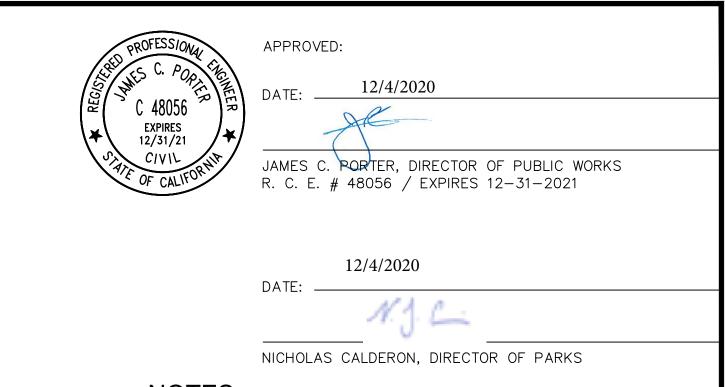


### NOTES:

- 1. CREST WIDTH SHOWN IS BASED ON TOPOGRAPHY AS SURVEYED AND MAY NOT REPRESENT ACTUAL CONDITIONS AT THE TIME OF CONSTRUCTION. THE CONTRACTOR SHALL VERIFY EXISTING TOPOGRAPHIC CONDITIONS AND PERFORM PRE-FILL SURVEY IN ACCORDANCE WITH THE SPECIFICATIONS.
- 2. ADJUST CREST OFFSET TO ACHIEVE CONFORM AT ELEV +7' BASED UPON PRE-FILL SURVEY.
- 3. FOR CONTROL LINE ALIGNMENT, SEE SHEET SP-1.



moffatt & nichol 2185 N. California Blvd., Suite 500 Walnut Creek, California 94596




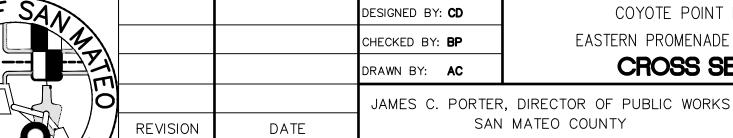

FOR REDUCED PLANS ORIGINAL SCALE IS IN INCHES

COYOTE POINT RECREATION AREA SCALE: AS NOTED EASTERN PROMENADE REJUVENATION PROJECT DATE: 10/11/2019 CROSS SECTIONS - 2

555 COUNTY CENTER, 5th FLOOR REDWOOD CITY, CALIFORNIA 94063 SP-4 SHEET **49** OF 59

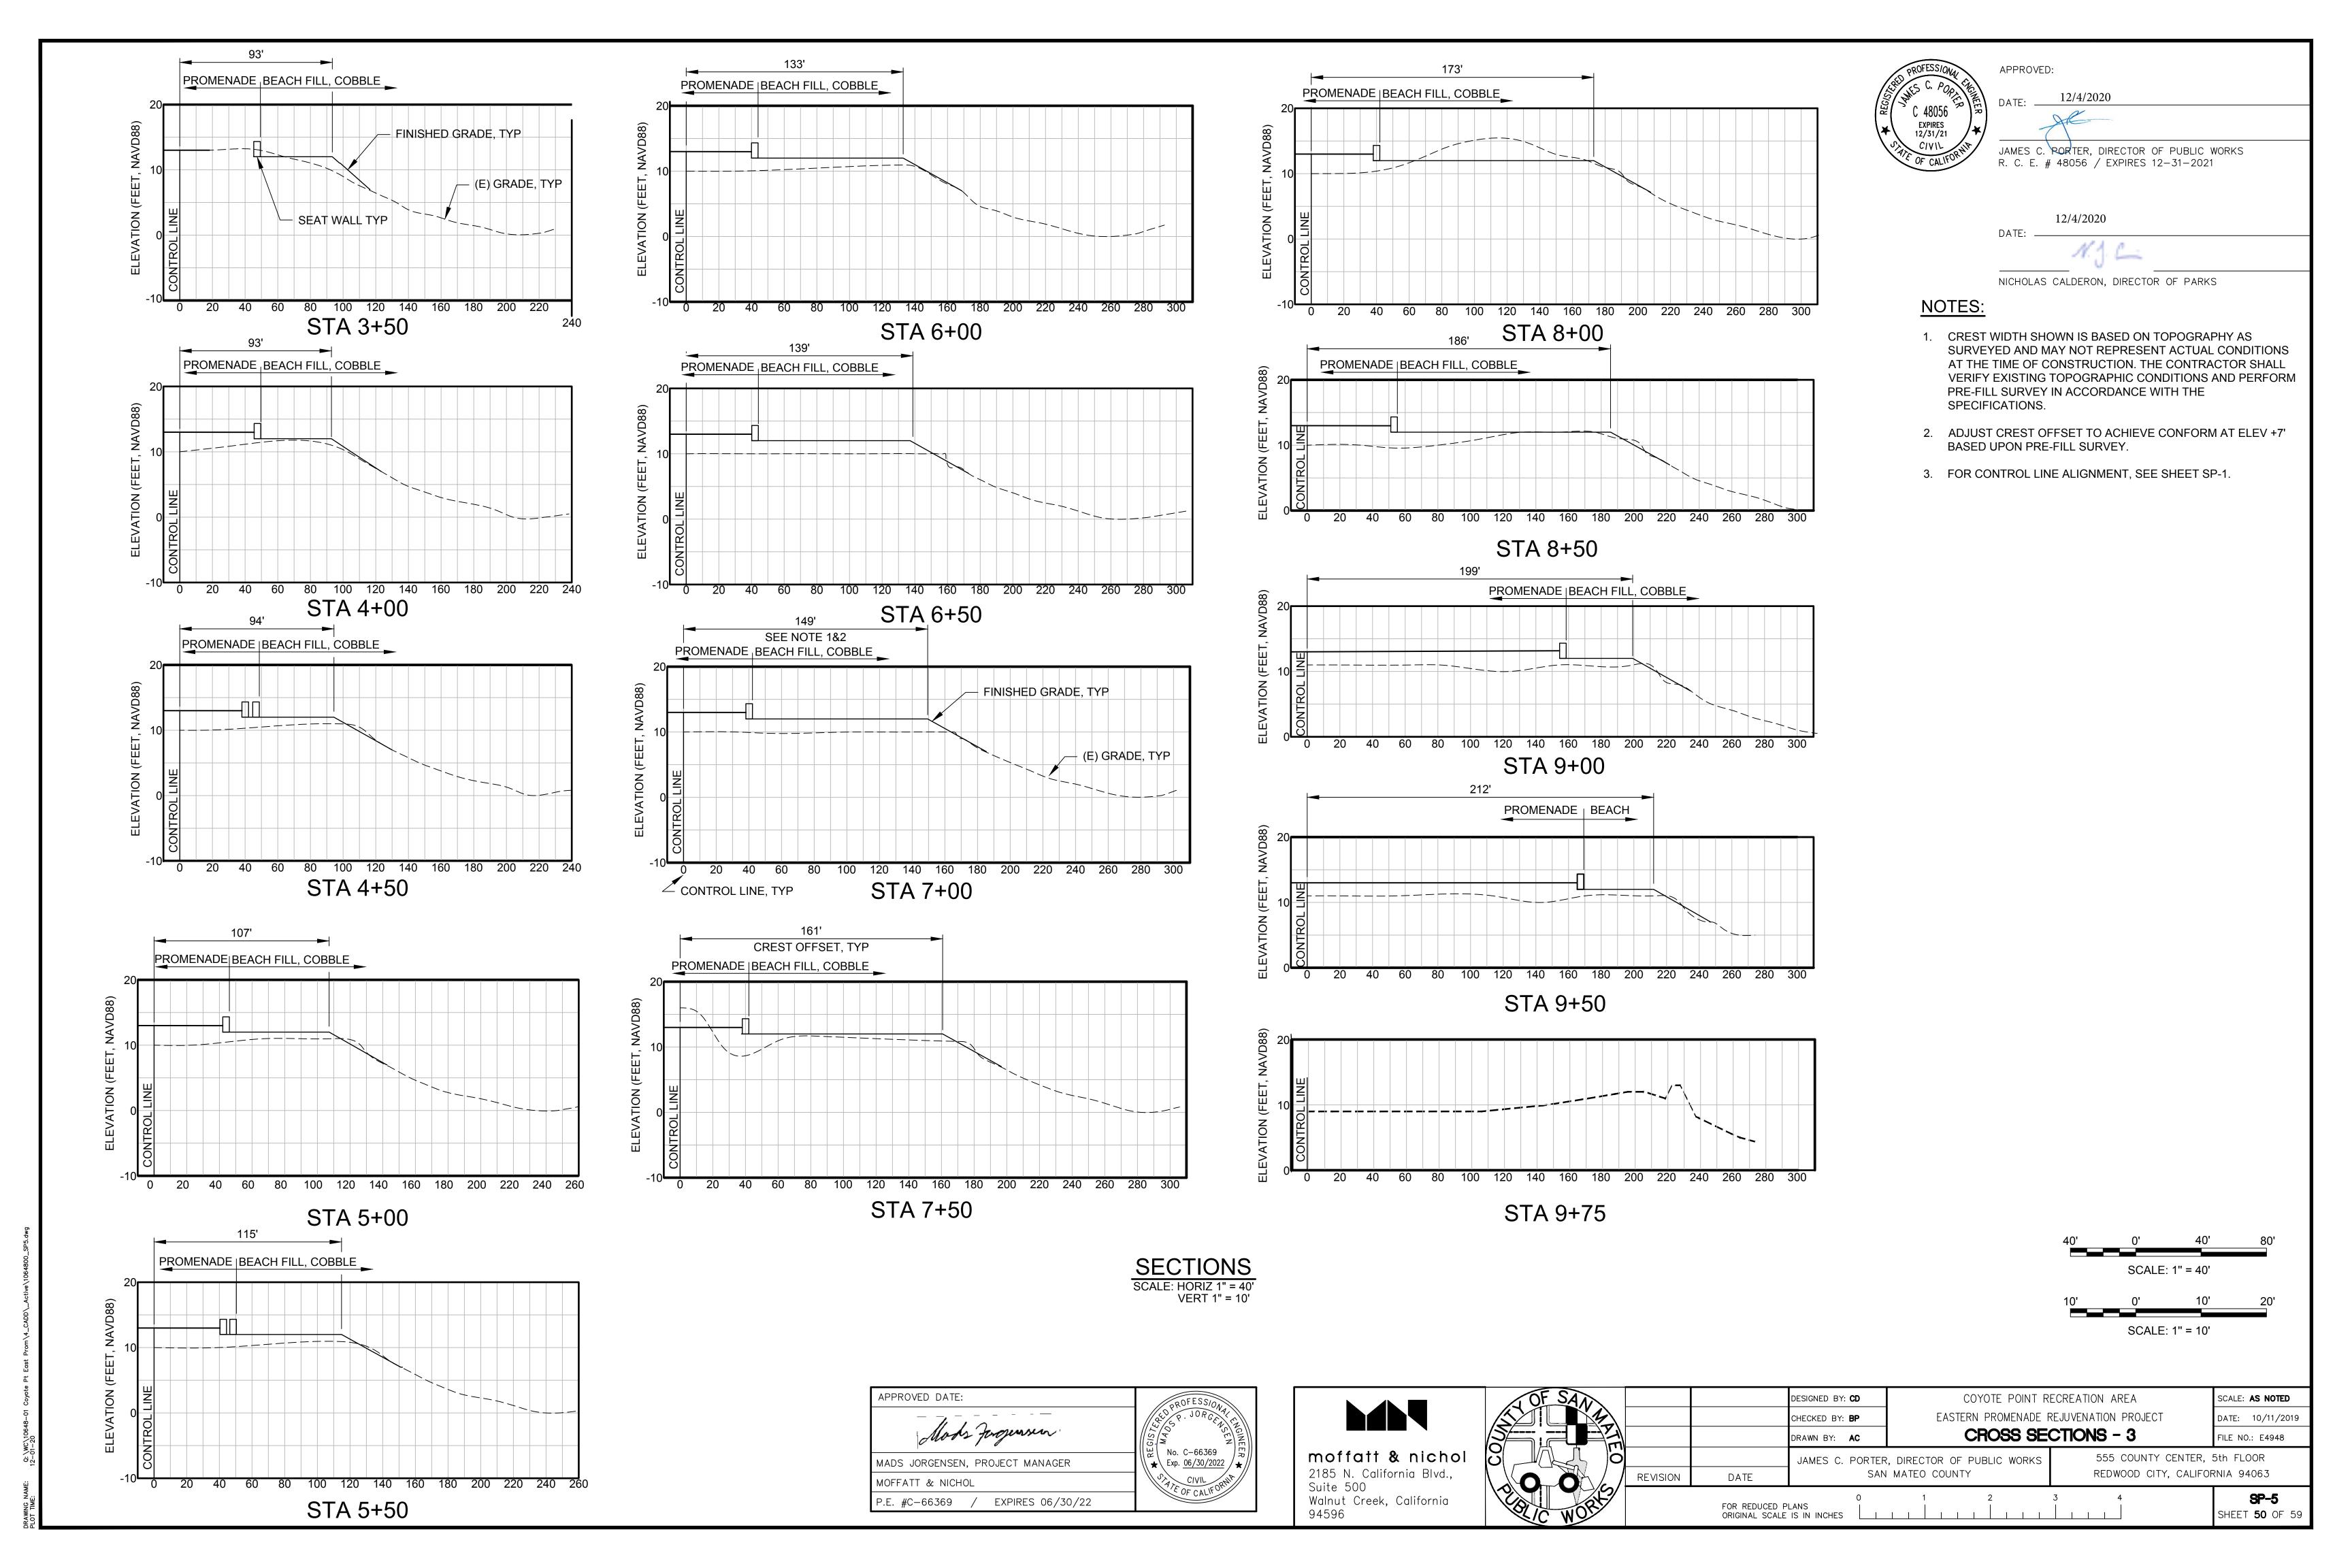

LIGHT SWITCH, FLUSH MOUNTED, 120/277V, 20 AMP, 48" AFF SUBSCRIPT "a" DENOTES LAMPS CONTROLLED LIGHT SWITCH, THREE WAY, FLUSH MOUNTED, 120/277V, 20AMP, 48"AFF MANUAL MOTOR STARTER, HORSEPOWER RATED CEILING MOUNTED OCCUPANCY SENSOR WALL MOUNTED, BI-LEVEL CONTROL DUAL TECHNOLOGY OCCUPANCY SENSOR WITH BUILT-IN LIGHT LEVEL SENSOR AND 180 DEGREE COVERAGE. "WATTSTOPPER" #DW-200 WALL MOUNTED, PASSIVE INFRARED OCCUPANCY SENSOR WITH BUILT-IN LIGHT LEVEL SENSOR AND 180 DEGREE COVERAGE. "WATTSTOPPER" #WS-200 FOURPLEX RECEPTACLE, FLUSH MOUNTED, NEMA 5-20R, 20AMP, 125V, DUPLEX RECEPTACLE, FLUSH MOUNTED, NEMA 5-20R, 20 AMP, 125V. 18" AFF UON. SUBSCRIPT "GFI" DENOTES WITH GROUND FAULT INTERRUPTER WHERE INDICATED ON PLAN DUPLEX RECEPTACLE, FLUSH MOUNTED, NEMA 5-20R, 20 AMP, 125V, 18" AFF UON DUPLEX RECEPTACLE, +42" A.F.F. OR ABOVE BACKSPLASH, NEMA 5-20R, 20 AMP 125V. DUPLEX RECEPTACLE FLOOR MOUNTED. HEAVY DUTY NON-FUSED DISCONNECT SWITCH, SEE DWGS FOR EXACT TYPE AND SIZE, HORSEPOWER RATED, 48" AFF UON TELE/DATA OUTLET, 4" SQUARE BOX x 2-3/8" DEPTH WITH 4" PLASTER RING. PROVIDE PULL STRING AND TERMINATE IN CEILING SPACE. TELEPHONE OUTLET, 4" SQUARE BOX x 2-3/8" DEPTH WITH 4" PLASTER RING. PROVIDE PULL STRING AND TERMINATE IN CEILING SPACE. o, Q JUNCTION BOX, LOCATE IN AN ACCESSIBLE LOCATION, CEILING MOUNTED, WALL MOUNTED +18" AFF UON MOTOR OUTLET AND CONNECTION, MOTOR FURNISHED BY **M**/ OTHERS, CONNECTED BY ELECTRICAL CONDUIT WITH WIRES, CONCEALED ABOVE CEILING OR IN WALL IN FINISHED AREAS EXPOSED IN UNFINISHED AREAS UNLESS OTHERWISE NOTED. HASH MARKS INDICATE NUMBER OF WIRES IF MORE THAN (3); "#10" INDICATES WIRES SIZE IF OTHER THAN #12 AWG. CONDUIT SIZE IS 3/4" U.O.N. -NEUTRAL WIRE, #10 MIN. WHERE NEUTRAL IS SHARED BY TWO OR MORE CIRCUITS —GROUND WIRE, #12 AWG U.O.N. CONDUIT WITH WIRES, CONCEALED UNDERGROUND, OR IN CRAWL SPACE UON CONDUIT WITH WIRES, HOMERUN TO PANELBOARD CIRCUIT IDENTIFICATION; IN THIS CASE, PANEL "A", CIRCUITS "16" AND "18" MC CABLE <del>-----</del> — T/D — CONDUIT FOR TELEPHONE AND DATA SYSTEM CONDUIT FOR FIRE ALARM SYSTEM — SA — CONDUIT FOR SECURITY ALARM SYSTEM FLEXIBLE WIRING AND EQUIPMENT CONNECTION  $\sim$ CONDUIT DOWN CONDUIT UP CONDUIT STUB OUT <del>//////////</del> EXISTING EQUIPMENT AND MATERIAL TO BE DISCONNECTED AND REMOVED. 120/208V OR 120/240V ELECTRICAL PANELBOARD, RECESSED OR SURFACE MOUNTED ILLUMINATED EXIT SIGN. SINGLE FACE. SHADE DENOTES FACE OF FIXTURE FLOOD LIGHT PROMENADE PATH LIGHT FIXTURE  $\alpha$ TWIN HEAD PARKING LOT LIGHT FIXTURE SINGLE HEAD PARKING LOT LIGHT FIXTURE (E) PARKING LOT LIGHT FIXTURE 1'x4' FLUORESCENT LIGHT FIXTURE WALL PACK LIGHT FIXTURE  $\vdash$ VANDAL RESISTANT WALL MOUNTED 3' FLUORESCENT STRIP LIGHT FIXTURE -POST TOP LIGHT FIXTURE

MOTION DETECTOR SMOKE DETECTOR HEAT DETECTOR STROBE, CANDELA LEVEL AS INDICATED COMBINATION HORN/STROBES, CANDELA LEVEL AS INDICATED MANUAL PULL STATION MONITORING MODULE CONTROL MODULE PASSIVE INFRARED MOTION DETECTOR ENGLISH DISPLAY KEYPAD SECURITY ALARM BELL. DOOR CONTACT MECHANICAL EQUIPMENT TAG LIGHTING FIXTURE IDENTIFICATION TAG. LETTER "A" DENOTES TYPE OF FIXTURE. SHEET NOTE IDENTIFICATION TAG, SEE SHEET NOTE 1 DETAIL IDENTIFICATION TAG, SEE DETAIL 1 OF SHEET E-5 E-5 NORTH ARROW **ABBREVIATIONS** AMPERE ALTERNATING CURRENT ANN ANNUNCIATOR AS AMMETER SWITCH ATS AUTOMATIC TRANSFER SWITCH

AUX. AUXILIARY AWG AMERICAN WIRE GAUGE BAL **BALANCE** BATT. BATTERY B.C.W. BARE COPPER WIRE BKR **BREAKER** BUILDING BOT BOTTOM CONDUIT CB CIRCUIT BREAKER CAB CABINET CAP CAPACITOR CDF CONTROLLED DENSITY FILL CHGR. CHARGER CKT CIRCUIT CURRENT LIMITING, CURRENT LIMITING "E" FUSE CL,CLE COL COLUMN COMP COMPARTMENT CONT. CONTROL CNTLR CONTROLLER CONC CONCRETE COND. CONDUCTOR CPT CONTROL POWER TRANSFORMER C.S. CONTROL SWITCH CSU CHANNEL SERVICE UNIT CURRENT TRANSFORMER COPPER CUB CUBICLE

DEEP

DUCT BANK

DEAD END

DIMENSION

DISCONNECT

DISTRIBUTION

DATA SERVICE UNIT

ELECTRICALLY OPERATED

ELECTRONIC DISPLAY MULTIMETER

ETHYLENE PROPYLENE RUBBER

FIRE ALARM CONTROL PANEL

DIAMETER

DRAWING

ELECTRICAL

ELEVATION

**EQUIPMENT** 

FOOT, FEET

FEEDER

FUTURE

FIELD

**FUSE** 

EACH

DIRECT CURRENT

D

DB

DC

D.E.

DIA

DIM

DISC

DIST.

DSU DWG

EΑ

ΕO

EDM

ELEC

ELEV

EPR

**EQUIP** 

FACP

FDR

FLD

FT

FUT.

F,FU

MAX MAXIMUM MCC MOTOR CONTROL CENTER MCCB MED MOLDED CASE CIRCUIT BREAKER MEDIUM MFR. MANUFACTURER МН MANHOLE МІ MECHANICAL INTERLOCK MIN MINIMUM MISC **MISCELLANEOUS** МО MANUALLY OPERATED MR MULTI-RATIO MSB MAIN SWITCHBOARD MOUNTED ΜV MEDIUM VOLTAGE MVA MEGA-VOLT AMPERE MW MEGAWATT N.C. NORMALLY CLOSED N.I.C. NOT IN CONTRACT N.O. NORMALLY OPEN N.T.S. NOT TO SCALE NP NAMEPLATE ON CENTER 0/C OVERCURRENT OVERHEAD **OVERLOAD** OL OPER. OPERATING P.B. PULL BOX POLYCHLORINATED BIPHENYLS PCB PCC PORTLAND CEMENT CONCRETE P.F. POWER FACTOR POWER FACTOR CORRECTION CAPACITOR PNL. PANEL PVC POLYVINYL CHLORIDE POWER PACIFIC GAS & ELECTRIC RADIUS REM REMOTE RSC, RSG RIGID STEEL CONDUIT, GALVANIZED REQ'D REQUIRED S.A. SURGE ARRESTERS SB SHORTING BLOCK SCH SCHEDULE SPD SEC SURGE PROTECTION DEVICE SECONDARY SHLD. SHIELDED SHT SHEET SPR SPARE SS STAINLESS STEEL SSRVS SOLID STATE REDUCED VOLTAGE STARTER ST SHUNT TRIP STA. STATION SHORT CIRCUITING TERMINAL BLOCK STB STD STANDARD SUB SUBSTATION SVCE SERVICE SW SWITCH **SWITCHBOARD** SWBD SWGR SWITCHGEAR SYMMETRICAL SYM TEL **TELEPHONE** TELEM **TELEMETERING** TEMP TEMPORARY TERM TERMINAL TOC TOP OF CONCRETE TS TEST SWITCH

TYP.

TYPICAL

GAL

G.L.

GND

GFCI

HT

НН

HV

IDP

INC

IND

INS

IRR

ΚV

KVA

ΚW

 $\mathsf{L}\mathsf{-}\mathsf{L}$ 

LTG

LPS

LV

LxWxH

KVAR

GALV

GALLONS

GROUND

HEIGHT

HEATER

HANDHOLE

INCOMING

INDICATION

**INSULATOR** 

IRRIGATION

KILOVOLT

KILOWATT

POUNDS

LIGHTING

LOW VOLTAGE

LONG. LENGTH

LINE TO LINE

LINE TO NEUTRAL

LOAD TAP CHANGER

JUNCTION BOX

KILOVOLT AMPERE

LIGHTNING ARRESTER

HIGH VOLTAGE

INTERRUPTING CAPACITY

JACKET WATER HEATER

THOUSAND CIRCULAR MILS

KILOVOLT AMPERE REACTIVE

INSTANTANEOUS, GROUND

LENGTH, WIDTH AND HEIGHT

LOW PRESSURE SODIUM

LONG TIME DELAY, SHORT TIME DELAY

INTRUSION DETECTION PANEL

GALVANIZED

GRADE LEVEL

GROUND FAULT CIRCUIT INTERRUPTER

ABBREVIATIONS (CONTINUE)



APPROVED: 12/4/2020 JAMES C. RORTER, DIRECTOR OF PUBLIC WORKS R. C. E. # 48056 / EXPIRES 12-31-2021

12/4/2020 DATE: \_\_\_\_\_

NICHOLAS CALDERON, DIRECTOR OF PARKS

**ABBREVIATIONS (CONTINUE)** 

UNDERGROUND U.G. U.O.N. UNLESS OTHERWISE NOTED UNDERWRITER LABORATORIES UL UV UNDERVOLTAGE

VOLT

W/

XFR

VACUUM CIRCUIT BREAKER V.C.B. VS VOLTMETER SWITCH V.T. **VOLTAGE TRANSFORMER** 

WEIGHT **WEATHERPROOF XDCR TRANSDUCER XFMR** TRANSFORMER

#### **DRAWING INDEX**

TRANSFER

E-1GENERAL NOTES, LEGEND, ABBREVIATIONS, AND DRAWING INDEX

E-2DSITE PLAN - ELECTRICAL DEMOLITION

E-3SINGLE LINE DIAGRAM

E-4KEY SITE PLAN - NEW WORK

E-5POWER AND LIGHTING ENLARGED PLAN - SHEET 1

E-6POWER AND LIGHTING ENLARGED PLAN - SHEET 2

E-7LIGHTING SCHEDULE AND PANEL SCHEDULES

E-8 ELECTRICAL DETAILS


E-9 EXISTING DUCTBANK VERTICAL RE-ALIGNMENT


SYMBOLS AND ABBREVIATIONS ARE FOR GENERAL USE. DISREGARD THOSE WHICH ARE NOTE USED ON THE DRAWINGS.

#### **GENERAL NOTES:**


- 1. THE COMPLETE ELECTRICAL INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE CALIFORNIA ELECTRICAL CODE, COUNTY OF SAN MATEO STANDARD PLANS AND SPECIFICATIONS. THE LATEST RULES AND REGULATIONS OF THE SAFETY ORDERS ISSUED BY THE DIVISION OF INDUSTRIAL SAFETY. THE NATIONAL BOARD OF FIRE UNDERWRITERS AND ALL APPLICABLE STATE AND LOCAL CODES ISSUED BY AUTHORITIES HAVING JURISDICTION
- 2. LOCATION(S) OF ELECTROLIERS, CONDUIT, PULL BOXES AND OTHER EQUIPMENT AS SHOWN ON THE PLAN IS APPROXIMATE AND MAY BE CHANGED TO SUIT FIELD CONDITIONS AS DIRECTED BY THE ENGINEER.
- 3. TOP OF FOUNDATION FOR LIGHTING ELECTROLIERS SHALL BE 2'-6" ABOVE THE SURROUNDING GRADE OR TOP OF CURB GRADE IN CURBED AREAS AS APPLICABLE U.O.N.
- 4. PULL ROPE SHALL BE PROVIDED IN ALL EMPTY CONDUITS.
- 5. ELECTRICAL EQUIPMENT AND FEEDER SHALL BE SUPPORTED AND/OR ANCHORED IN ACCORDANCE WITH CBC SEISMIC REQUIREMENTS.
- 6. UPON COMPLETION OF ELECTRICAL WORK, THE CONTRACTOR SHALL SCHEDULE AND PERFORM A COMPLETE FIELD AND FUNCTIONAL TESTING TO DEMONSTRATE TO THE COUNTY THAT THE NEW INSTALLATION IS OPERATING AS INTENDED.
- 7. CABLES INSTALLED IN PULLBOXES AND VAULTS SHALL BE SUPPORTED, AS REQUIRED, ON CABLE RACKS, AND SHALL BE ROUTED ALONG WALL USING THE LONGEST RUN BETWEEN ENTRY AND EXIT.




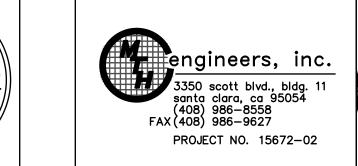




			DESIGNED BY:	GS	COYO	TE POINT R	ECREATION AREA	SCALE: NONE
4			CHECKED BY:	JH	EASTERN P	ROMENADE F	REJUVENATION PROJECT	DATE: 03/08/2020
			DRAWN BY:	VM	GENERAL NOTES, LE	EGEND, ABBF	REVIATIONS, AND DRAWING INDEX	FILE NO.: E4948
			JAMES C.	PORTER	R, DIRECTOR OF PUBL	LIC WORKS	555 COUNTY CENTER,	5th FLOOR
	REVISION	DATE		SAN	N MATEO COUNTY		REDWOOD CITY, CALIFOR	RNIA 94063
55		FOR REDUCED P ORIGINAL SCALE		0	1 2	2	3 4	<b>E-1</b> SHEET <b>51</b> OF 59

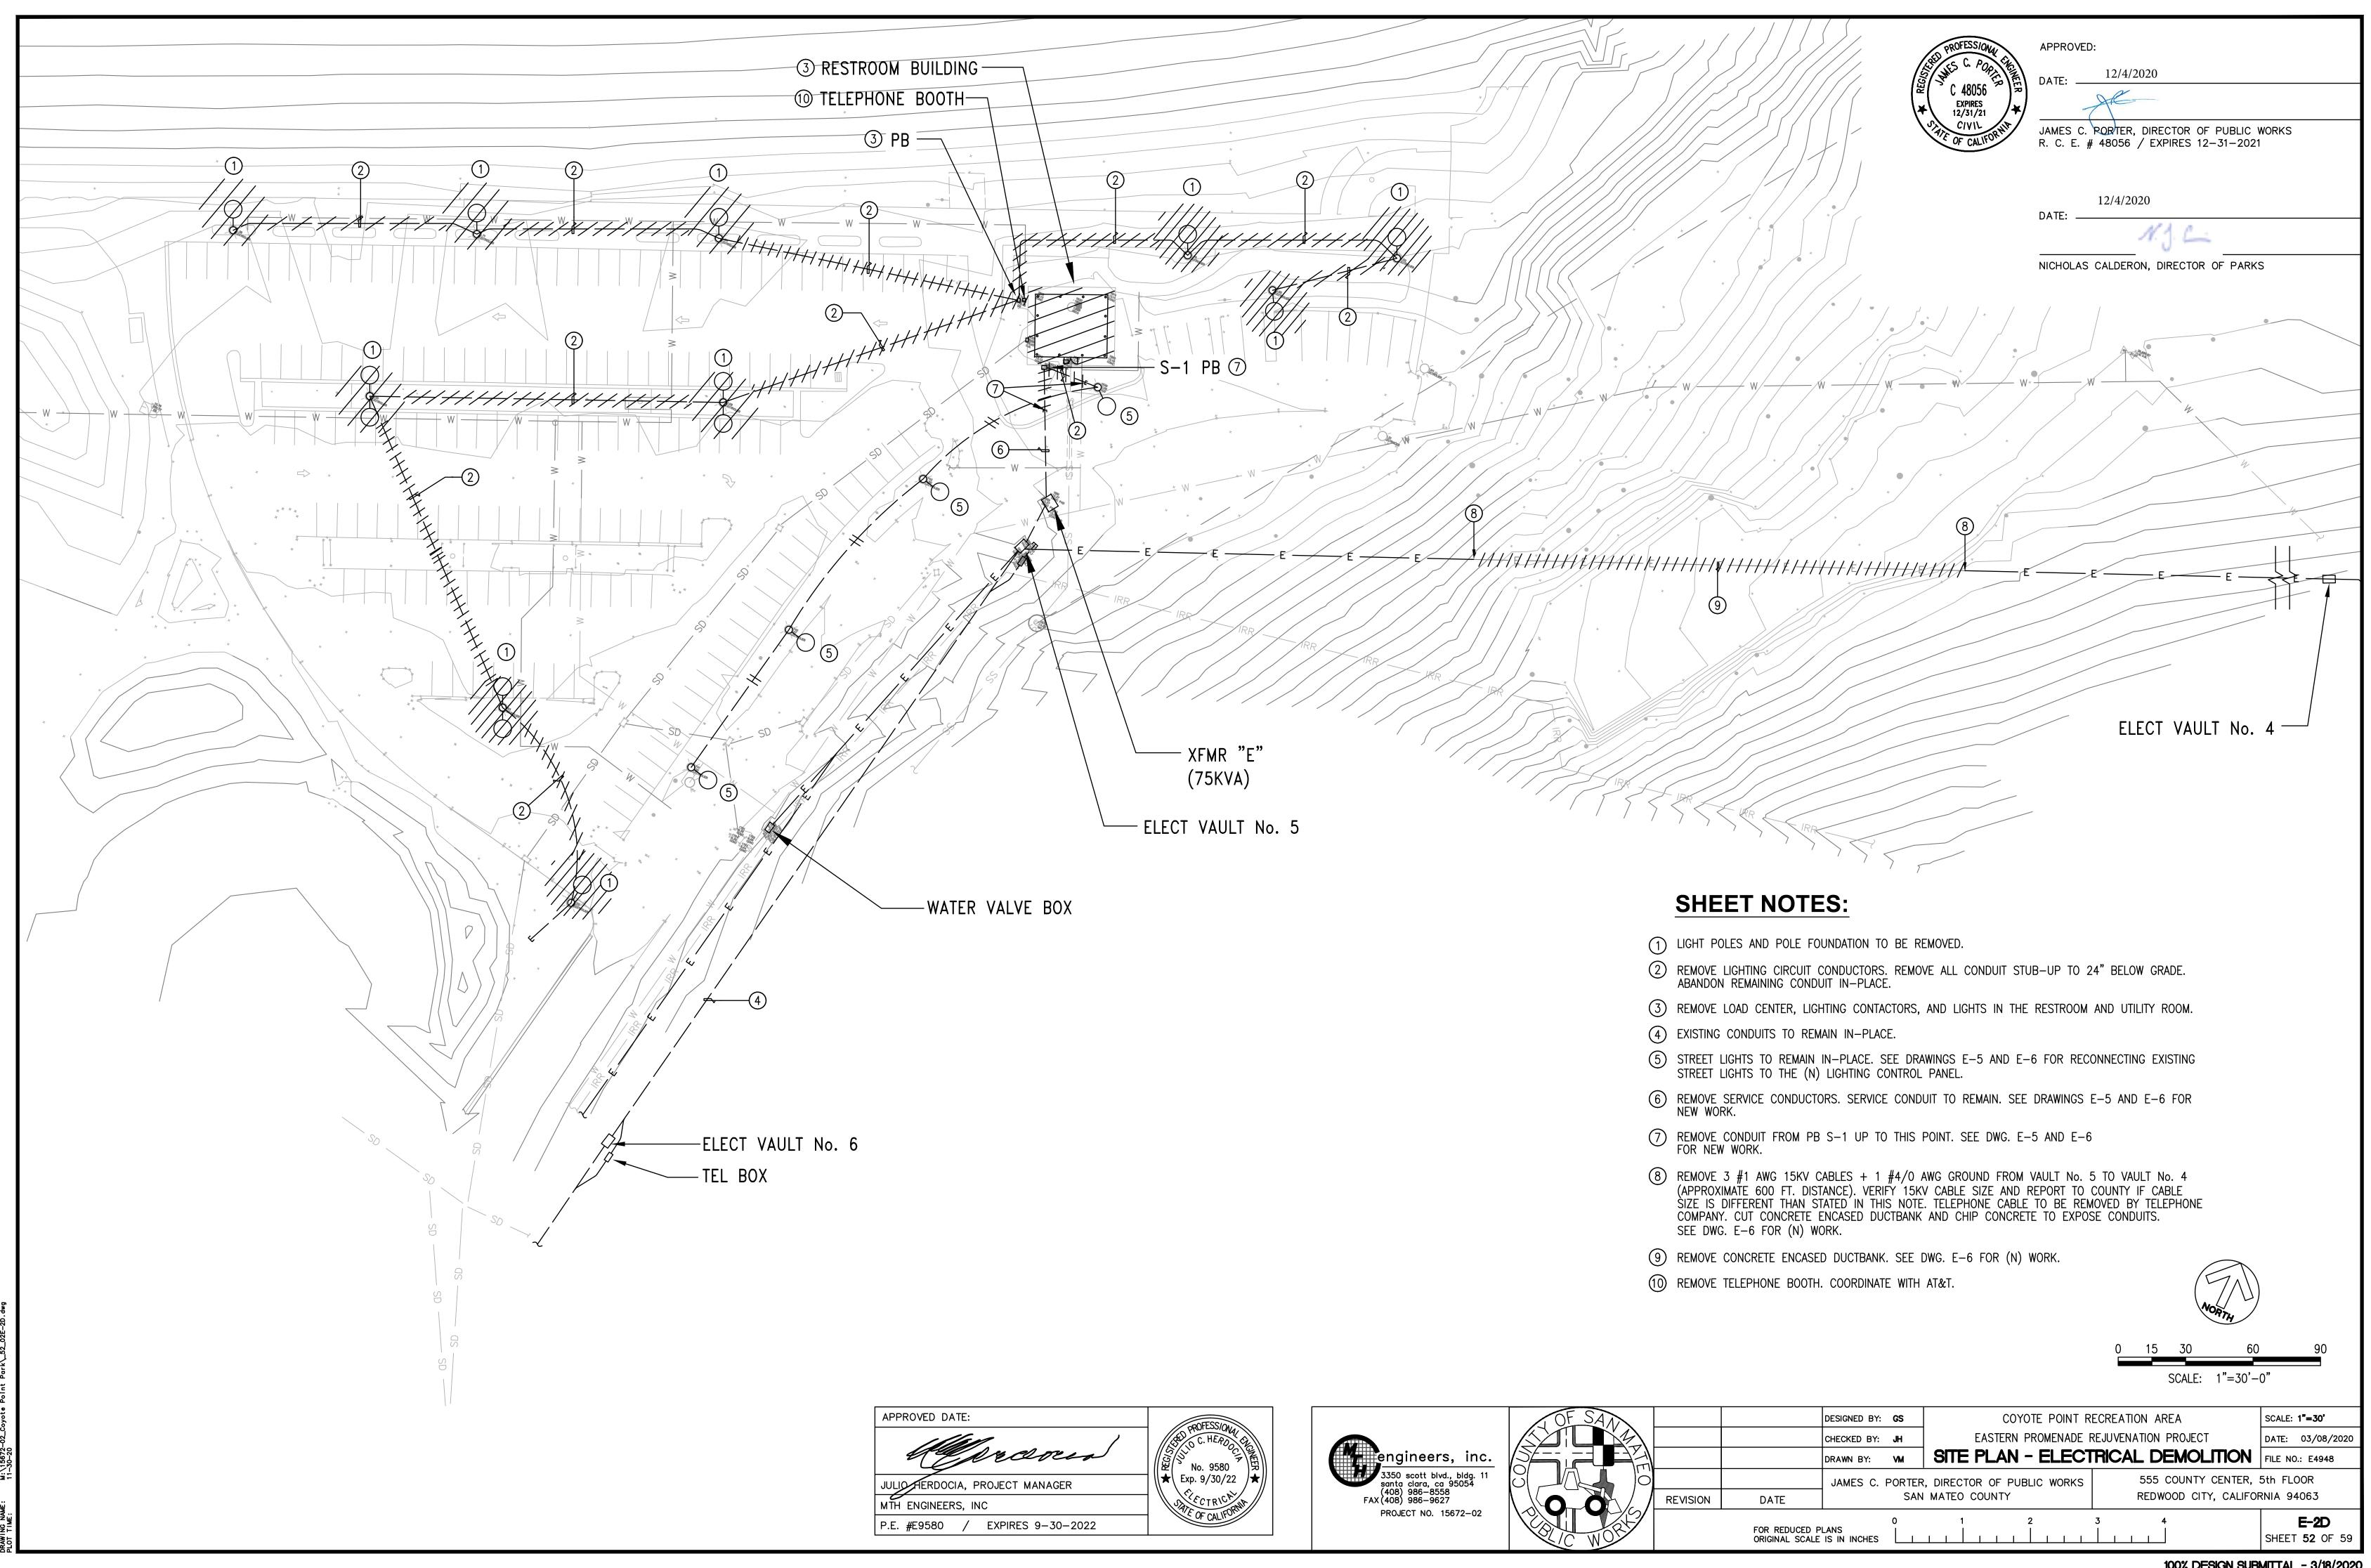

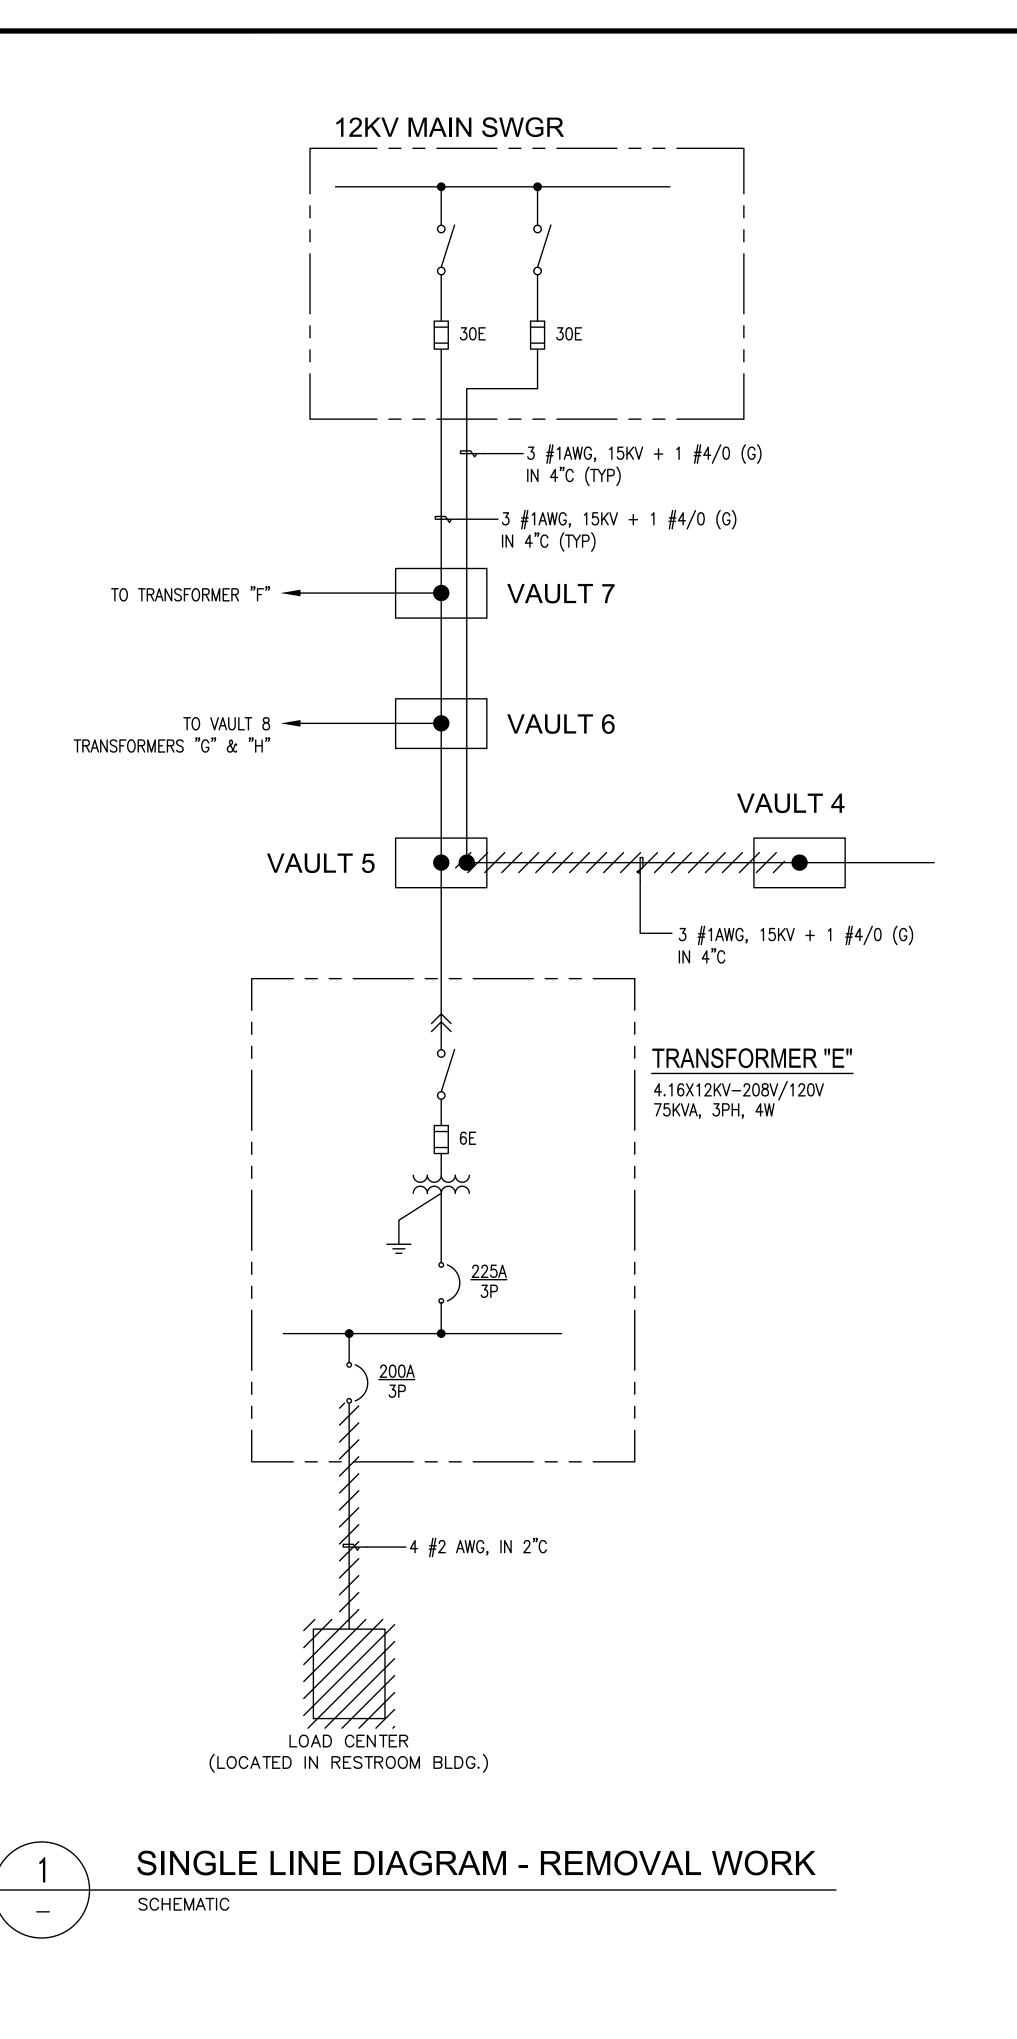

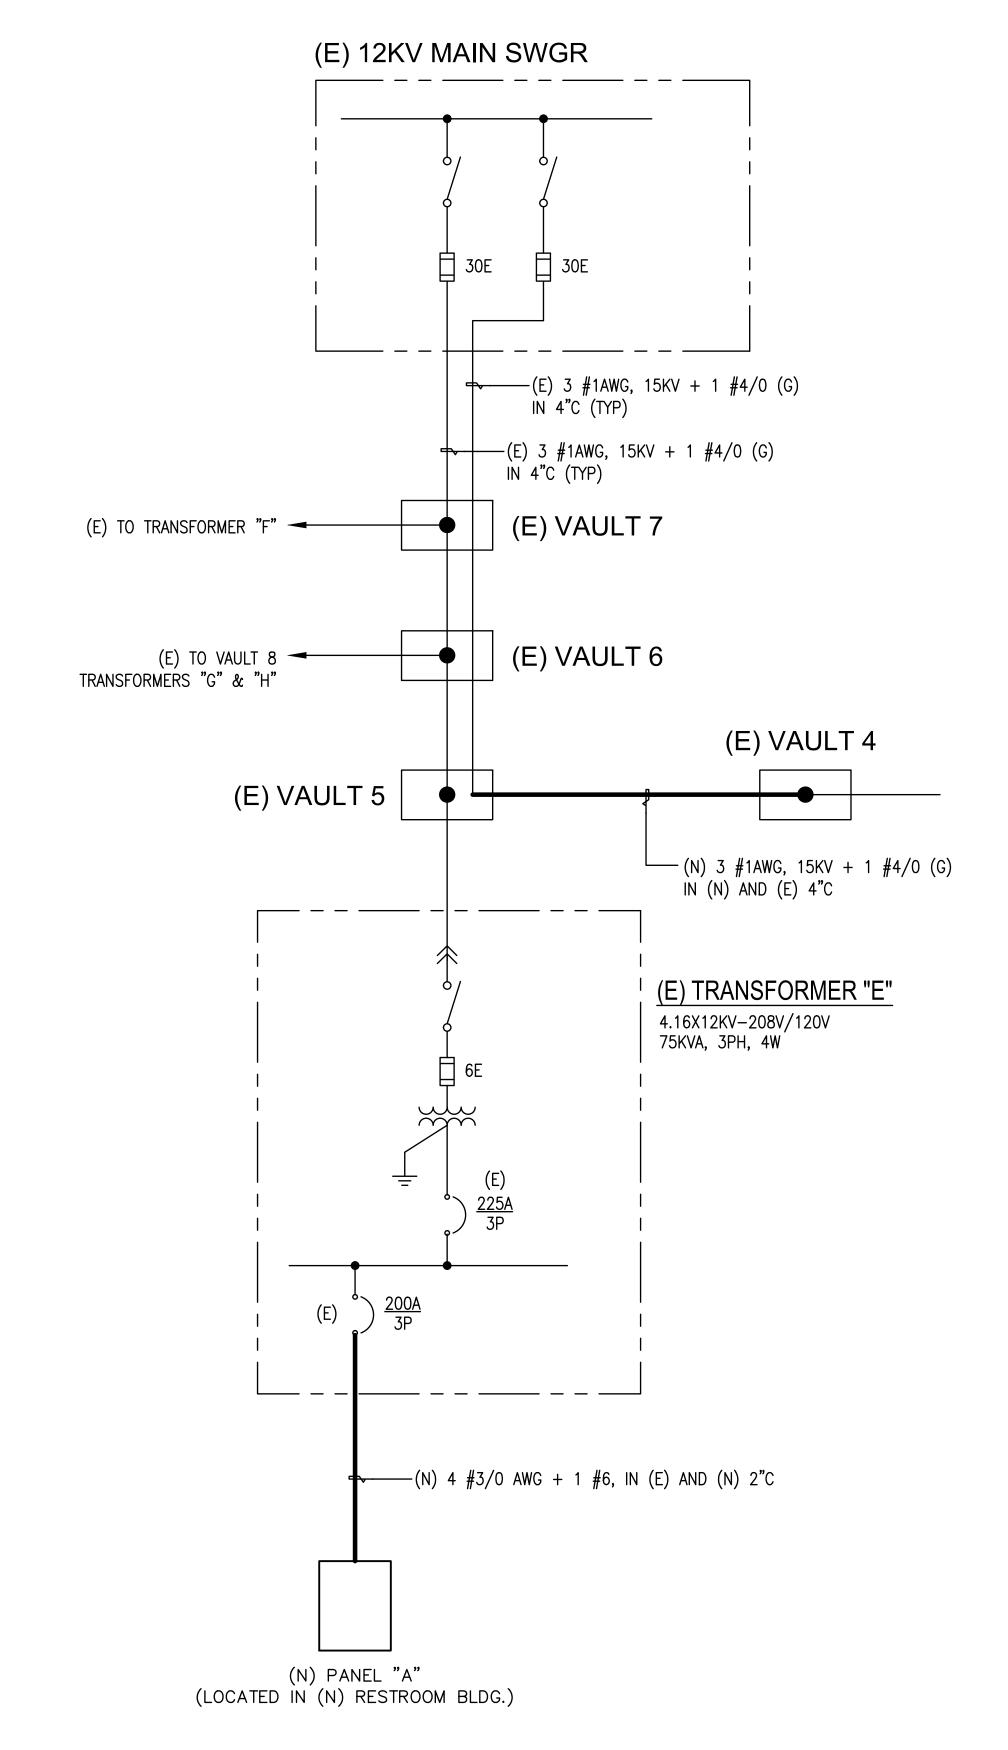



APPROVED DATE:	20/22/400
Mercon	No. 9580
JULIO HERDOCIA, PROJECT MANAGER	Exp. 9/30/22
MTH ENGINEERS, INC	STATE OF ON TORM
P.E. #E9580 / EXPIRES 9-30-2022	OF CALIFO

	1— <u> </u>	neers,	
FA	santa (	scott blvd., clara, ca 95 986—8558 986—9627	
	PROJEC	T NO. 156	72-02

OF SAM	
	F
OLC WOS	

		DESIGNED BY:	(
		CHECKED BY:	,
		DRAWN BY:	,
		JAMES C.	Р
VISION	DATE		

FOR REDUCED PLANS ORIGINAL SCALE IS IN INCHES

COYOTE POINT RECREATION AREA EASTERN PROMENADE REJUVENATION PROJECT SINGLE LINE DIAGRAM

SAN MATEO COUNTY

APPROVED:

DATE: \_\_\_\_\_

C 48056 EXPIRES 12/31/21

12/4/2020


12/4/2020


JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS R. C. E. # 48056 / EXPIRES 12-31-2021


NICHOLAS CALDERON, DIRECTOR OF PARKS

SCALE: NONE DATE: 03/08/2020 FILE NO.: E4948 555 COUNTY CENTER, 5th FLOOR

PORTER, DIRECTOR OF PUBLIC WORKS REDWOOD CITY, CALIFORNIA 94063 E-3 SHEET **53** OF 59

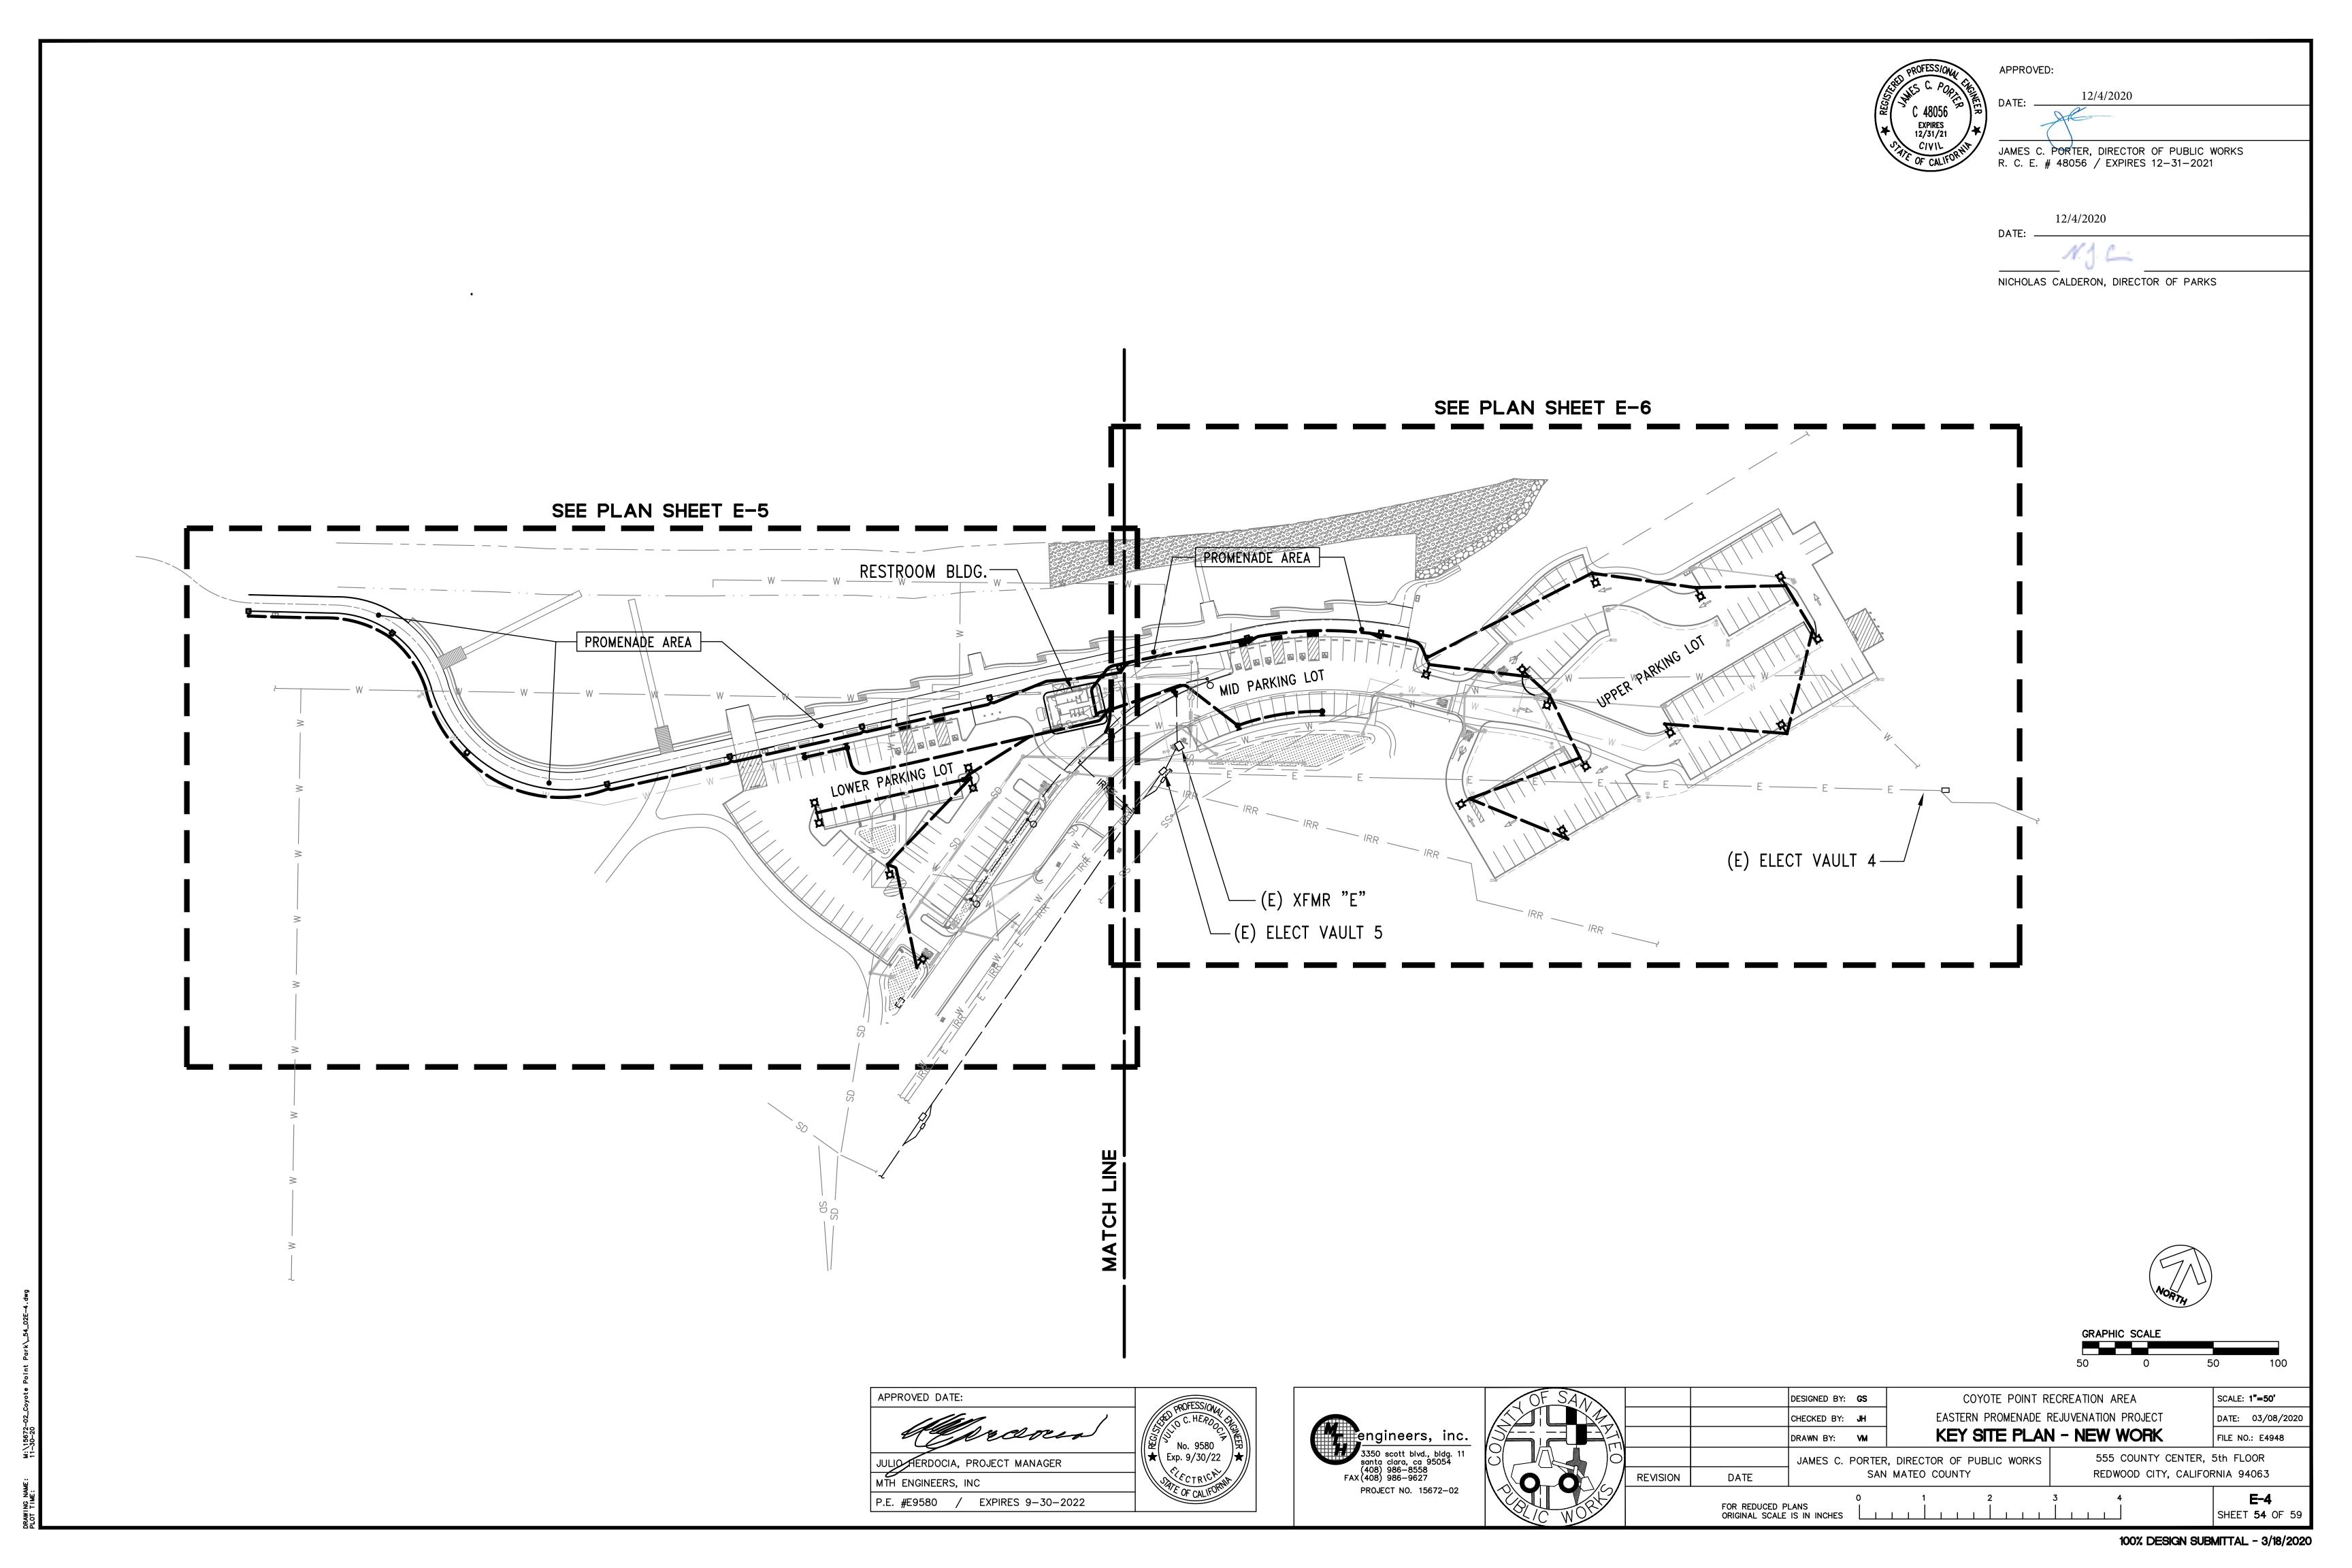

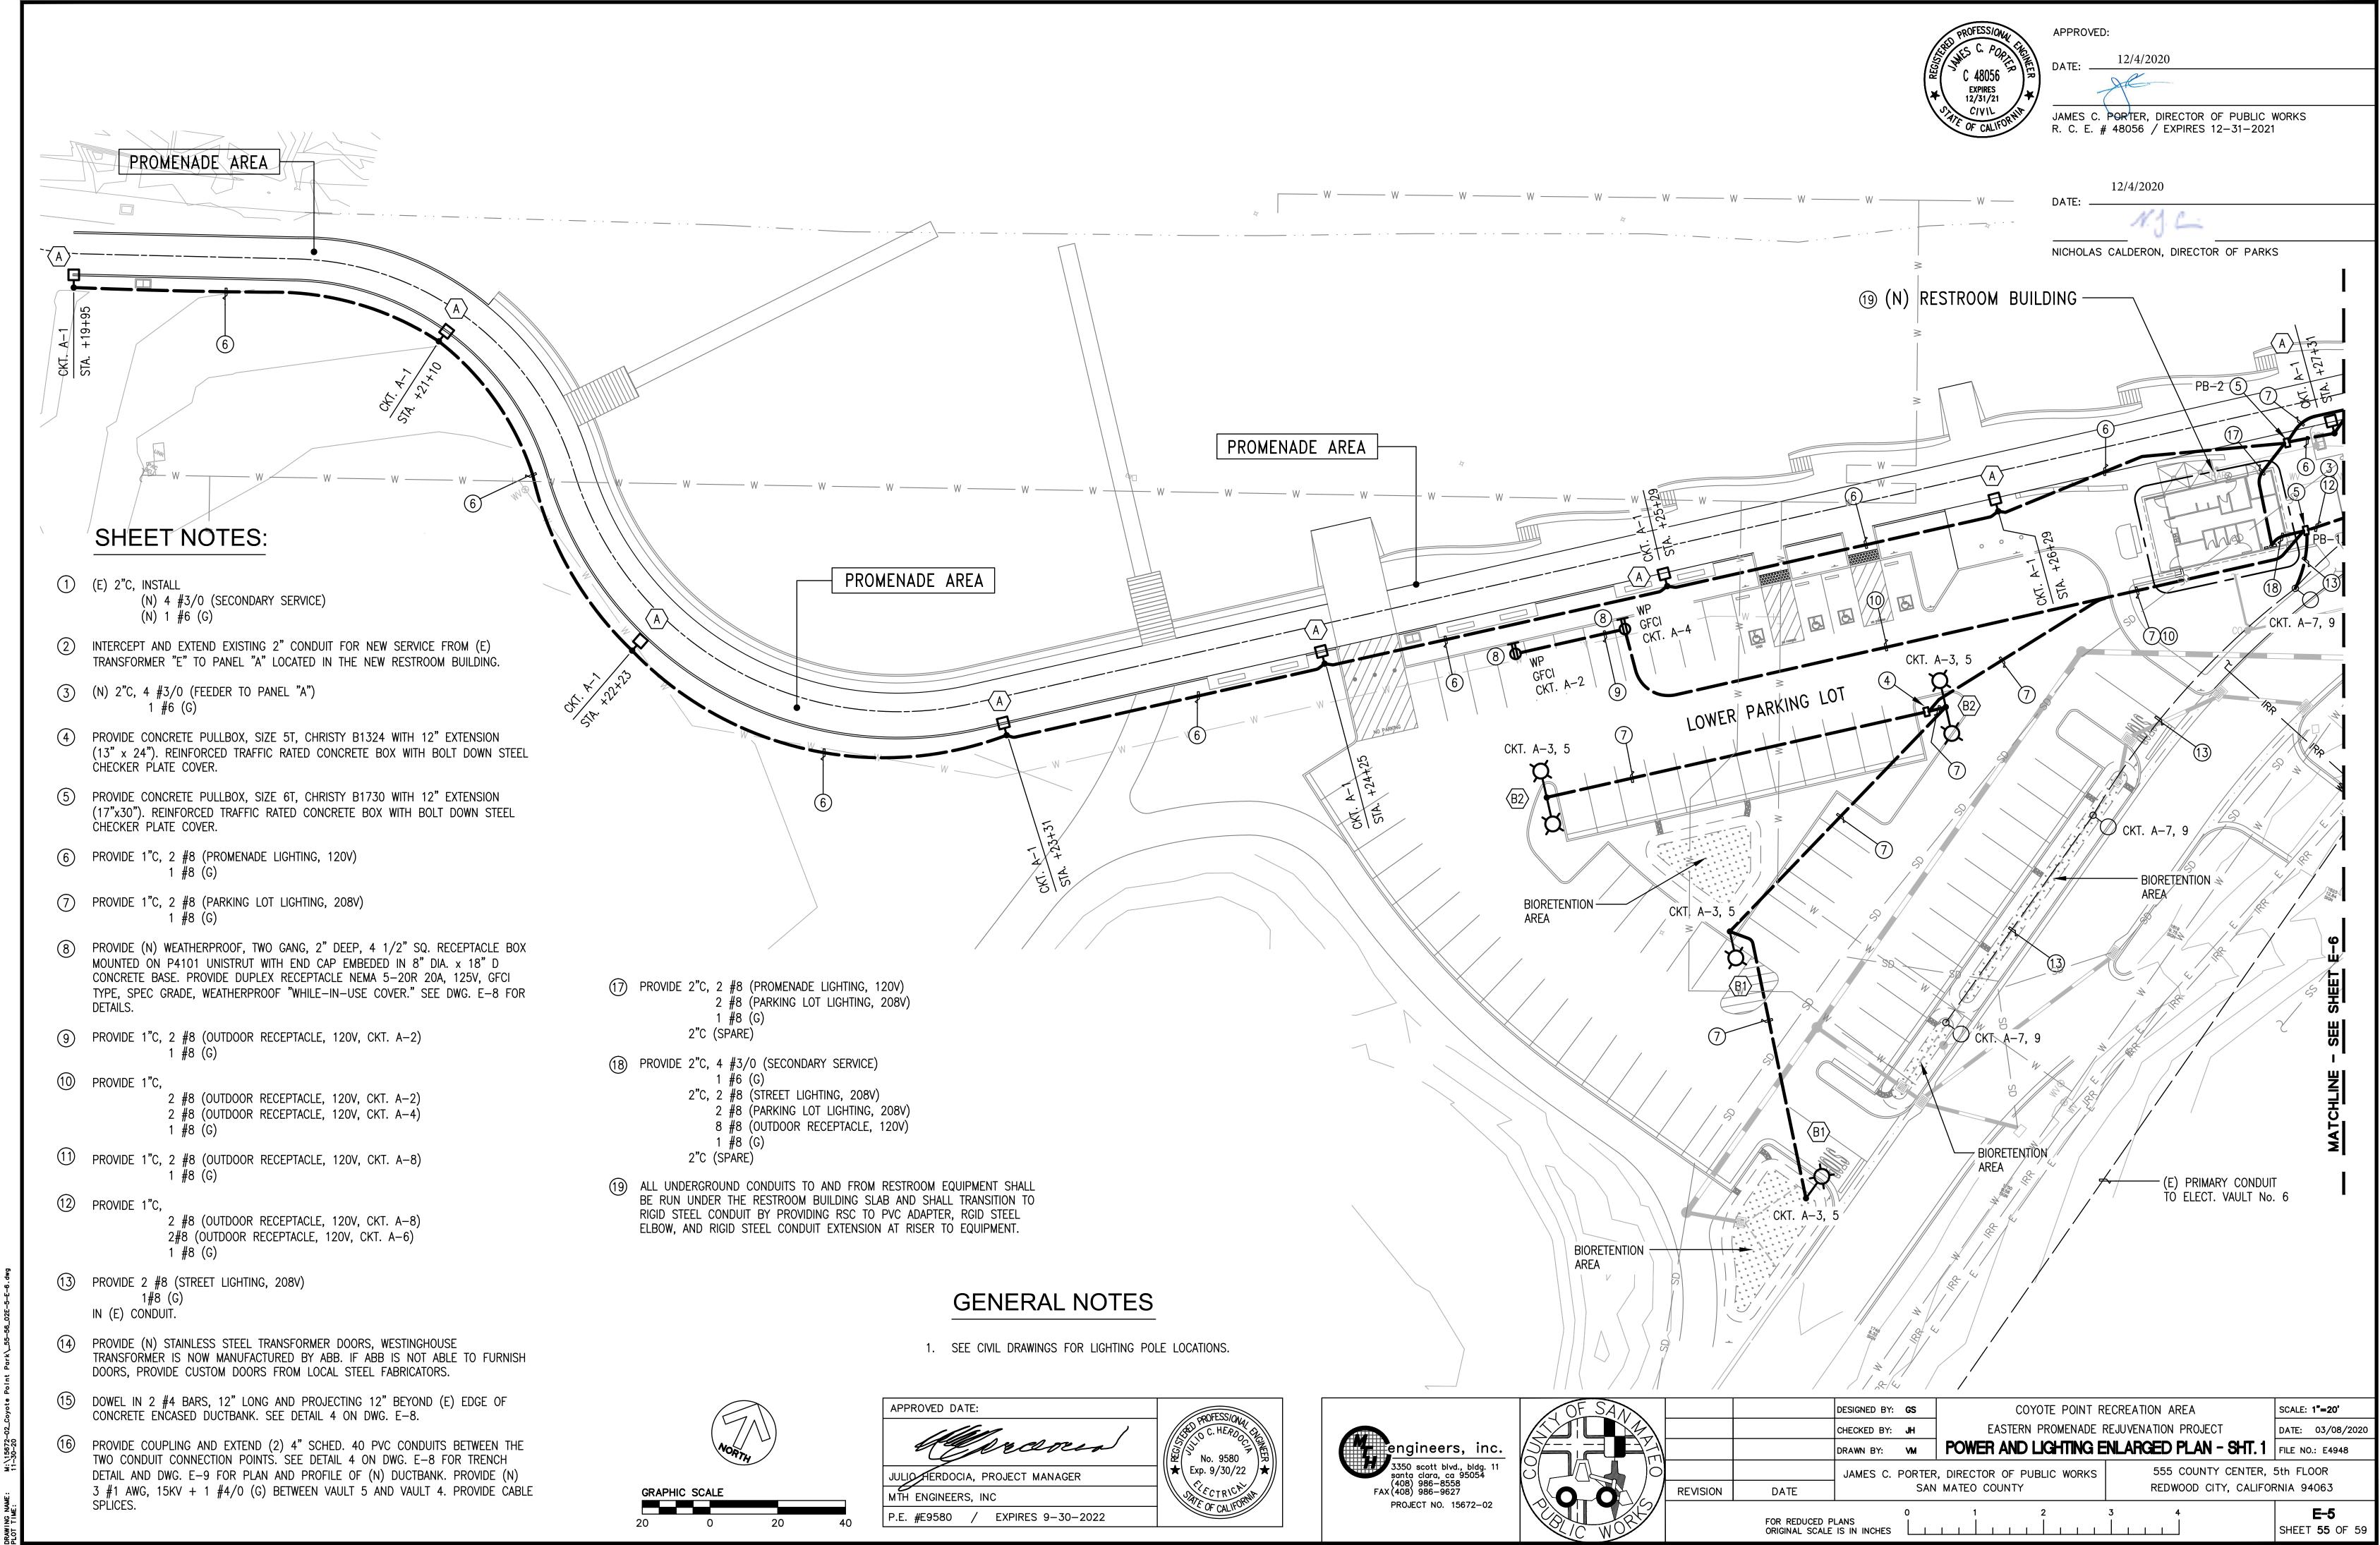

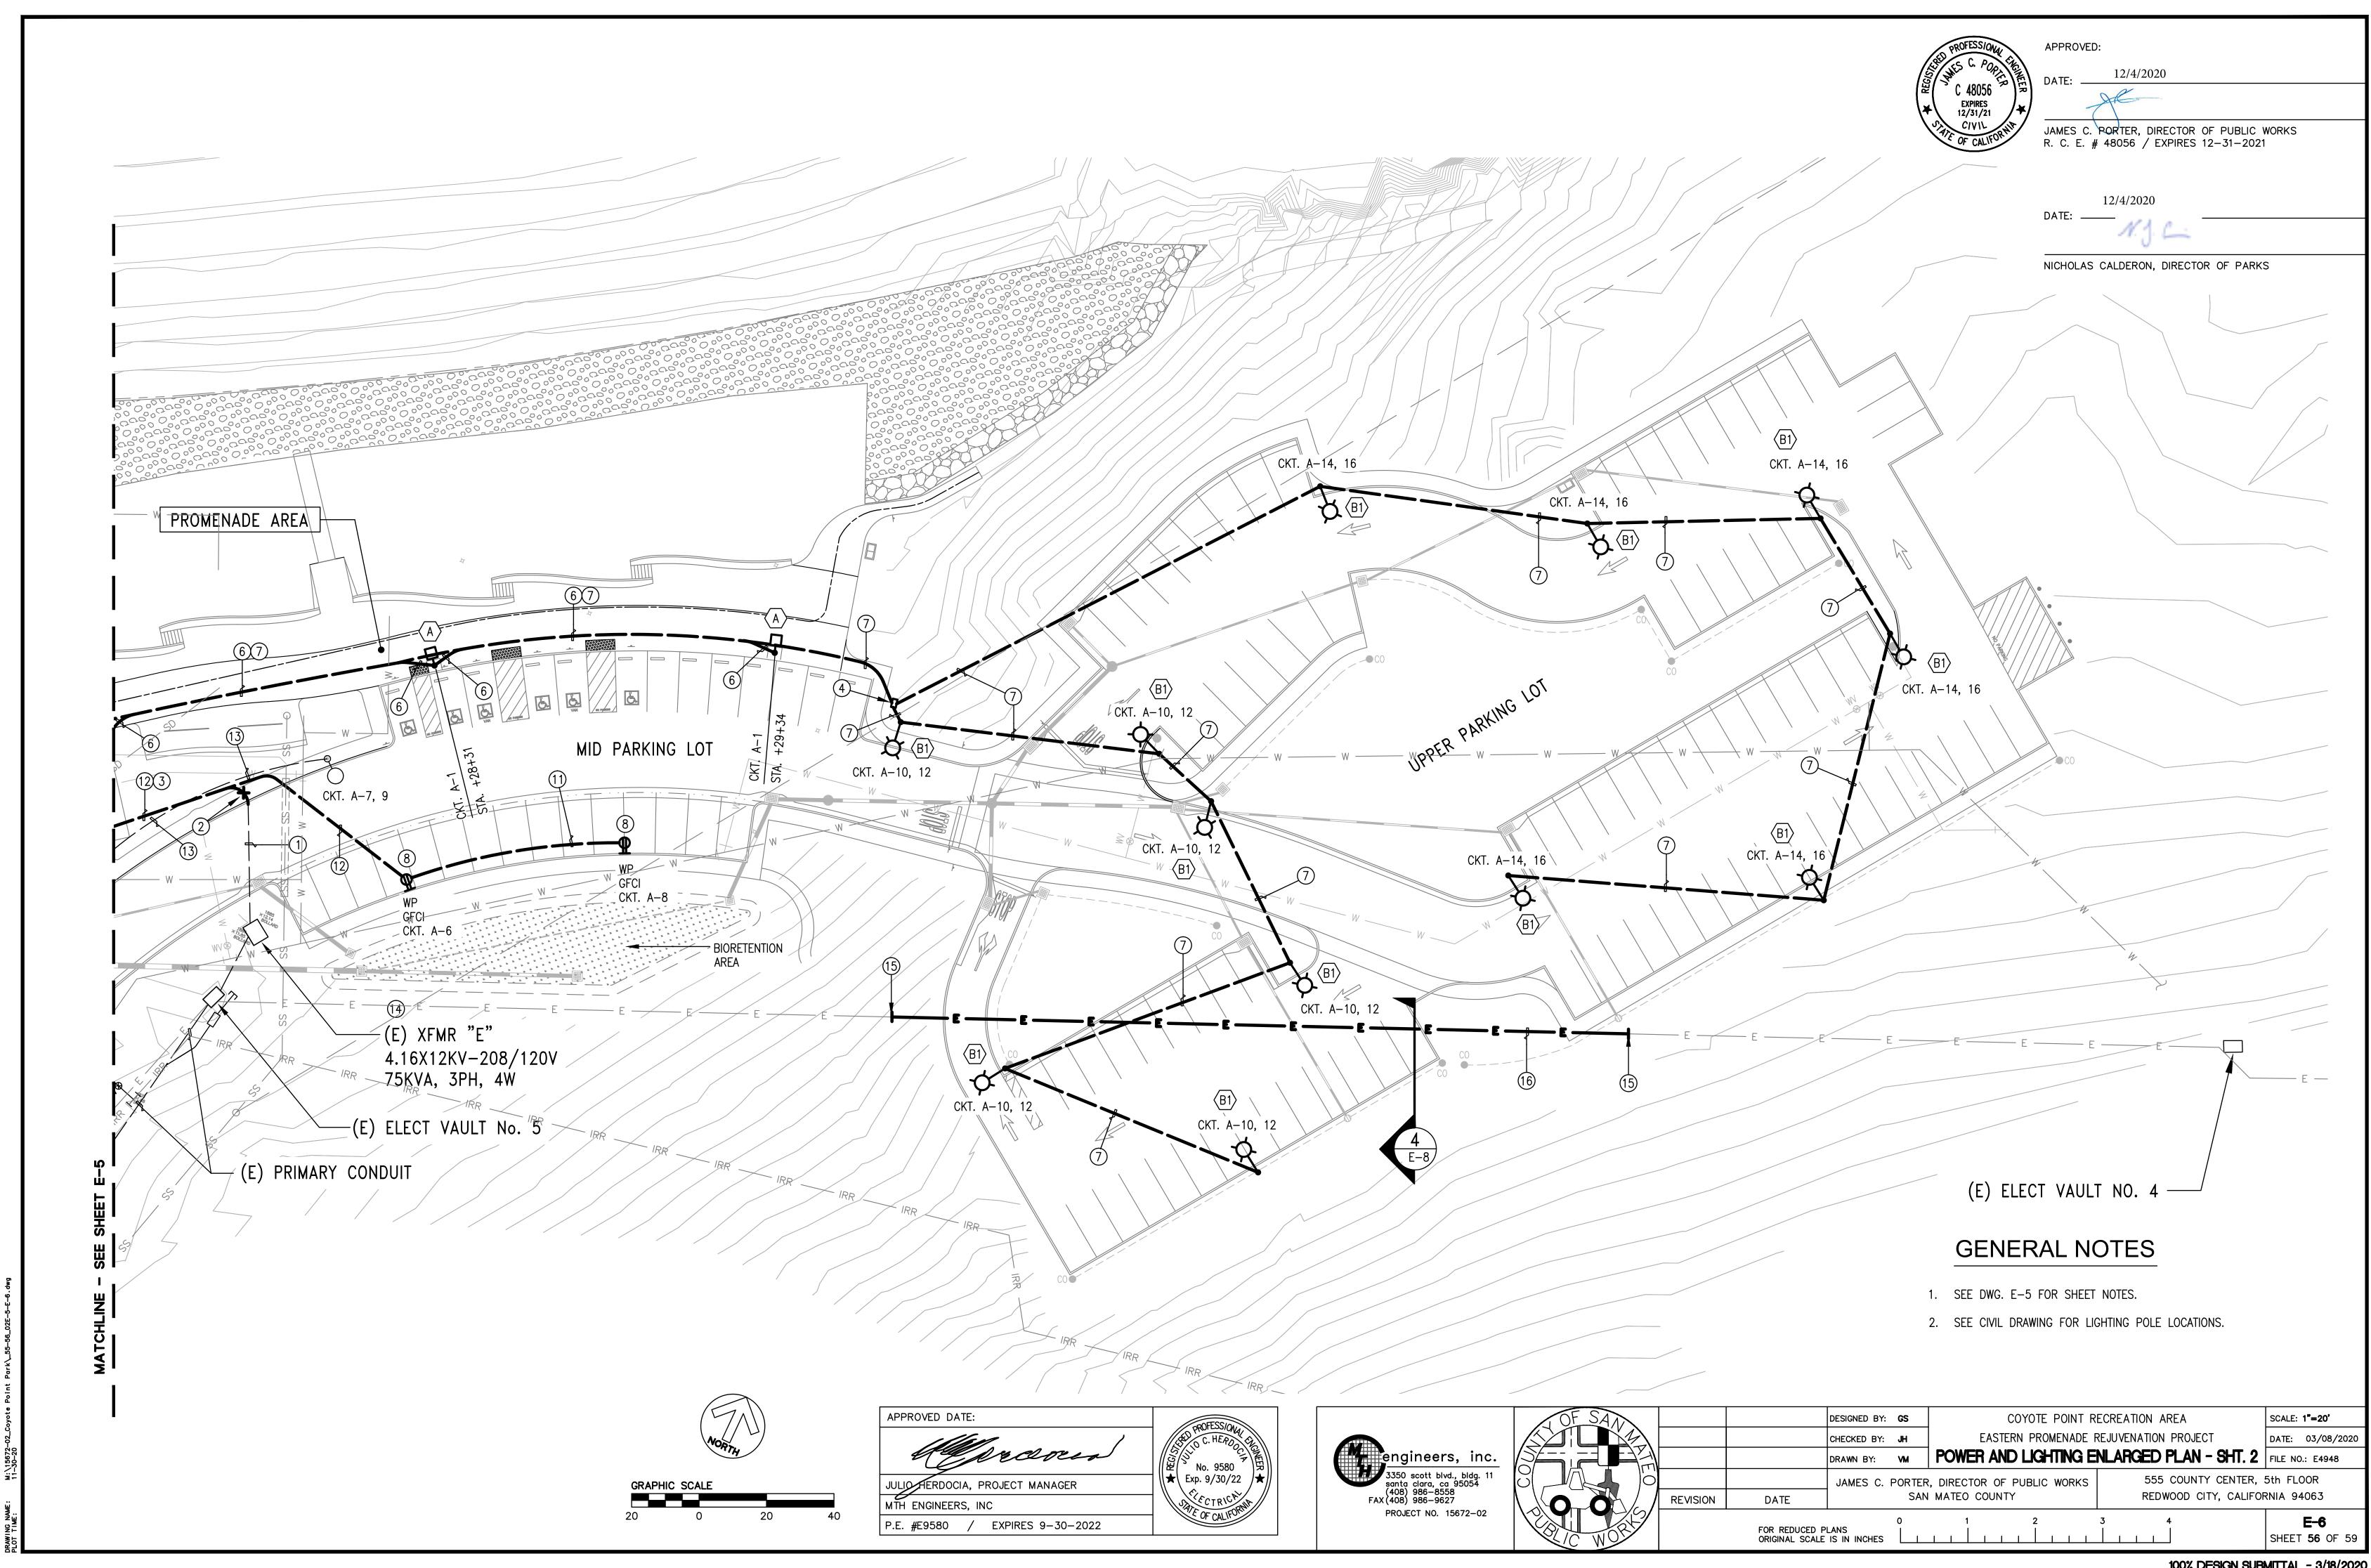

	LIGHTING FIXTURE SCHEDULE																								
MARK	MANUFACTURER'S MODEL NO.	LAMPS QTY. TYPE																						MOUNTING	DESCRIPTION AND REMARKS
A	RAB LIGHTING #ALED26  POLE CREE SSS SERIES #SSS-4-11-10-CW-BS-1D-C-BZ	1	(1) LED	26	120	10 FT. POLE MOUNTED	LED AREA WALKWAY LUMINAIRE TYPE IV DISTRIBUTION, FULLY SHIELDED, PRECISION DIE CAST ALUMINUM HOUSING, LENS FRAME. POLYESTER POWDER COATED. WEATHERPROOF HIGH TEMPERATURE SILICONE GASKETS. BRONZE COLOR. UL LISTED, SUITABLE FOR WET LOCATIONS.																		
B1	RAB LIGHTING #ALED3T78  POLE CREE SSS SERIES #SSS-4-7-25-CW-BS-1D-C-BZ, EXCEPT 22'-6" HEIGHT	1	(6) 13W LED	78	208	22'-6" FT. POLE MOUNTED	LED AREA PARKING LOT LUMINAIRE TYPE III DISTRIBUTION, FULLY SHIELDED, PRECISION DIE CAST ALUMINUM HOUSING, LENS FRAME AND MOUNTING ARM. POLYESTER POWDER COATED. WEATHERPROOF HIGH TEMPERATURE SILICONE GASKETS. BRONZE COLOR. UL LISTED, SUITABLE FOR WET LOCATIONS.																		
B2	RAB LIGHTING #ALED3T78  POLE CREE SSS SERIES #SSS-4-7-25-CW-BS-2D18-C-BZ, EXCEPT 22'-6" HEIGHT	2	(6) 13W LED	156	208	22'-6" FT. POLE MOUNTED	SAME AS TYPE B1 EXCEPT TWIN HEAD.																		

ENCLOSURE NEMA 1 , INTERRUPTING DUTY							20/2	.08V	VOLT	,	3	PHAS	Ε,	4		WIRE
MOUNTING <u>SURFA</u>			KER_	22K		Α,		150	_ A.	MAIN	BREA	AKER,		250	Α.	BUS
	LC	DADS-V	/A	BKR.	скт.	PH	ASE	CKT.	BKR.	´ L(	DADS-	VA				
DESCRIPTION	Α	В	С	POLE	NO.		B C		POLE	<u> </u>	В	С		DESCR	PTI	ON
PROMENADE LIGHTING	260			20/1	1	•	$\overline{++}$	2	20/1	600			OUTDOOF	RECPT LO	OWER F	ARKING LOT
LOWER PARKING LOT LIGHTING		195		20 /	3	-	<del> </del>	4	20/1		600		OUTDOOF	RECPT LO	OWER F	ARKING LOT
LOWER PARKING LOT LIGHTING			195	2	5	-	+	6	20/1			600	OUTDOOF	R RECPT M	ID PAR	KING LOT
STREET LIGHTING	156			20 /	7	<b> </b>	++	8	20/1	600			OUTDOOF	R RECPT M	ID PAR	KING LOT
STREET LIGHTING		156		2	9	-	<del> </del>	10	20 /		234		UPPER	PARKING	LOT	LIGHTING
SPARE				20/1	11	-	+	12	/ 2			234	UPPER	PARKING	LOT	LIGHTING
					13	┥	++	14	20 /	234			UPPER	PARKING	LOT	LIGHTING
					15	-	<b>+</b>	16	/ 2		234		UPPER	PARKING	LOT	LIGHTING
					17	-	+	18	20/1				SPARE	<u>-</u>		
					19	<b>                                     </b>	++	20								
		_			21	-	<del> </del>	22								
					23		+	24								
				<b>V</b>	25	┥	++	26	<b> </b>							
		_		20 /	27	-	<del> </del>	28	20 /							
			_	/ 2	29		<u> </u>	30	/ 2			-	<b>†</b>			
	-				31	•	++	32								
					33	-	<del> </del>	34								
			_		35			36				-				
	_				37	•	+	38								
					39	-	<del> </del>	40								
			_		41	_	<del>   </del>	42				-				
	416	351	195							1434	1068	834				
TOTAL: 4.29 KVA PANEL # "A" FEEDER SIZE SEE ONE LINE DIAGRAM																

	RELAY / CIR	CUIT	CON	NTROL	LOAD	CIRCUITS	
RELAY NO.	PANEL A	FIELD CIRCUIT	OFF	ON	RELAY TYPE	LOAD WATTS	NOTES
1	1	A-1	TIMECLOCK	PHOTOCELL	S	260	
2	3, 5	A-3, 5	TIMECLOCK	PHOTOCELL	2	390	
3	7, 9	A-7, 9	TIMECLOCK	PHOTOCELL	2	312	
4	10, 12	A-10,12	TIMECLOCK	PHOTOCELL	2	468	
5	14, 16	A-14,16	TIMECLOCK	PHOTOCELL	2	468	
6					S		SPARE
7					2		
8					2		
					TOTAL	1898	

APPROVED:

DATE:

12/4/2020

JAMES C. PORTER, DIRECTOR OF PUBLIC WORKS R. C. E. # 48056 / EXPIRES 12–31–2021

DATE:

12/4/2020

DATE:


NICHOLAS CALDERON, DIRECTOR OF PARKS


RELAY TYPE: S SINGLE POLE, 120/277V 20A ZMAX

2 2 POLE, 220/480V 20A 3 SINGLE POLE, 347V 20A N NORMALLY CLOSED 120V - 347V

# 1


## LIGHTING CONTROL PANEL SCHEDULE

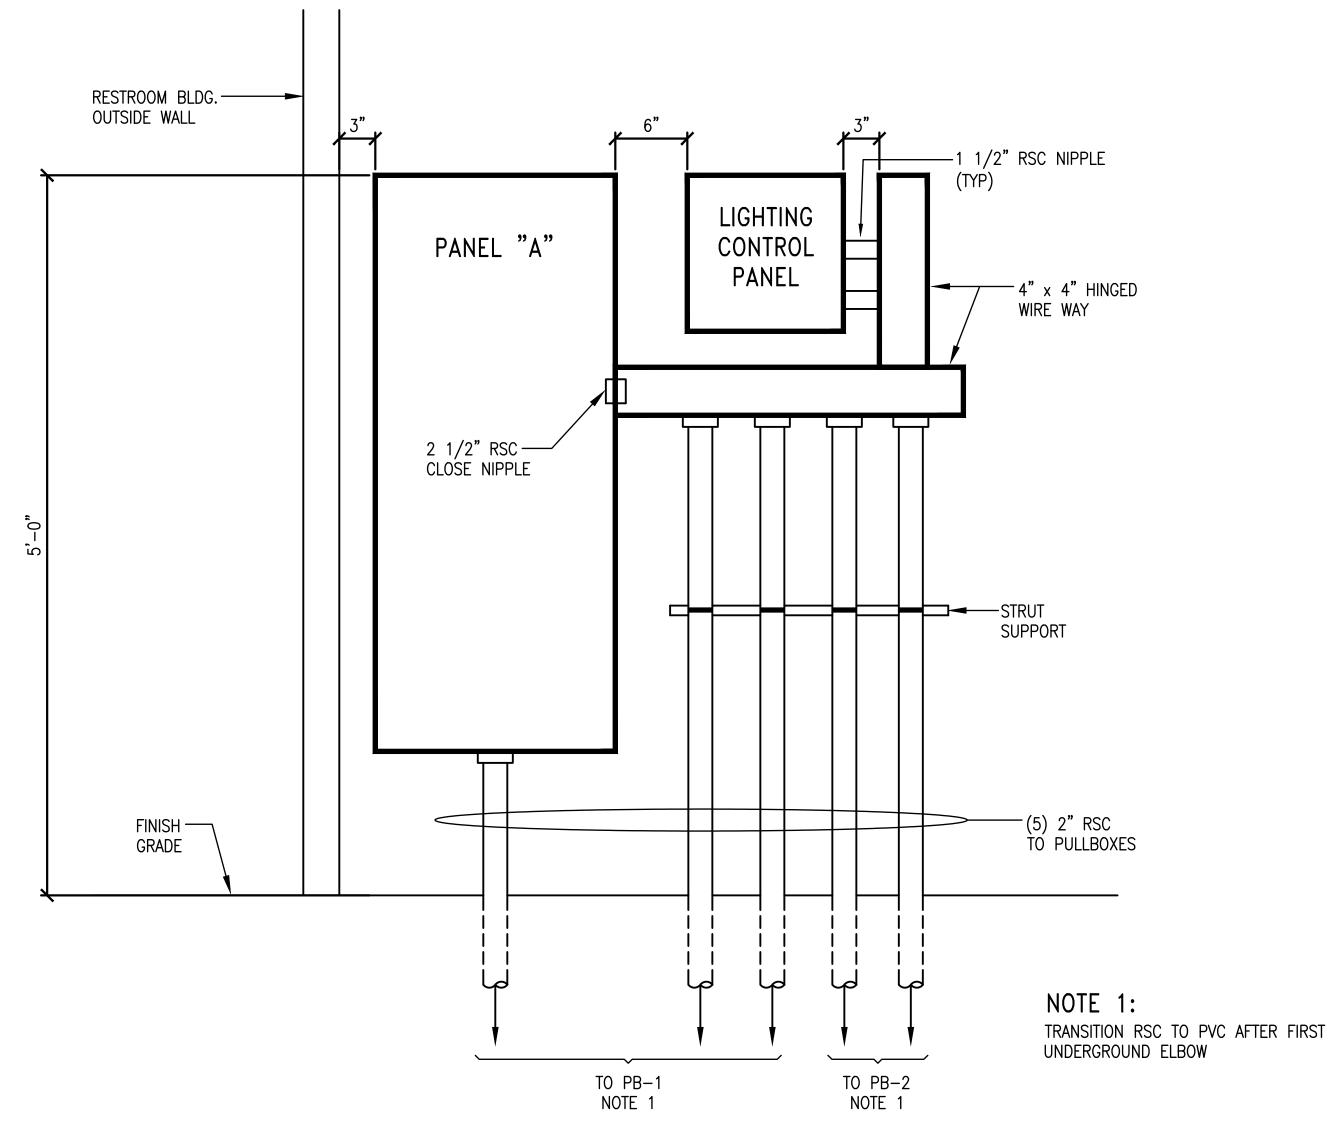



# PANELBOARD AND LIGHTING CONTROL PANEL INSTALLATION DETAIL




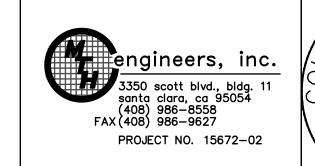


JOF SAM			DESIGNED BY:	GS	ĺ
			CHECKED BY:	JH	
			DRAWN BY:	VM	
			JAMES C.	PORTER	., DI
	REVISION	DATE		SAN	. MA
W NO STATE OF THE PARTY OF THE		FOR REDUCED P ORIGINAL SCALE		0	

### **SHEET NOTES:**

- (1) CONTRACTOR SHALL DRILL AND TAP REDWOOD TRIM INTO THE LIGHTING POLE TO MATCH EXISTING.
- 2 PROVIDE (N) 1" RSC 4 #8 (RECEPTACLE STANCHION) 1 #8 (G)
- 3 PROVIDE (N) WEATHERPROOF, TWO GANG, 2" DEEP, 4 1/2" SQ. RECEPTACLE BOX MOUNTED ON P4101 UNISTRUT WITH END CAP EMBEDDED IN 8" DIA. x 18" D CONCRETE BASE. PROVIDE DUPLEX RECEPTACLE NEMA 5-20R 20A, 125V, GFCI TYPE, SPEC GRADE, WEATHERPROOF "WHILE-IN-USE COVER."

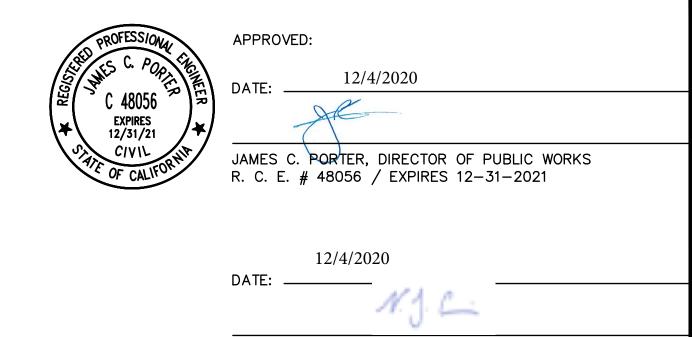

NICHOLAS CALDERON, DIRECTOR OF PARKS

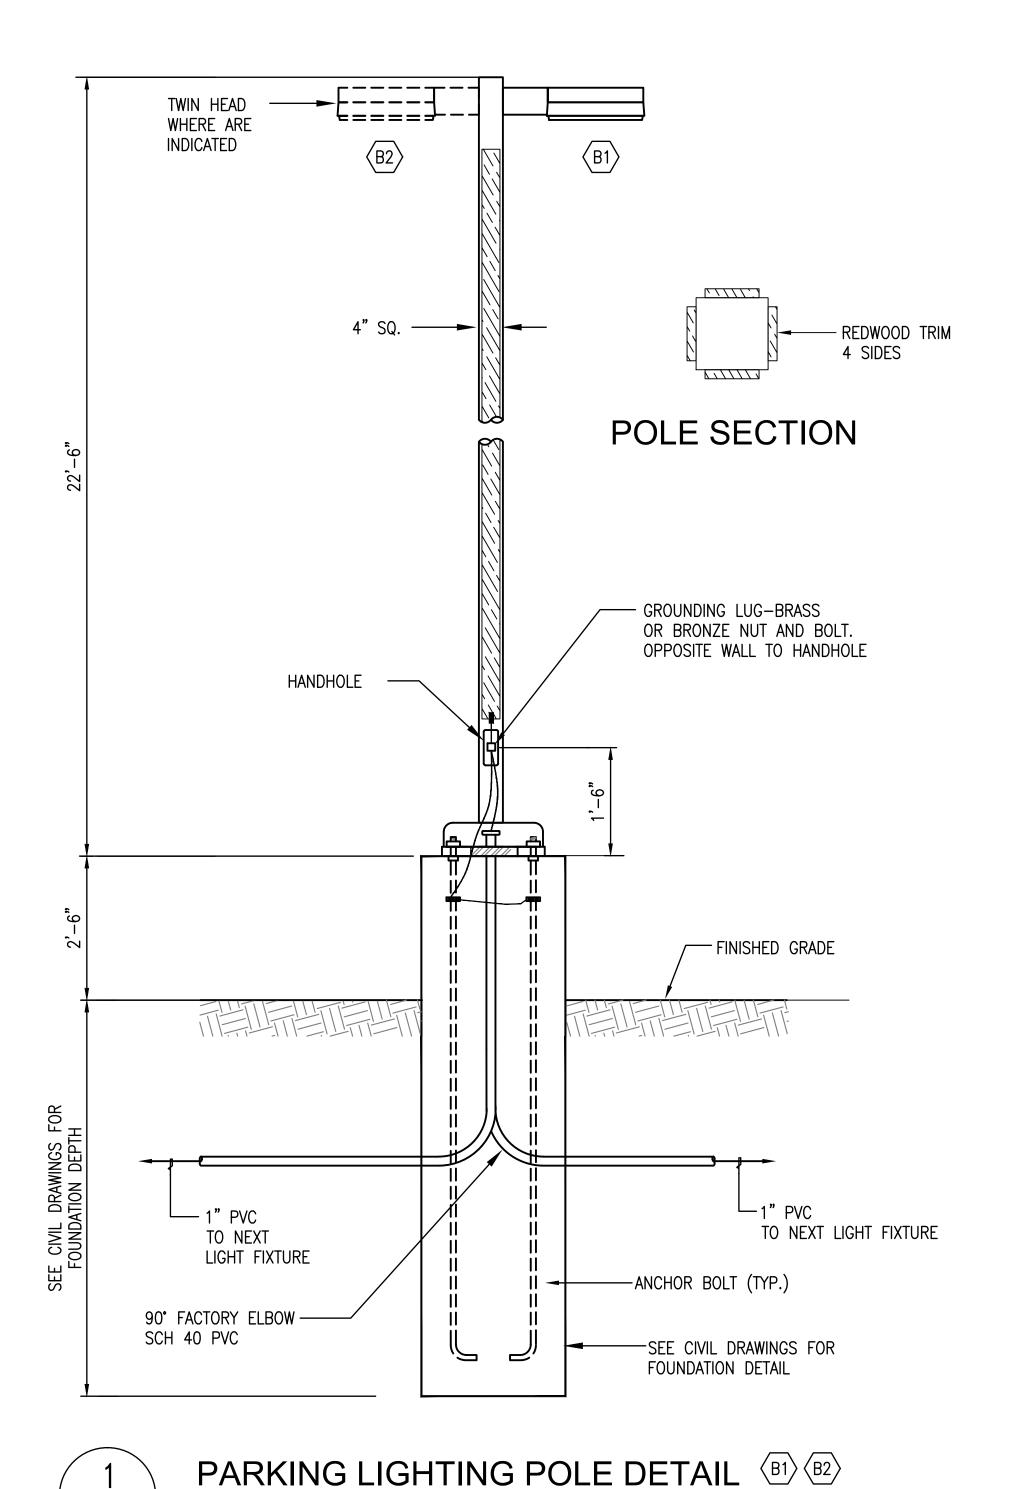

SCALE: NTS

